


Order Plans @ WWW.DIline.com

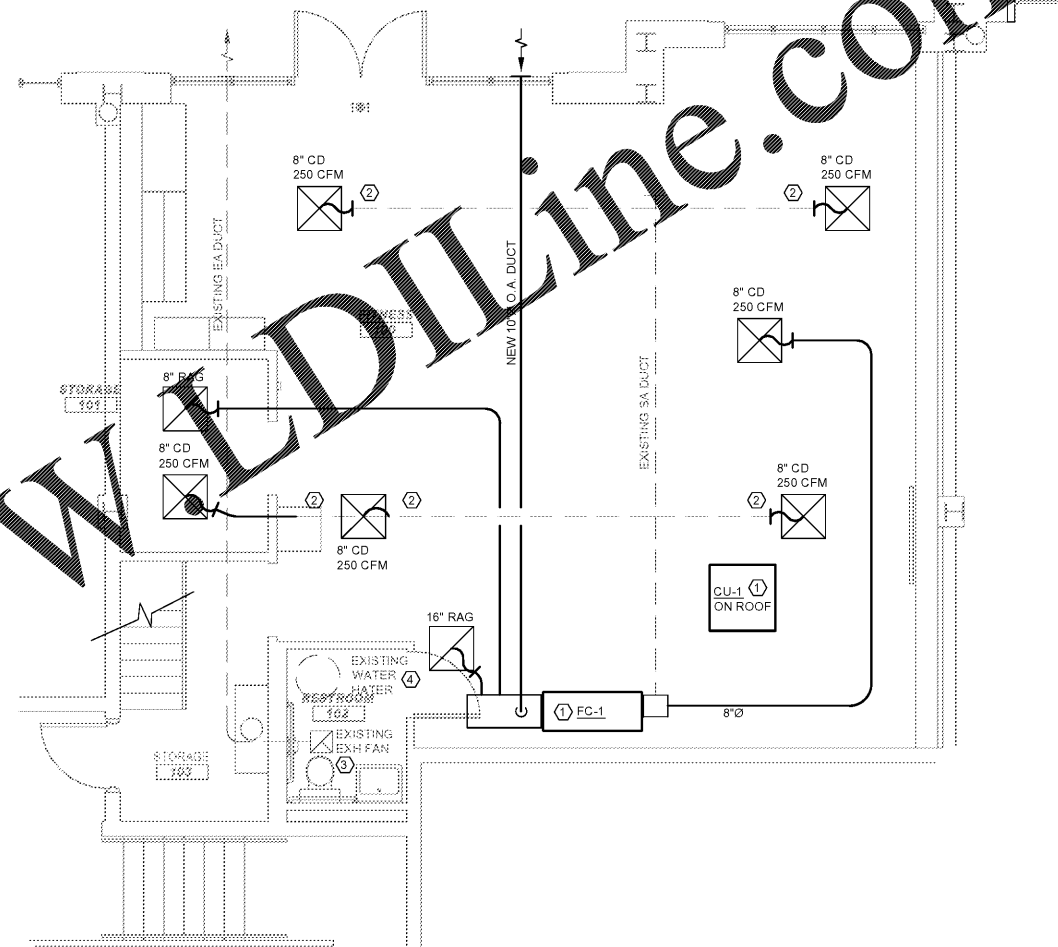

1 MECHANICAL PLAN
M1.10 SCALE: 1/4" = 1'-0"

KEY NOTES: □

1. REPLACE EXISTING FAN COIL AND ASSOCIATED CONDENSING UNIT. FIELD VERIFY EXACT LOCATION OF UNIT ON ROOF.
2. CONNECT NEW DIFFUSER TO EXISTING DUCT WITH FLEX DUCT. HARD DUCT CONNECTION IS NOT ACCEPTABLE.
3. CLEAN AND VERIFY OPERATION OF EXISTING CEILING EXHAUST FAN. PROVIDE SEPARATE LINE ITEM PRICING TO REPLACE EXISTING EXHAUST FAN WITH 75 CFM, GREENHECK SP-B110 OR EQUAL.
4. CHECK OUT AND REPAIR EXISTING WATER HEATER LOCATED ABOVE RESTROOM CEILING. PROVIDE SEPARATE LINE ITEM PRICING TO REPLACE EXISTING WATER HEATER WITH LIKE MODEL.

GENERAL NOTE:

1. ALL NEW AND EXISTING DUCTWORK SHALL BE INSULATED PRIOR TO INSTALLATION OF NEW CEILING.

ISSUES	
11.20.20	PERMIT SET

9Round - Atlanta
1745 Peachtree Road NW, Suite L
Atlanta, GA 30309
Project Number: 739.00
ISSUED FOR CONSTRUCTION

STRUCTURAL

M.E.P. & F.P.
WestSide Engineering
5525 Interstate North Parkway
Suite 200
Atlanta, GA 30328
Phone: 404-242-6240
WE# 20238

CIVIL

