



FIRE PROTECTION KEYNOTES	
APPLIES TO THIS SHEET	
REPRESENTED BY [Symbol]	
1.	PROVIDE A DOUBLE INTERLOCK PREACTION SYSTEM IN SECURITY ELECTRONICS ROOM.
2.	PROVIDE SPRINKLER PROTECTION IN CHASES, IN THE SPACE ABOVE CELL CEILINGS AND ABOVE THE CEILINGS IN THE COMMON AREAS.
3.	NO AUTOMATIC SPRINKLER COVERAGE REQUIRED IN THIS SPACE.
4.	ADD (2) RISERS IN EXISTING SPRINKLER ROOM FOR EACH SMOKE COMPARTMENT IN BUILDING 2 - NEW CONSTRUCTION.
5.	COORDINATE LOCATION OF NEW PIPING WITH EXISTING CONDITIONS.

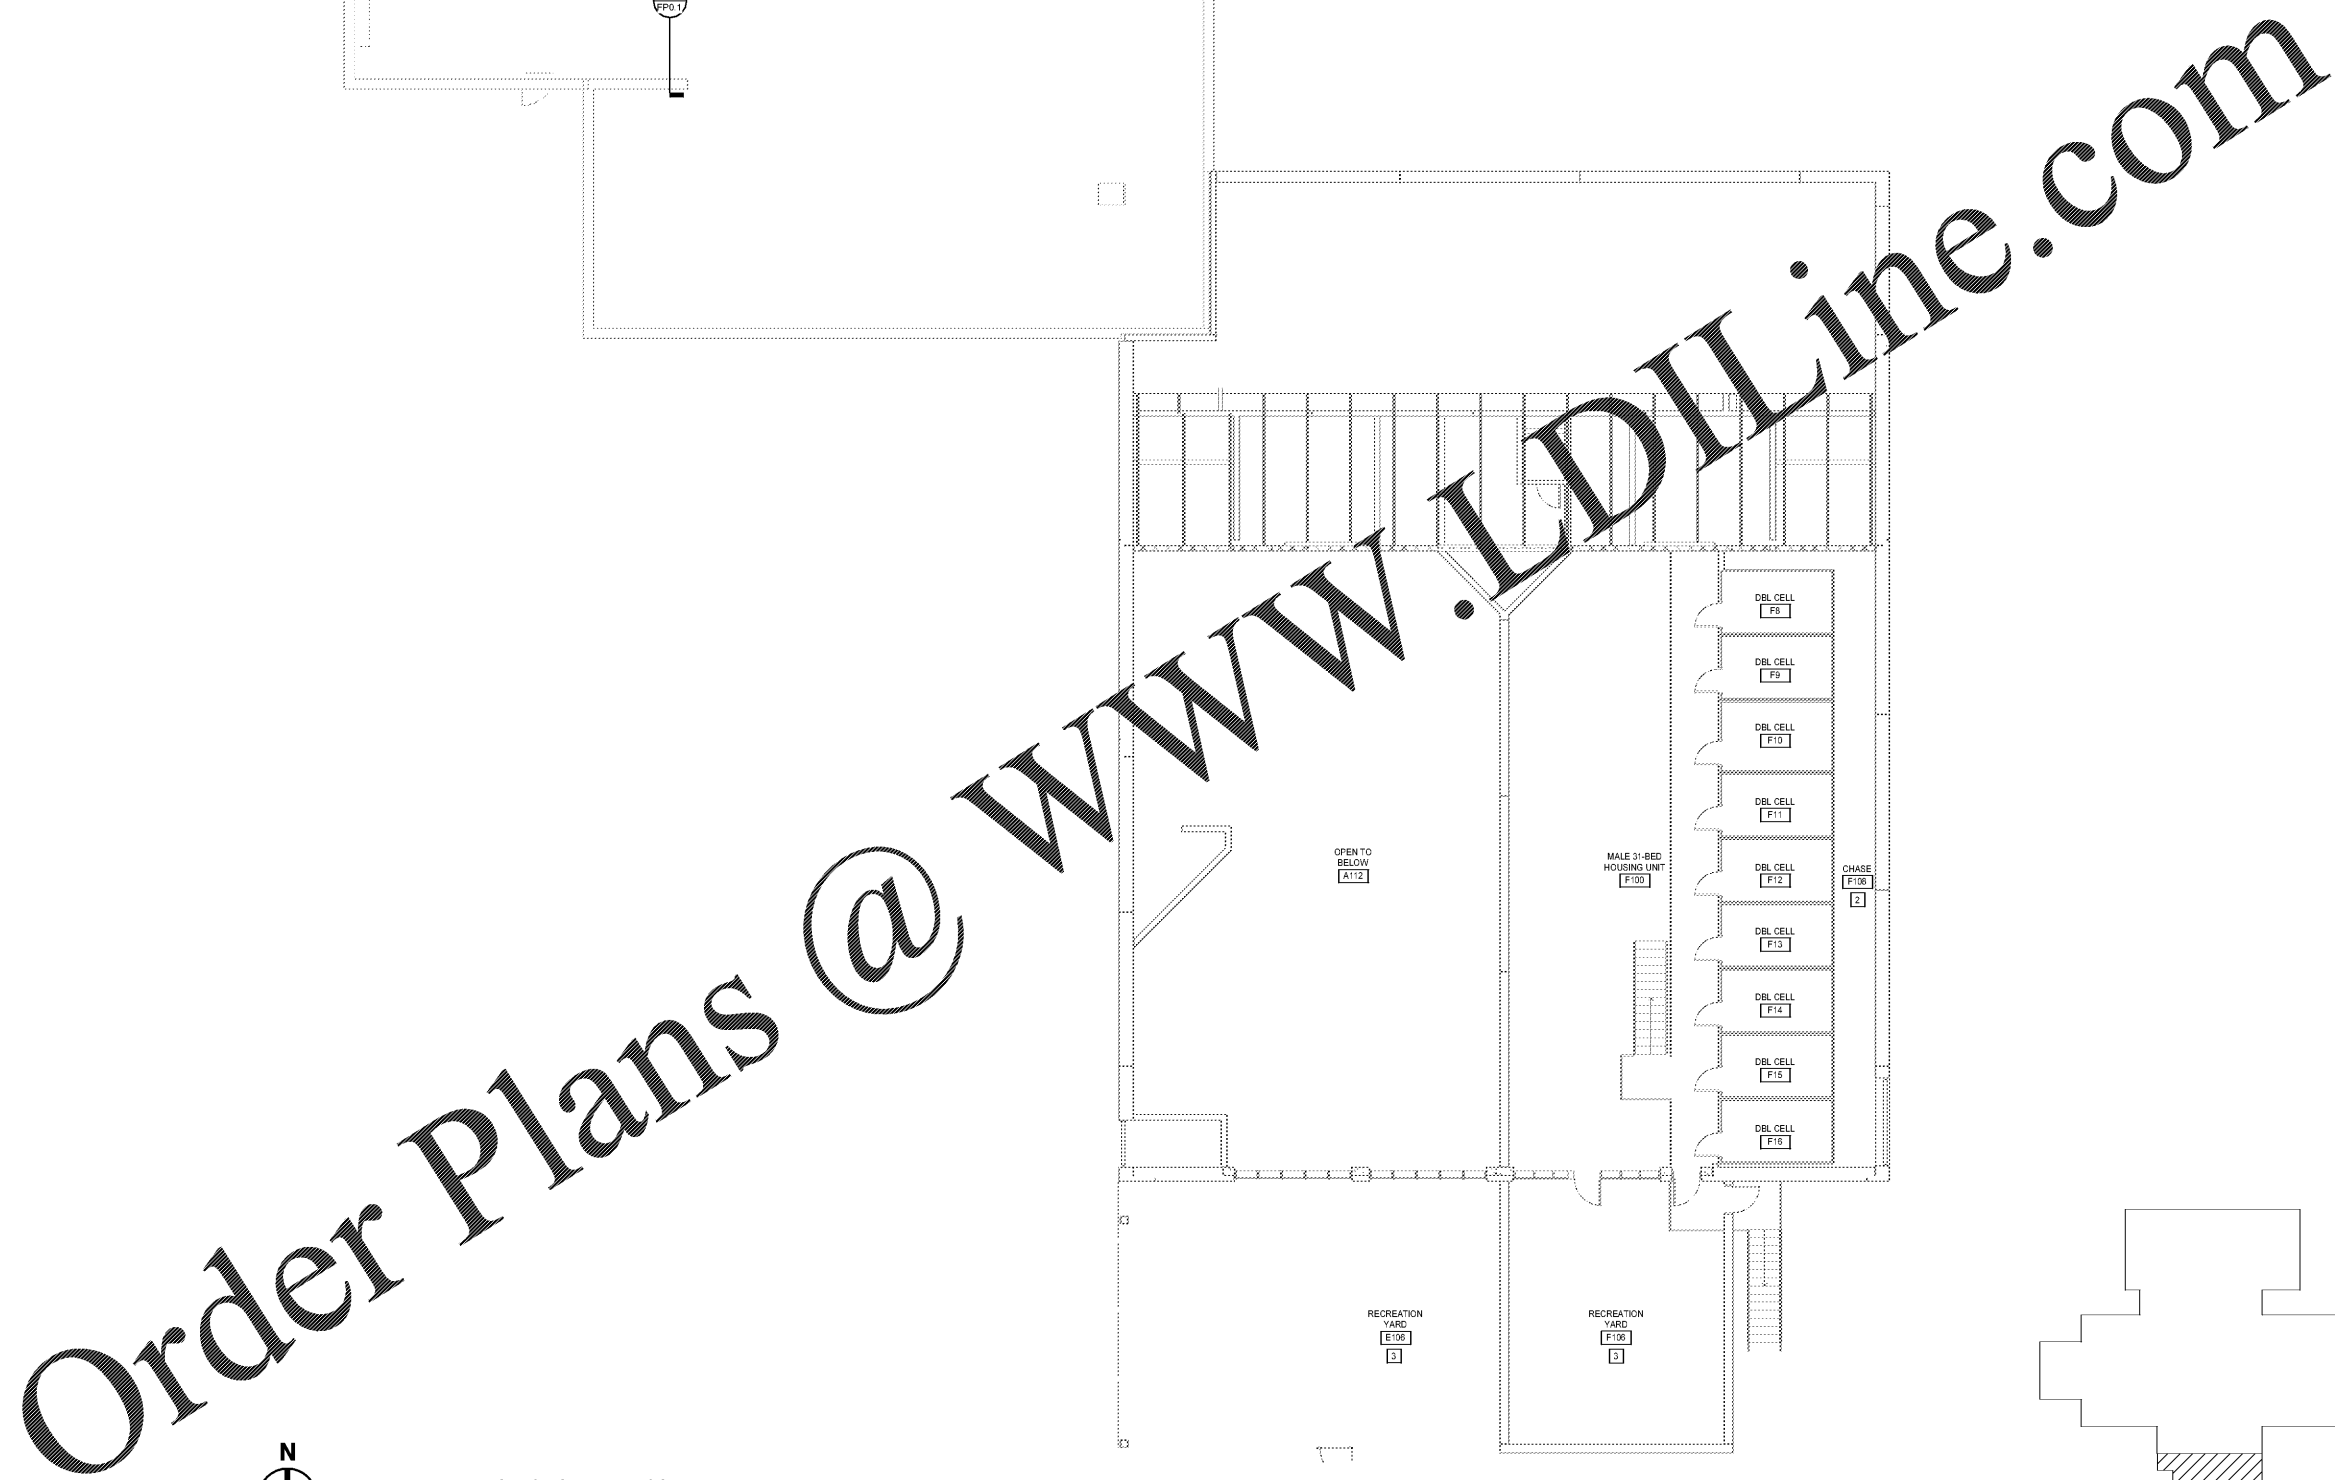

N
MEZZANINE FIRE PROTECTION PLAN - SOUTH
1/8" = 1'-0"

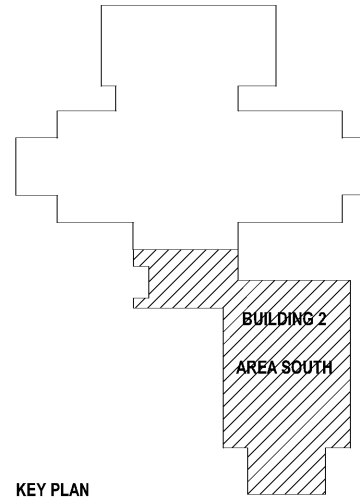

MOSELEYARCHITECTS



1320 MAIN STREET, SUITE 300, COLUMBIA, SC 29201
PHONE (803) 724-1252
MOSELEYARCHITECTS.COM

MARION COUNTY LEC

591492
MARION COUNTY
2715 EAST HWY 76, MULLINS, SC 29574

PROJECT NO.	DATE	REVISIONS
591492	OCTOBER 30, 2020	

MEZZANINE FIRE PROTECTION PLAN - SOUTH

FP2.2.1

10/30/2020 9:47:35 AM