


10/29/2020 3:50:37 PM


J
H
G
F
E
D
C
B
A

1 2 3 4 5 6 7 8 9 10

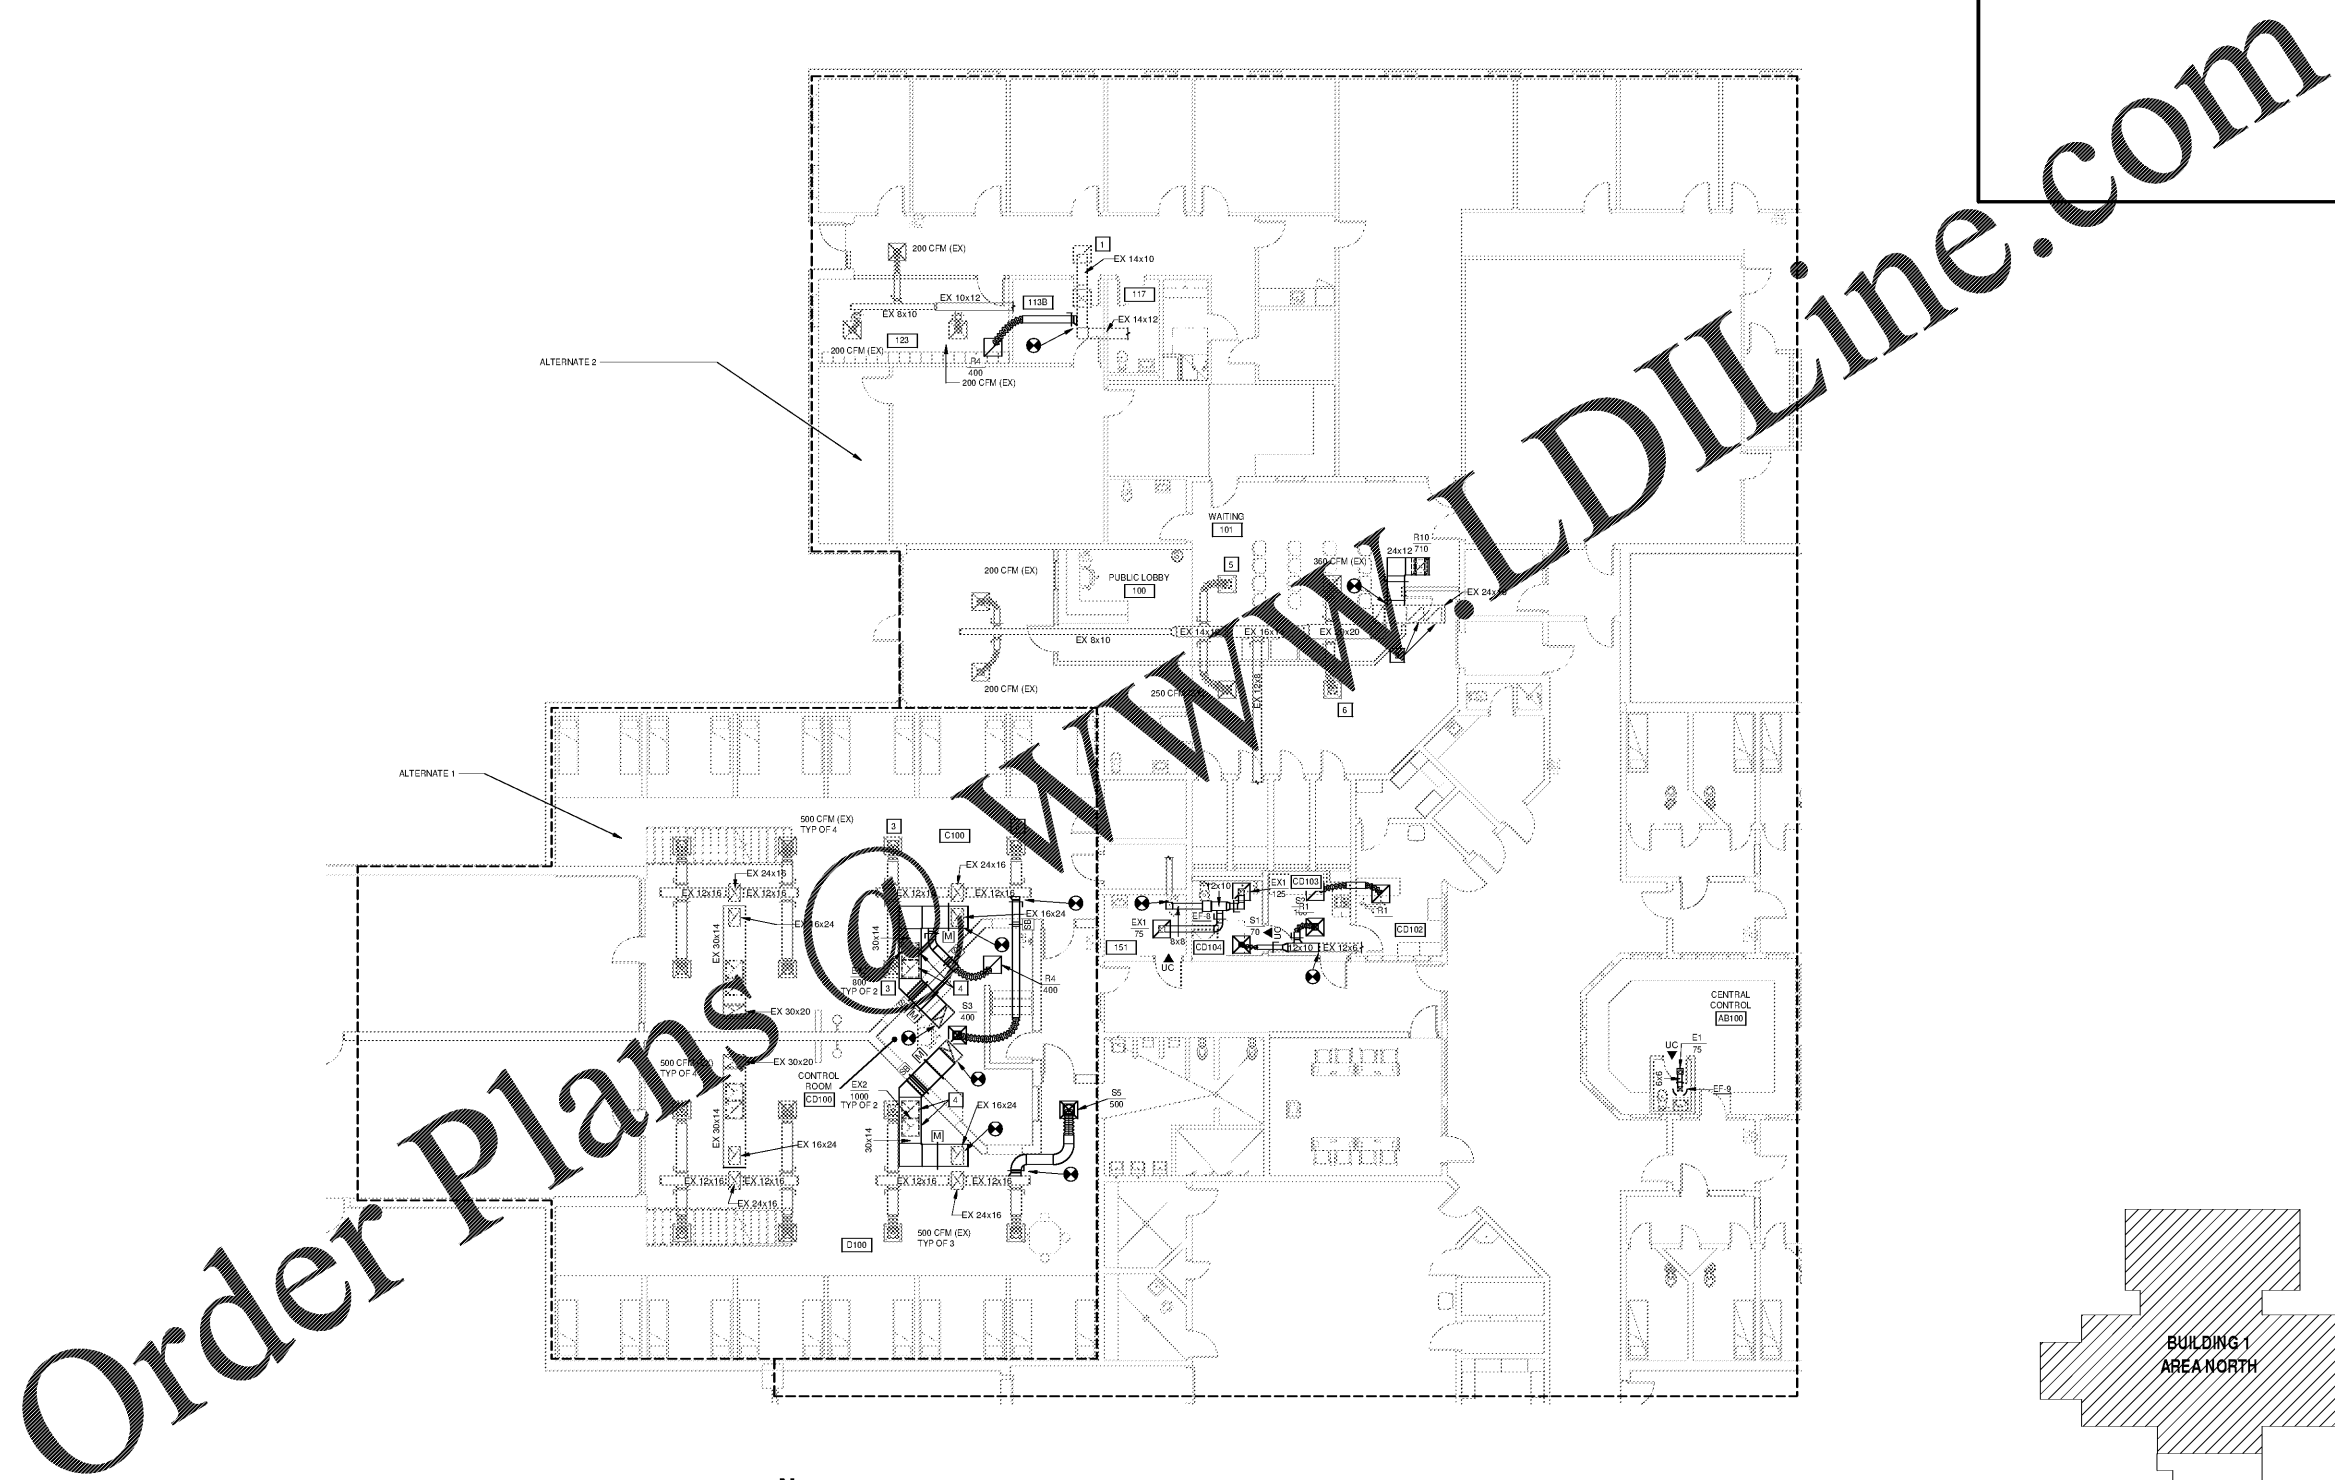

N
 FIRST FLOOR PLAN - DUCTWORK - EXISTING BUILDING
 1/8" = 1'-0"

KEYNOTES	
APPLIES TO THIS DRAWING	
REPRESENTED BY [n]	
1.	BALANCE TO 200 CFM
2.	BALANCE RETURN AIR GRILLES TO EQUAL THE ROOM SUPPLY AIR TOTAL
3.	BALANCE SUPPLY AIR TO 535 CFM
4.	PROVIDE MANUAL BALANCING DAMPER IN DUCT RISE TO RETURN OR EXHAUST GRILLE
5.	BALANCE TO 350 CFM
6.	BALANCE TO 260 CFM

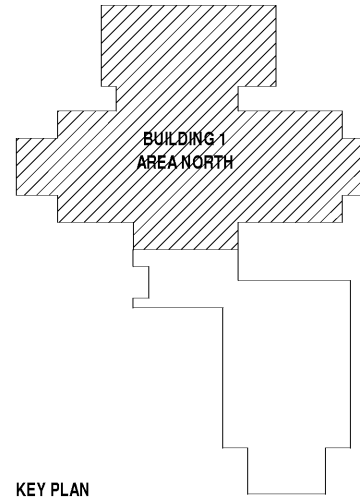

MOSELEYARCHITECTS



6210 ARDREY HELL ROAD - THE HUB AT WAVERLY, SUITE 425 - CHARLOTTE, NC 28277
 PHONE (704) 540-3755 FAX (704) 540-3754
 MOSELEYARCHITECTS.COM

MARION COUNTY LEC
 591492
 MARION COUNTY
 2715 EAST HWY 76, MULLINS, SC 29574

DATE	REVISIONS
10/29/2020	1

FIRST FLOOR PLAN -
 DUCTWORK -
 EXISTING BUILDING

M2.1