Order Plans @ www.LDILine.com

COMM KEYNOTES

APPLIES TO E2.X.3 SERIES DRAWINGS
REPRESENTED BY (n)

1. PROVIDE TWO 2" CONDUITS FROM EXISTING TELECOM ROOM TO CABLE TRAY IN BUILDING 2. FIELD COORDINATE ROUTING TO AVOID CONFLICTS. PROVIDE ONE 12 STRAND FIBER FROM EXISTING TELECOM ROOM TO SECURITY ROOM VIA ONE CONDUIT AND CABLE TRAY. PROVIDE PULL STRING IN THE OTHER CONDUIT. PROVIDE INNER DUCT FOR FIBER WHERE ROUTED IN CABLE TRAY. (THIS WORK IS BASE BID)
2. PROVIDE ONE 2 POST RACK TO MATCH EXISTING. COORDINATE LOCATION WITH SE CONTRACTOR AND OWNER. (THIS WORK IS BASE BID)
3. PROVIDE FOUR 2" CONDUITS WITH PULL STRING FROM EXISTING CONTROL ROOM TO SECURITY ROOM IN BUILDING 2. FIELD COORDINATE ROUTING TO AVOID CONFLICTS. ONE SHALL BE USED BY THE FIRE ALARM CONTRACTOR, ONE BY THE SECURITY CONTRACTOR, AND TWO SPARE. (THIS WORK IS BASE BID)
4. THE RTU'S AND EF'S IN ZONE 1 AND 2 ARE CURRENTLY CONTROLLED BY THE BAS VIA INPUT FOR THE FIRE ALARM SYSTEM. REFER TO THE FIRE ALARM/SMOKE CONTROL MATRIX ON DRAWING E4.1 FOR THE REVISED OPERATION OF THE EQUIPMENT ASSOCIATED WITH THE SMOKE CONTROL FOR SMOKE ZONES 1 AND 2. PROVIDE FIRE ALARM CONTROL AND MONITOR MODULES FOR THIS EQUIPMENT TO CONTROL AND MONITOR THE STATUS OF THE EQUIPMENT DIRECTLY FROM THE FIRE ALARM CONTROL PANEL (AND OVERRIDE THE BAS CONTROLS) AS INDICATED ON THE FIRE FIGHTER CONTROL PANEL (FFSCP) ON DRAWING E4.2. ALSO WIRE THE CONTROL SWITCHES ON THE FFSCP INDICATED ON DRAWING E4.2 TO CONTROL THE EQUIPMENT PER THE SEQUENCE OF OPERATION INDICATED THEREIN.
5. PROVIDE 4'X8'X3/4" FIRE RESISTANT PLYWOOD MOUNTED WITH LONG DIMENSION MOUNTED VERTICALLY ON WALLS AS INDICATED.
6. PROVIDE 18" LADDER TRAY AT 9'-6". TYPICAL FOUR (4) CONDUITS ASSIGNED WITH LADDER TRAY THRU WALL TO THE CABLE TRAY IN CORRIDOR. REFER TO CABLE TRAY WALL PENETRATION DETAIL ON DRAWING E4.1 FOR SIMILAR INSTALLATION.

GENERAL NOTES

A. REFER TO ARCHITECTURAL DRAWINGS FOR SMOKE COMPARTMENTS LOCATIONS.

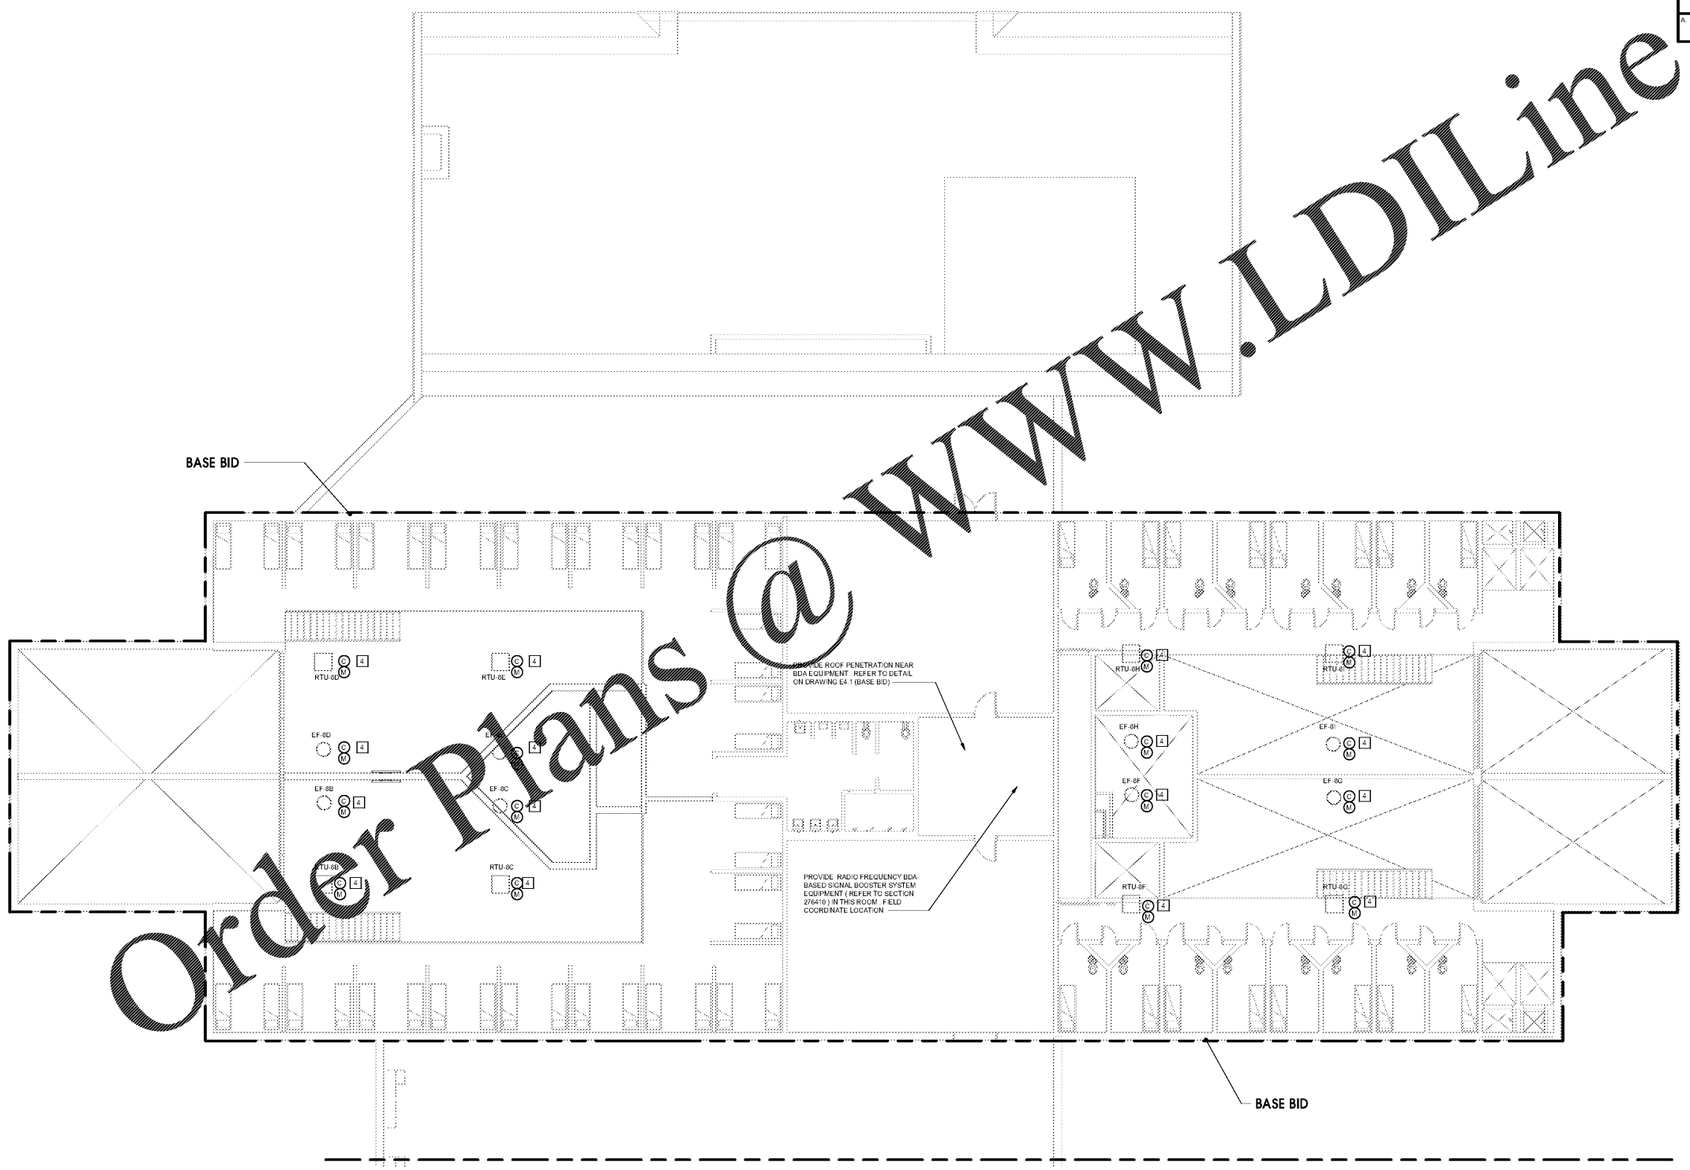

MEZZANINE FLOOR PLAN - AREA NORTH - COMMUNICATIONS
1/8" = 1'-0"

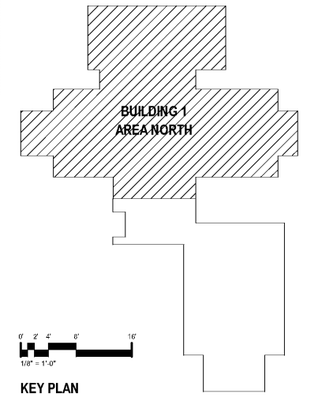

KEY PLAN

MOSELEY ARCHITECTS
6210 ARDREY KELL ROAD - THE HUB AT WAVERLY SUITE 425 - CHARLOTTE, NC 28277
PHONE (704) 540-3755 FAX (704) 540-3754
MOSELEYARCHITECTS.COM

SOUTH CAROLINA PROFESSIONAL ENGINEER
WILLIAM J. CARY
No. 34883
10/30/20

SOUTH CAROLINA
MOSELEY ARCHITECTS
No. 3983
CERTIFICATE OF AUTHORIZATION

MARION COUNTY LEC

591492
MARION COUNTY
2715 EAST HWY 76, MULLINS, SC 29574

PROJECT NO: 591492	
DATE	OCTOBER 30, 2020
REVISIONS	
DATE	DESCRIPTION

MEZZANINE FLOOR PLAN - AREA NORTH - COMMUNICATIONS

E2.3.3

10/30/2020 1:22:35 PM