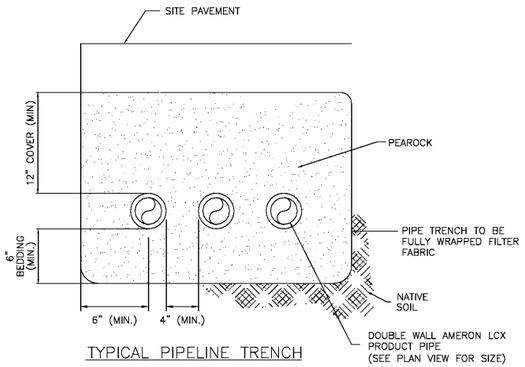

TYPICAL PIPELINE TRENCH

NOTE:

1. SEE SHEET TA–2.1 FOR SITE SPECIFIC PRODUCT DISPENSER AND PIPING LAYOUT NUMBER OF PRODUCT DISPENSER VARIES.
2. SEE TA–3.2 FOR GENERAL CONDUIT REQUIREMENTS. SEE SITE ELECTRICAL PLAN FOR SITE SPECIFIC ELECTRICAL REQUIREMENTS LAYOUT
3. CONTRACTOR OF VERIFY PRODUCT CONFIGURATION AND PIPE PRODUCT ACCORDINGLY.

LEGEND

P– PREMIUM UNLEADED	—P—
R– REGULAR UNLEADED	—R—
V– VENT	—V—
D– DIESEL	— D —
EO – NON–ETHONAL UNLEADED	—EO—

F = FILL
V = TANK VENT
ATG = AUTOMATIC TANK GAUGE
STP = SUBMERSIBLE TURBINE PUMP
AS = ANNULAR SPACE

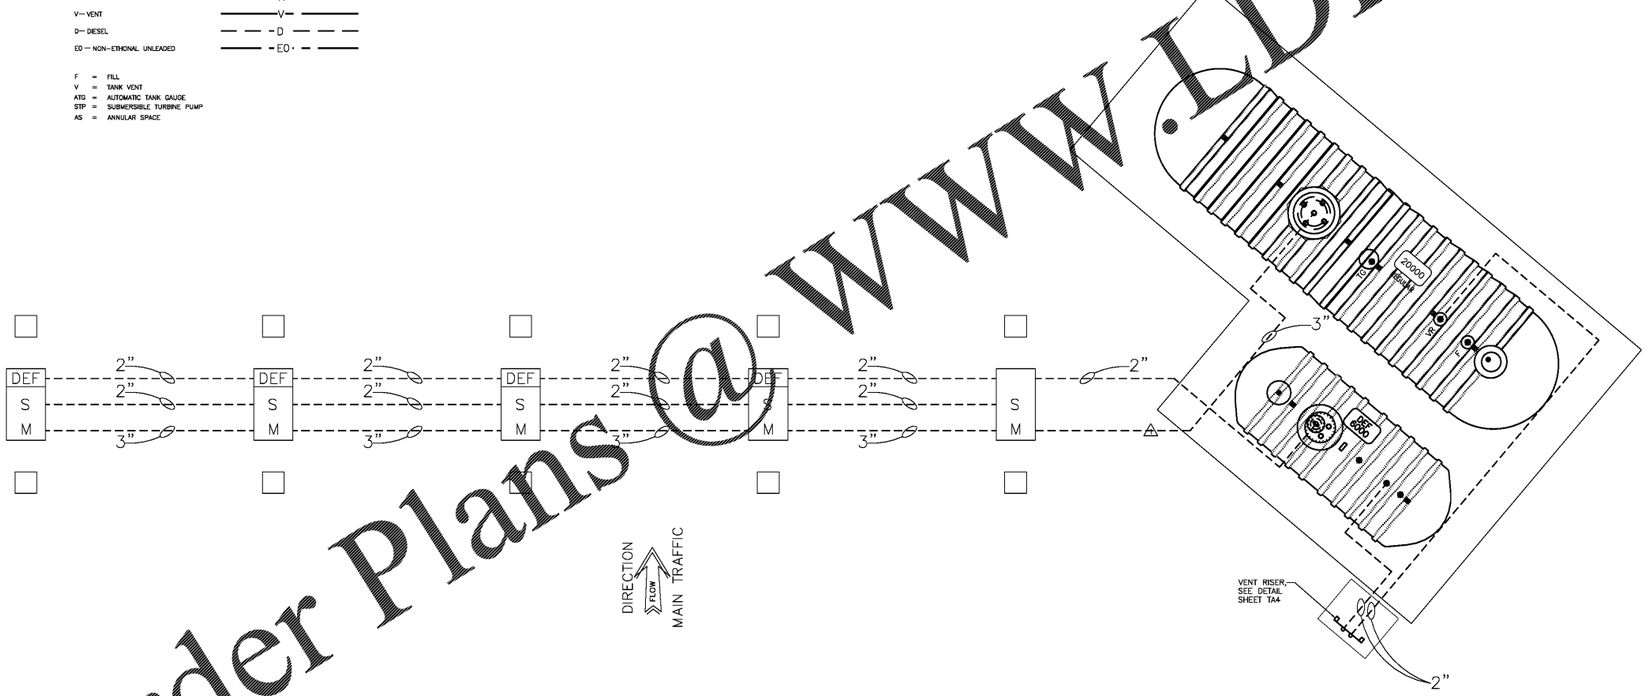

DIESEL CANOPY

1 / TA–3 SCHEMATIC–GENERAL TANK, PRODUCT PIPING LAYOUT (SEE SITE PIPING & ELECTRICAL PLANS FOR SITE SPECIFIC REQUIREMENTS)
N.T.S.

Order Plans @ www.LDILine.com

CLIENT:

CIRCLE K STORES, INC.

SOUTH ATLANTIC DIVISION
215 PENDLETON ST
WAYCROSS, GA 31501
PHONE: (912) 285–4011

DESIGN TEAM:

MDM SERVICES, INC.
engineering • environmental • construction
1055 KATHLEEN ROAD LAKELAND, FLORIDA 33805
(863) 646-9130
FB #004891

TANK & PIPING PLANS & SPECIFICATIONS

NO.	DATE	REVISION DESCRIPTION

BID SET

RICHARD R. MORRIS, P.E.
GA #[illegible]

SITE ADDRESS:

CIRCLE K

1717 E 16th AVE.
CORDELE, CRISP COUNTY
GEORGIA

SCALE:	MDM JOB # 20183
DATE: 9/01/2020	
DESIGNED BY:	
DRAWN BY: JR	FILE NAME:
CHECKED BY:	

DRAWING TITLE:
TANK & PIPING DETAILS

SHEET NO:
TA-3.1