


PARTITION TYPES

SHEET NOTES




- STUDS CONTINUE TO DECK U.N.O.
- USE 5/8" GYPSUM BOARD ON NON-RATED PARTITIONS U.N.O.
- USE 5/8" FIRE RATED GYPSUM BOARD ON FIRE RATED PARTITIONS.
- REF ROOM FINISH SCHEDULE FOR LOCATION OF FRP.
- EXTEND GYP. BD. A MINIMUM OF 6" ABOVE SUSPENDED CEILING SYSTEMS WHERE NOT INDICATED TO EXTEND TO DECK.
- REF PARTITION KEY SYMBOL FOR STUD THICKNESS.
- WHERE NO CEILING IS INDICATED CONTINUE GYP BD & FINISH TO DECK UNO.
- STUD PARTITIONS REQUIRING A FIRE RATING OF ONE HOUR SHALL COMPLY WITH UL#465, TWO HOUR WITH UL#411.
- STUD WALLS RECEIVING FIRE RETARDANT PLYWOOD SHALL BE 22 GAUGE OR HEAVIER.
- PROVIDE ALTERNATING DIAGONAL METAL STUD BRACING FROM ROOF DECK TO WALL STUDS ABOVE CEILING AT 48" O.C. FOR PARTITION STUDS OVER 6" WIDE.
- USE MOISTURE RESISTANT TILE BACKER BOARD BEHIND CERAMIC AND FRP BOARD. RESTROOMS REQUIRE MOISTURE RESISTANT GYP. BD. ABOVE TILE WAINSCOT. REF TOILET TILE ELEVATION SHEET A2.
- PROVIDE BATT INSULATION AT ALL PARTITION PARTITIONS AND CORNER LOCATIONS WHERE INDICATED ON PLANS.
- PROVIDE CONTROL JOINTS: REF DETAIL THIS SHEET. FULL HEIGHT OF MTL STUD PARTITIONS @ 4" O.C. MAX. PROVIDE JOINT AT LATCH SIDE OF JAMB AT SINGLE DOORS AND BOTH JAMBS ON DOUBLE DOORS AND WINDOWS. REF SPEC.
- BRACE ALL STUD PARTITIONS WHICH DO NOT EXTEND TO ROOF STRUCTURE TO DECK. REF DETAIL THIS SHEET.

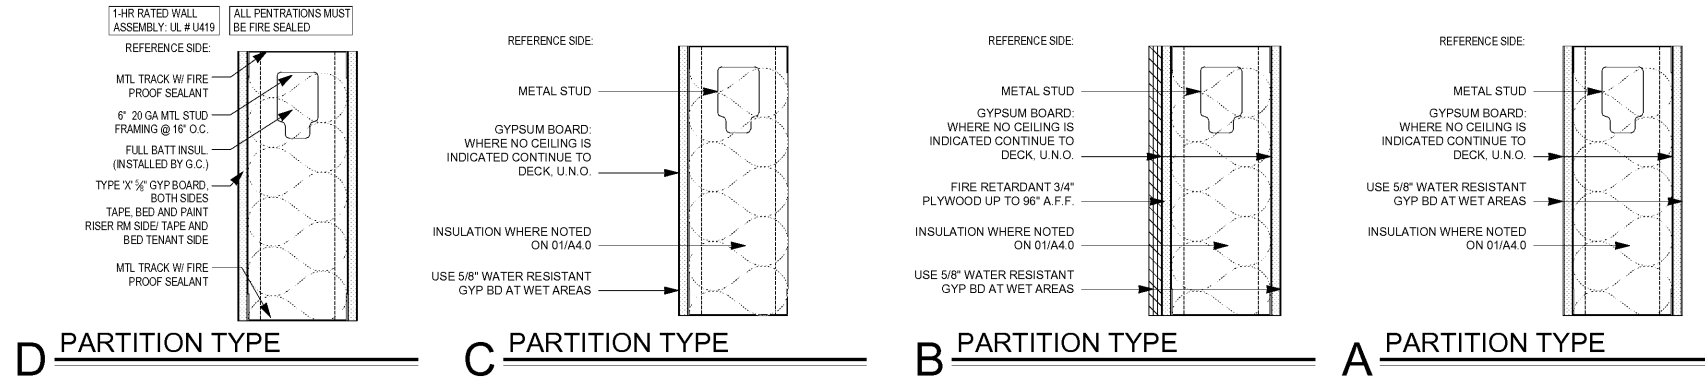

1925 Prospect Av.
 Orlando, FL 32814
 P (407) 661-9100
 F (407) 661-9101
 www.cp.com
 Florida Corporate Certificate #AA 000626




CLIENT NAME
Cross Development
 4536 MacArthur Blvd
 Carrollton, TX 75010

PROJECT NAME
Caliber Collision Five Forks (161)
 1215 East Butler Rd
 Greenville, SC 29607



PROJECT NO.	220087
DATE	07/08/2020
DRAWN	JJ
CHECKED	CD
RELEASE	PERMIT COMMENTS RESPONSE - 08/27/2020

A3.4

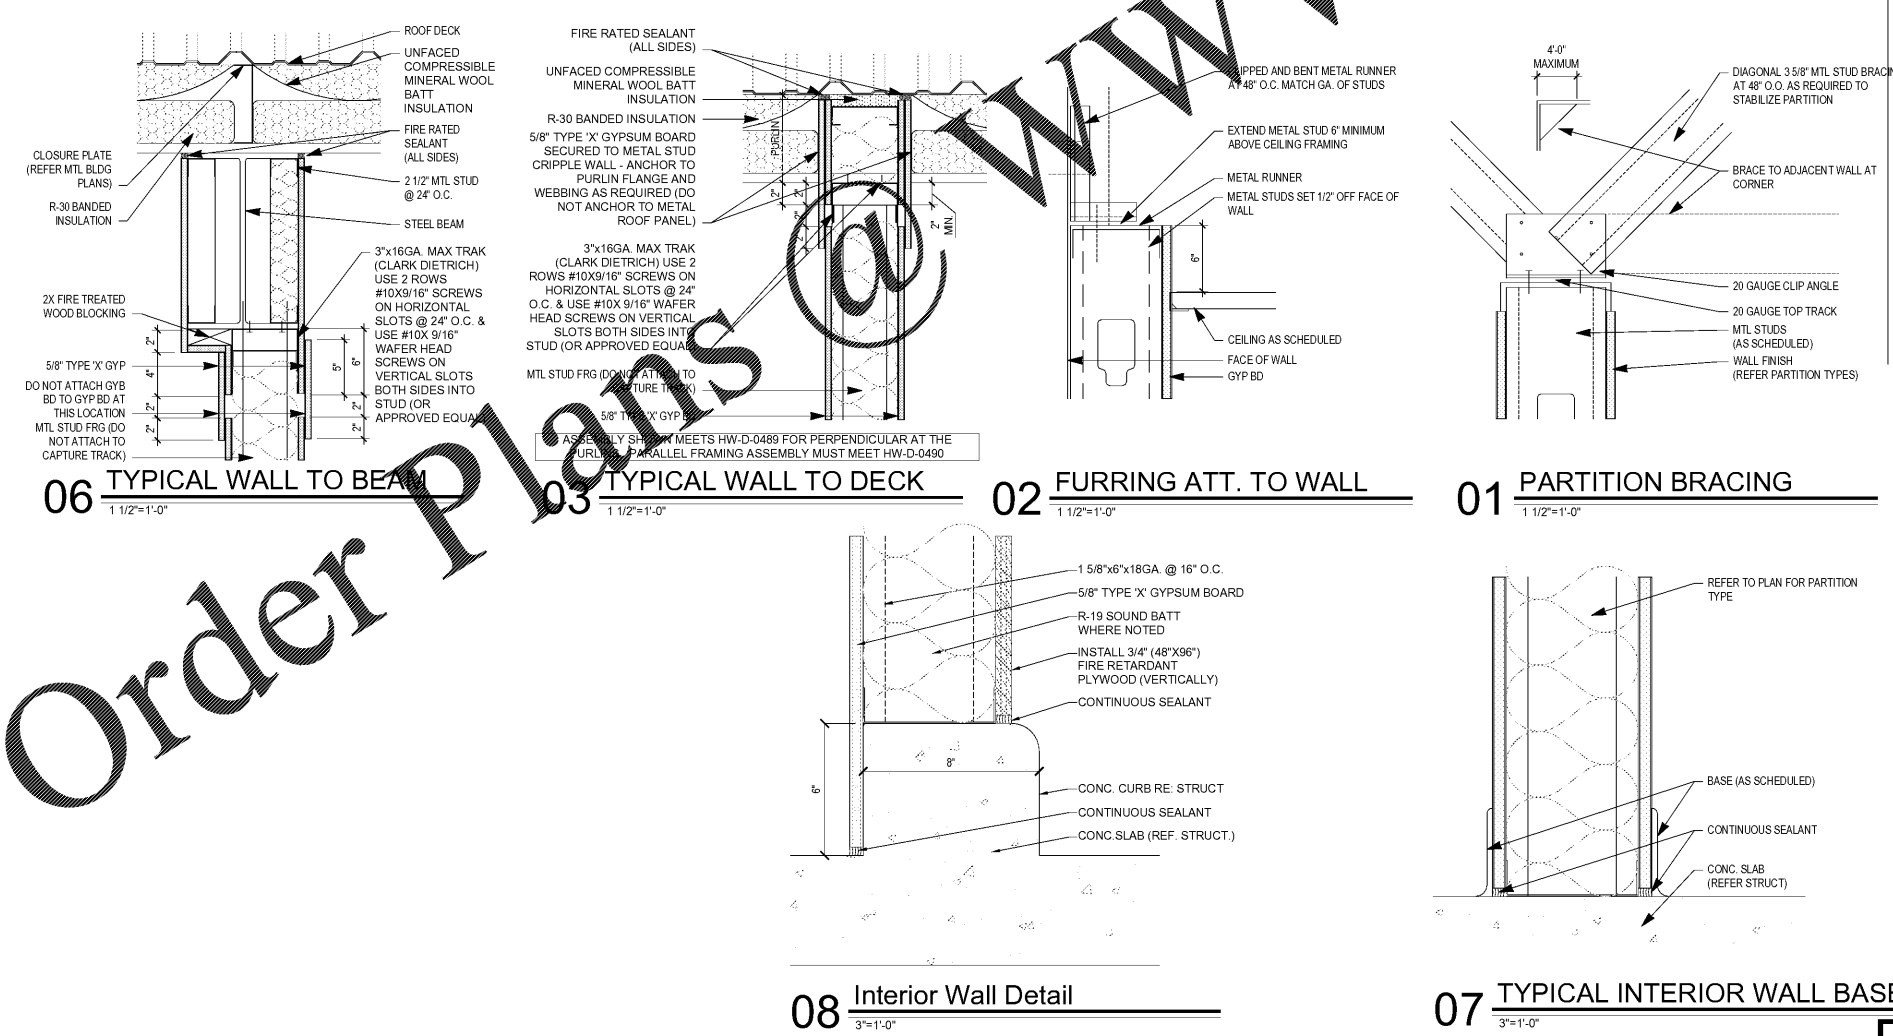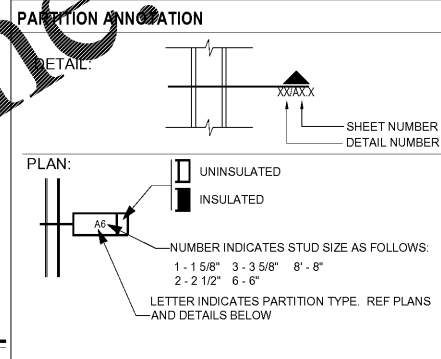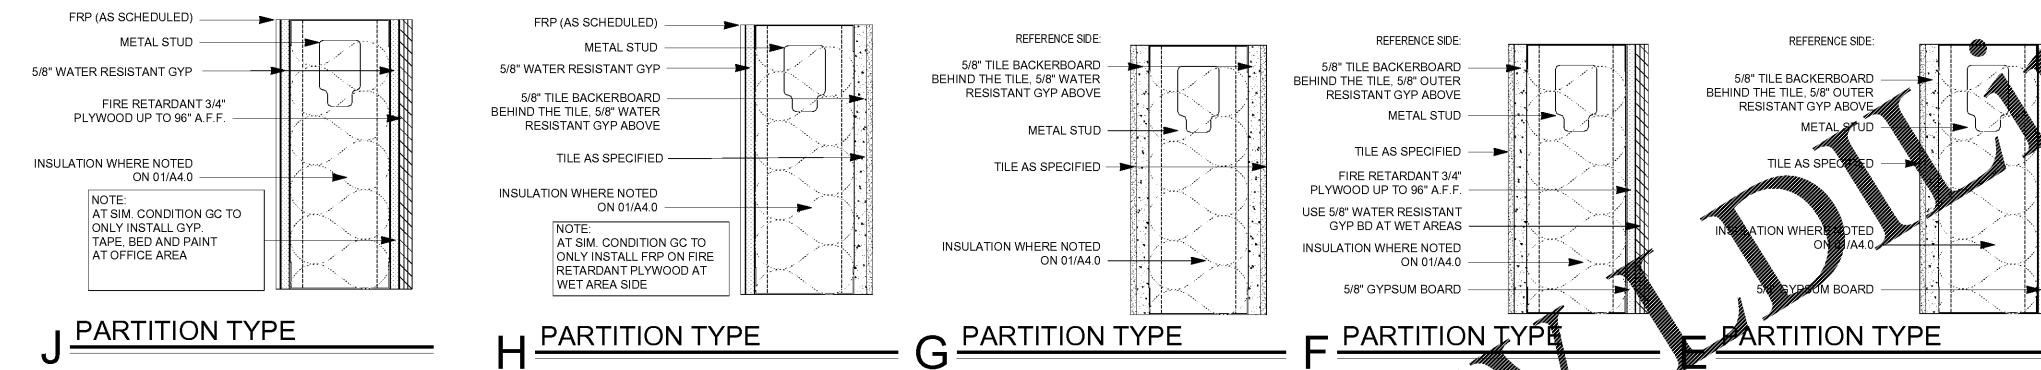

Order Plans @ WWW.DIline.com

BID SET 10/28/2020