SHEET NOTES

1. INSTALL MOLDED PIPE FLASHING AT ALL NEW PIPE OR CONDUIT PENETRATIONS THROUGH ROOF. REF. MECHANICAL FOR LOCATIONS. REF 5 - A4

ROOF LEGEND

- NEW RTU
- NEW CU
- NEW DOAS
- NEW RCU
- NEW EXHAUST FAN

brr

ARCHITECT OF RECORD:
JOHN F. FRANK
8131 METCALF AVE
OVERLAND PARK, KS 66204

www.brrarch.com

TEL: 913-262-9095
FAX: 913-262-9044

STIPULATION FOR REUSE

THESE DRAWINGS ARE PREPARED FOR USE ON THIS PROJECT ONLY AND ARE NOT TO BE USED IN WHOLE OR PART FOR ANY OTHER PROJECT. CONTRACTOR SHOULD NOTIFY THIS OFFICE IMMEDIATELY IF THESE PLANS ARE TO BE USED ON A SITE OTHER THAN THAT SHOWN HEREON. SUBMITTALS FOR A DIFFERENT SITE WILL BE REJECTED. THESE PLANS ARE FOR EXAMPLE ONLY AND MUST BE REVIEWED BY LICENSED ARCHITECTS AND ENGINEERS FOR COMPLIANCE WITH LOCAL CODES AND ORDINANCES. ALTERATIONS TO THESE PLANS MUST BE MADE BY OR UNDER THE DIRECTION OF THE ARCHITECT WHO SEALS AND SIGNS THE DRAWINGS. REUSE WITHOUT WRITTEN PERMISSION IS PROHIBITED BY LAW.

CONSULTANTS

Walmart

ATLANTA (GRESHAM), GA
2427 GRESHAM RD SE 30316
ST ORE NO. 03709-253

9664589 | PROTO

JOB NUMBER: 186

2021 SPRB-R

ISSUE BLOCK

CHECKED BY:	
DRAWN BY:	MED
PROTO CYCLE:	10/30/20
DOCUMENT DATE:	11/20/20

NOT FOR CONSTRUCTION

ROOF PLAN AND DETAILS

SHEET: A4

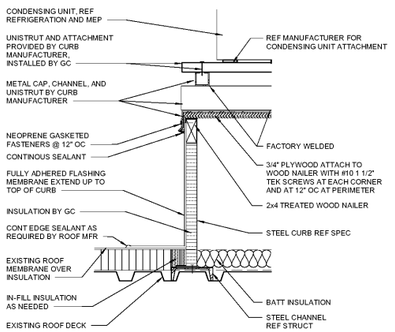

6 CONDENSER UNIT CURB
1 1/2" = 1'-0"

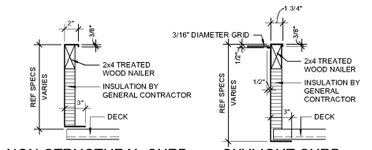

4 CURB
1 1/2" = 1'-0"

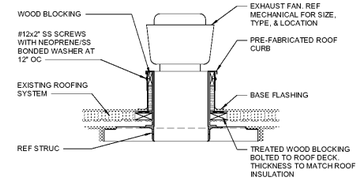

8 EXHAUST FAN DETAIL
1" = 1'-0"



7 ROOF TOP UNIT
1 1/2" = 1'-0"



5 ROOF PENETRATION
1" = 1'-0"

NOTE: FOR ROOF PENETRATIONS LOCATED WHERE WALKWAY PADS ARE INSTALLED, TRIM WALKWAY PADS 4" FROM EDGE OF ROOF PENETRATION FLASHING BEFORE PAD INSTALLATION.

NOTE: DO NOT INSTALL WALK WAY PADS UNTIL ROOF PENETRATION FLASHINGS ARE COMPLETE.



3 PAD LAYOUT (TYP ALL UNITS)
1/2" = 1'-0"

INSTALLATION NOTES:
1. THE ROOF PENETRATION CURB, HOOD AND CLOSURE PLATES ARE FURNISHED BY OWNER AND INSTALLED BY GENERAL CONTRACTOR
2. ALL HOOD PENETRATIONS SHALL BE THROUGH THE VERTICAL CLOSURE PLATES ONLY. PIPING AND CONDUIT SHALL BE INSTALLED BY THE TRADE CONTRACTORS WITH THE PIPE AND CONDUIT CENTERLINES 5" ABOVE THE TOP OF THE ROOF CURB WITH A MINIMUM OF 1" BETWEEN THE PIPE AND CONDUIT EXTERNAL SURFACE
3. THE GENERAL CONTRACTOR SHALL CUT AND INSTALL THE VERTICAL CLOSURE PLATES AFTER ALL PIPING AND CONDUITS ARE INSTALLED AND SEAL ALL PENETRATIONS AS NOTED IN THE DETAIL AND PROVIDE CONTINUOUS SEALANT AT THE PERIMETER JOINT BETWEEN THE CLOSURE PLATES AND HOOD AND CURB AND WHERE THE CLOSURE PLATES OVERLAP. REF SEALANT SPECIFICATION. EXPANDING FOAM SEALANT SHALL NOT BE USED WHERE SEALANT IS EXPOSED TO THE EXTERIOR.
4. EXTEND EXTERIOR REFRIGERANT AND WATER LINE EXTERNAL PVC INSULATION JACKET 1" INSIDE HOOD METAL CLOSURE PLATE.

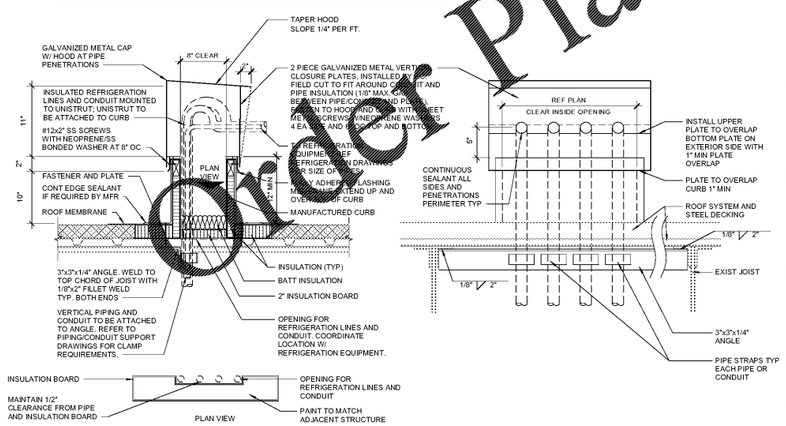

2 REFRIGERATION LINE ROOF PENETRATION
1" = 1'-0"

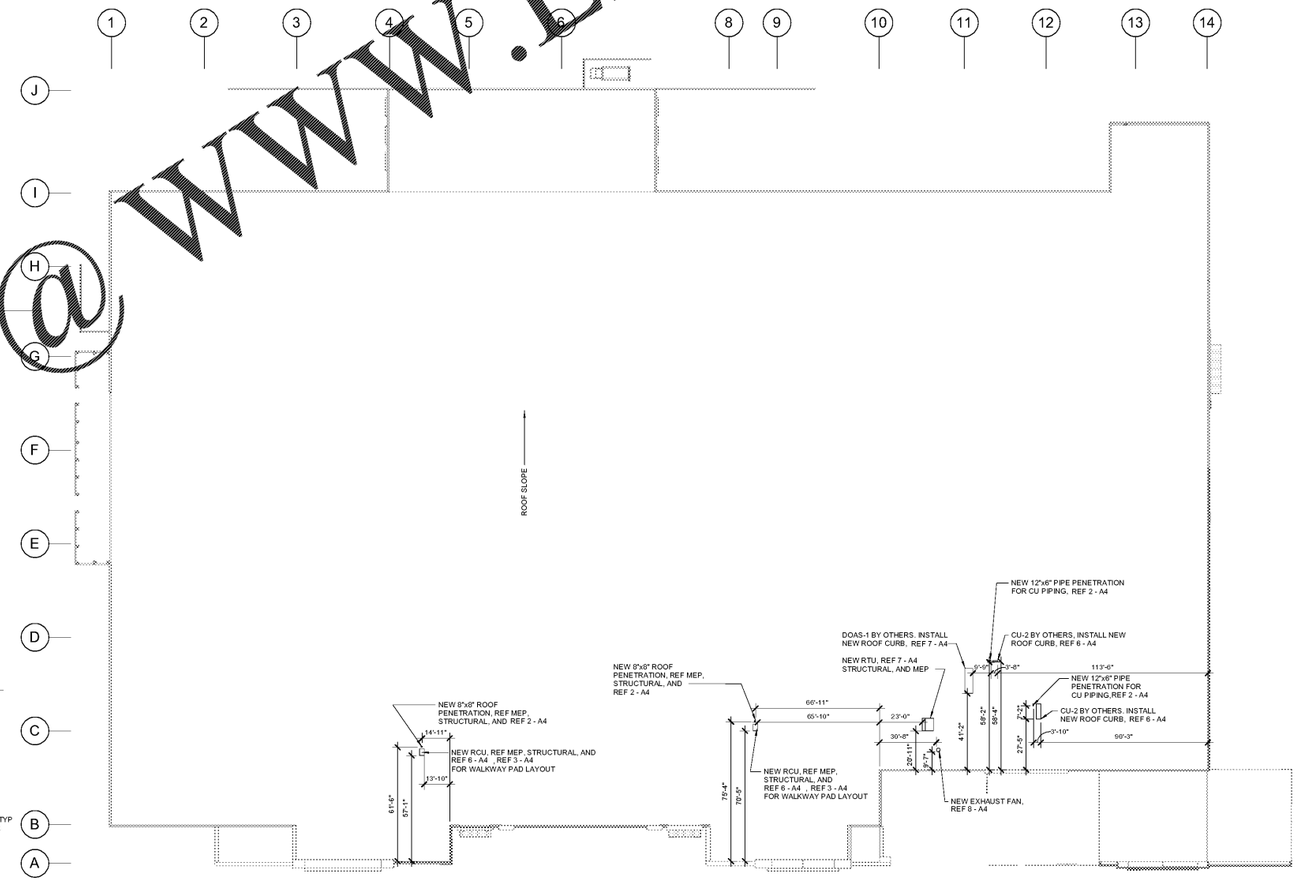

1 ROOF PLAN
1" = 30'-0"

Order Plans @ WWW.LDILine.com

12/01/2020 2:56:13 PM
C:\Users\mdavis\Documents\Walmart\Walmart_GA_186_R_ARCH_V36_mdavis.rvt