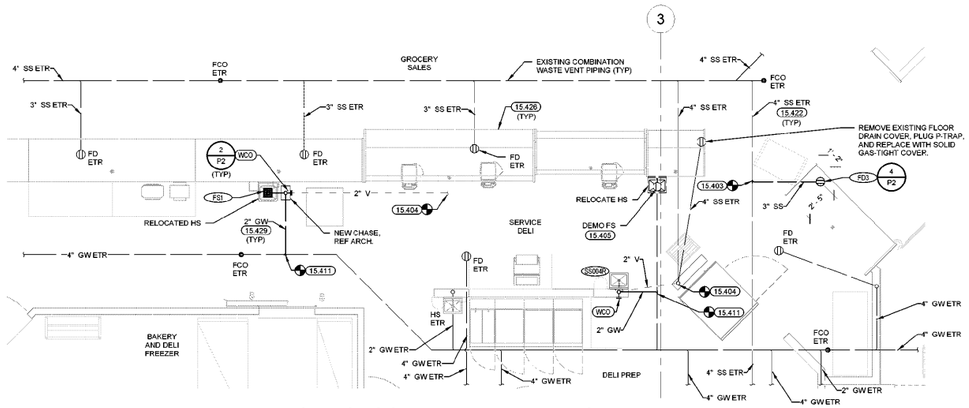

3 FRONT GROCERY DWV PLUMBING PLAN
1/4" = 1'-0"

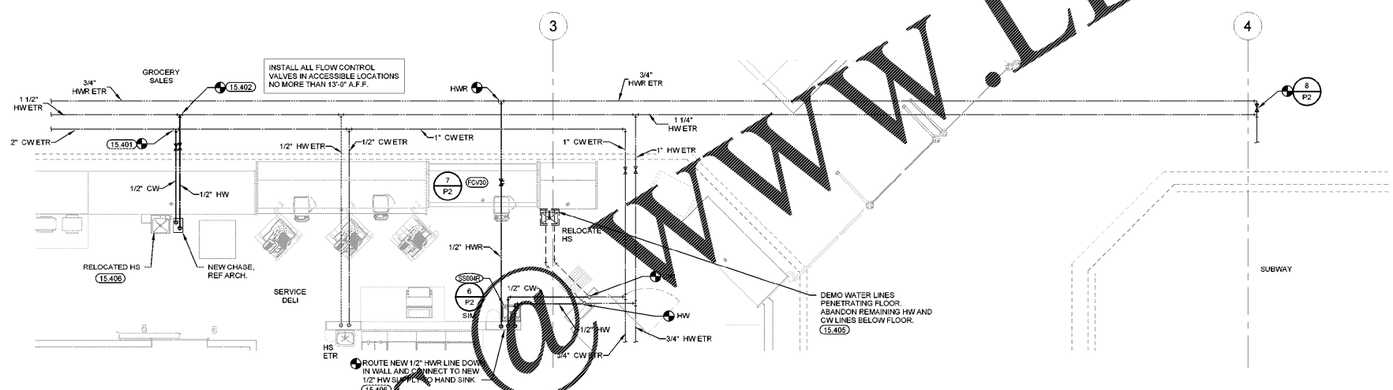

2 FRONT GROCERY WATER PLUMBING PLAN
1/4" = 1'-0"

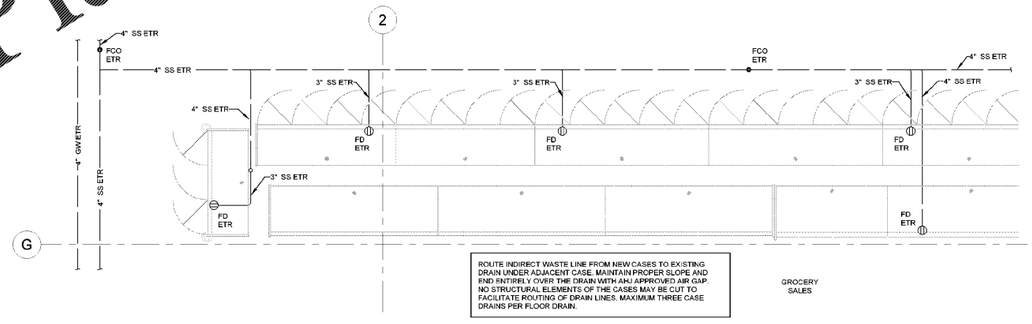

1 REAR GROCERY PLUMBING PLAN
1/4" = 1'-0"

FOOD PREP AREA NOTES

10.29.13

1. ROUTE ALL PIPING CONCEALED WITHIN STUD WALLS WHENEVER POSSIBLE.
2. ALL EXPOSED PIPE INSULATION SHALL BE CLAD PER SPECIFICATIONS. EXPOSED PIPING SHALL COMPLY WITH ONE OF THE FOLLOWING INSTALLATION OPTIONS:
   A. SURFACE MOUNTING PIPING WITH NON-CORROSIVE ANCHORS; SEAL BOTH SIDES OF PIPE TO SURFACE CONTINUOUSLY WITH SEALANT.
   B. INSTALL PIPING 1/2" OFF FACE OF SURFACE TO ALLOW FOR CLEANING. USE ONLY NON-CORROSIVE MATERIALS FOR ANCHORS AND SPACERS.
   C. COVER PIPING WITH 20 GAUGE STAINLESS STEEL BENT PLATES MOUNTED TO SURFACE WITH NON-CORROSIVE ANCHORS; APPLY CONTINUOUS SEALANT ALONG EDGES AND JOINTS.
3. PROPER INSTALLATION OF SEALANTS IS CRITICAL TO MEETING WALMART QUALITY STANDARDS. PROVIDE SEALANTS IN ACCORDANCE WITH DRAWINGS AND SPECIFICATIONS. REFERENCE SECTION 07900 FOR SEALANT SCHEDULE.
4. INTERIOR SEALANTS USED IN FOOD PREP AREAS SHALL MEET THE REQUIREMENTS FOR USE IN USDA REGULATED FACILITIES.
5. PROVIDE CONTINUOUS USDA APPROVED SEALANT AT ALL JOINTS BETWEEN MATERIALS ON WALLS IN FOOD PREPARATION COOLER AND FREEZER AREAS.
6. ALL JOINTS BETWEEN DISSIMILAR MATERIALS SHALL BE SEALED AS REQUIRED FOR A COMPLETE AND PROPER INSTALLATION, REGARDLESS OF WHETHER SHOWN ON THE DRAWINGS FOR NOT.

KEYNOTES

15.401	CONNECT TO NEAREST DOMESTIC COLD WATER PIPE OF EQUAL OR LARGER SIZE. VERIFY SIZE AND LOCATION AT SITE. PROVIDE SHUT-OFF VALVE IN NEW PIPE AT POINT OF CONNECTION
15.402	CONNECT TO EXISTING HOT WATER PIPE OF EQUAL OR LARGER SIZE. VERIFY SIZE AND LOCATION AT SITE. PROVIDE SHUT-OFF VALVE IN NEW PIPE AT POINT OF CONNECTION.
15.403	CONNECT TO EXISTING SANITARY PIPE OF EQUAL OR LARGER SIZE. VERIFY SIZE, LOCATION, ELEVATION, AND FLOW DIRECTION AT SITE.
15.404	CONNECT TO EXISTING VENT PIPE OF EQUAL OR LARGER SIZE. VERIFY SIZE AND LOCATION AT SITE.
15.405	PROPERLY CAP, PLUG AND CONCEAL ANY PIPING LEFT IN PLACE. CAP ABANDONED SEWER PIPING A MINIMUM OF 8" BELOW FINISHED FLOOR. MATCH EXISTING FLOOR CONSTRUCTION AND FINISHES. RE: ARCHITECTURAL PLANS. REMOVE UNUSED WATER AND VENT PIPING ABOVE CEILING AND CAP REMAINING PIPE.
15.406	PLUMBING CONTRACTOR TO MAKE ALL NECESSARY DISCONNECTS AND RECONNECTS OF PLUMBING FIXTURES BEING RELOCATED OR REUSED.
15.411	CONNECT TO EXISTING GREASE WASTE OF EQUAL OR LARGER SIZE. VERIFY SIZE, LOCATION, ELEVATION, AND FLOW DIRECTION AT SITE.
15.422	EXISTING PIPING TO REMAIN (VERIFY LOCATION IN FIELD)
15.426	WHERE NEW REFRIGERATED CASES ARE REPLACING EXISTING CASES AT SAME LOCATION, EXISTING FLOOR DRAINS MAY BE REUSED IF EXISTING DRAIN IS IN A REUSABLE LOCATION (VERIFY IN FIELD)
15.429	CUT AND PATCH EXISTING CONCRETE FLOOR SLAB FOR INSTALLATION OF NEW UNDERGROUND PLUMBING PIPE. MATCH EXISTING CONSTRUCTION AND FINISHES.

ALL REFRIGERATED CASE DRAIN OUTLETS SHALL BE 2" IN SIZE.

ALL REFRIGERATED CASE DIMENSIONS ARE FROM EDGE OF CASE TO CENTER OF DRAIN.

PRIOR TO SETTING NEW REFRIGERATED CASES, THOROUGHLY CLEAN ALL DEBRIS FROM FLOOR DRAIN AND/OR FLOOR SINK GRATES AND BODIES. HYDRO-JET EACH FLOOR DRAIN AND/OR FLOOR SINK TO THE MAIN.

REUSE EXISTING CASE DRAIN IF NOT MORE THAN 1/2 OF DRAIN IS EXPOSED AND THE LOCATION COMPLIES WITH AHJ REQUIREMENTS. CONTRACTOR SHALL FIELD VERIFY EXACT LOCATION OF DRAINS ON WEEK 1 AND NOTIFY AOR/EOR IF DRAINS REQUIRE RELOCATION. SUBMIT CHANGE ORDER FOR ADDITIONAL SCOPE. (TYP)

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

brr
ARCHITECT OF RECORD:
DOHN P. FRANK
8131 METCALF AVENUE
SUITE 300
OVERLAND PARK, KS 66204
www.brrarch.com
TEL: 913-262-9095
FAX: 913-262-9044

STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND IS NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT. ANY REUSE OF THIS DRAWING WITHOUT THE WRITTEN CONSENT OF HENDERSON ENGINEERS IS PROHIBITED. ALL COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING COPYRIGHT, ARE RESERVED BY HENDERSON ENGINEERS. ALL DRAWINGS, PLANS, SPECIFICATIONS AND COPIES THEREOF FURNISHED BY HENDERSON ENGINEERS ARE AND SHALL REMAIN THE PROPERTY OF HENDERSON ENGINEERS. THEY ARE NOT TO BE USED IN ANY WAY WITHOUT THE PRIOR WRITTEN PERMISSION OF HENDERSON ENGINEERS.

CONSULTANTS
HENDERSON ENGINEERS
8345 CLEVELAND AVE. SUITE 300
LENEXA, KS 66215
TEL 913.492.0300 FAX 913.492.0001
WWW.HENDERSONENGINEERS.COM
24HRSERVICE
GA CORPORATE NO. PEF000734
EXPIRES 6/30/2021

Walmart
ATLANTA (GRESHAM)
2427 GRESHAM PARKWAY
STORE NO. 03709-2316
GENERAL REMODEL
JOB NUMBER: 2180607/09 | PROTO: SPHB

ISSUE BLOCK

CHECKED BY:	JME
DRAWN BY:	HKM
PROTO CYCLE:	09/25/20
DOCUMENT DATE:	11/20/20

NOT FOR CONSTRUCTION

GROCERY PLUMBING PLANS

SHEET: GP1

JARROD M. EASTERWOOD

Order Plans @ WWW.LDILine.com