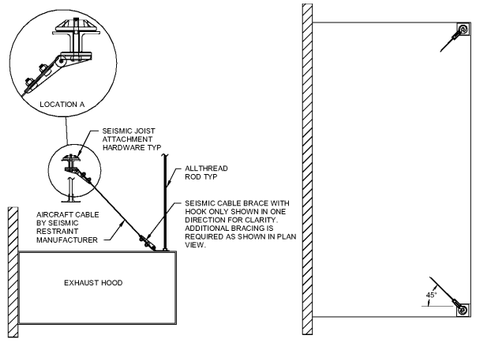

11 SEISMIC CABLE BRACE FOR EXHAUST HOODS ATTACHED TO WALL
NTS

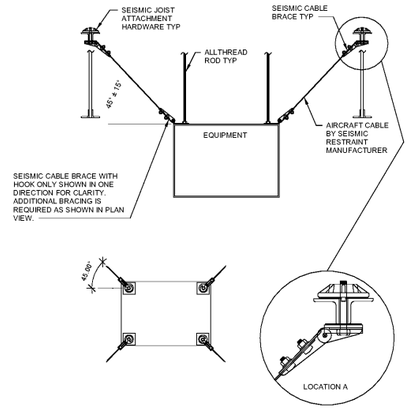

10 ALL-DIRECTIONAL SEISMIC CABLE BRACE FOR SUSPENDED EQUIPMENT
NTS



9 SEISMIC RESTRANT OF WATER HEATER
NTS

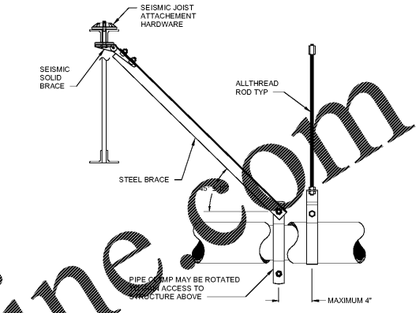

8 LONGITUDINAL SEISMIC SOLID BRACE FOR CLEVIS SUPPORTED PIPE/CONDUIT
NTS

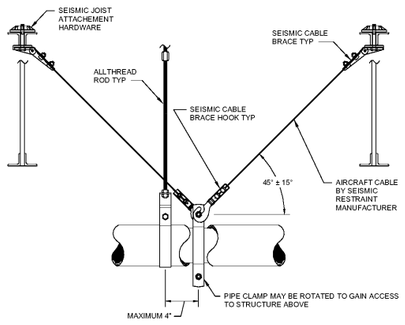

7 LONGITUDINAL SEISMIC CABLE BRACE FOR CLEVIS SUPPORTED PIPE/CONDUIT
NTS

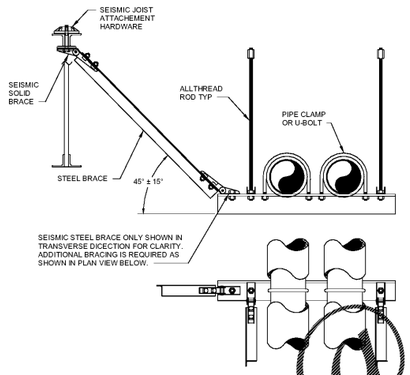

6 ALL-DIRECTIONAL SEISMIC SOLID BRACE FOR TRAPEZE SUPPORTED PIPE/CONDUIT
NTS

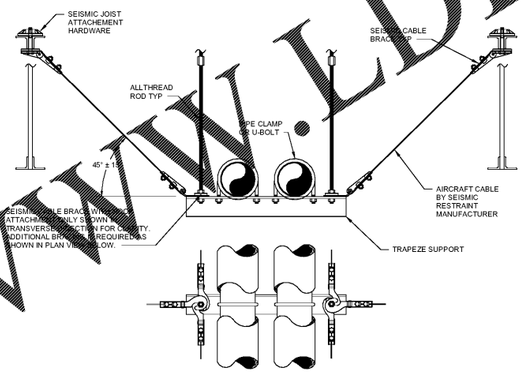

5 ALL-DIRECTIONAL SEISMIC CABLE BRACE FOR TRAPEZE SUPPORTED PIPE/CONDUIT
NTS

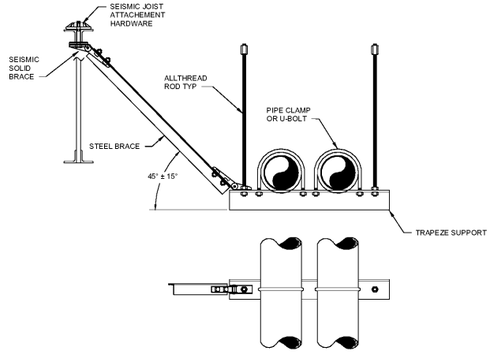

4 TRANSVERSE SEISMIC SOLID BRACE FOR TRAPEZE SUPPORTED PIPE/CONDUIT
NTS

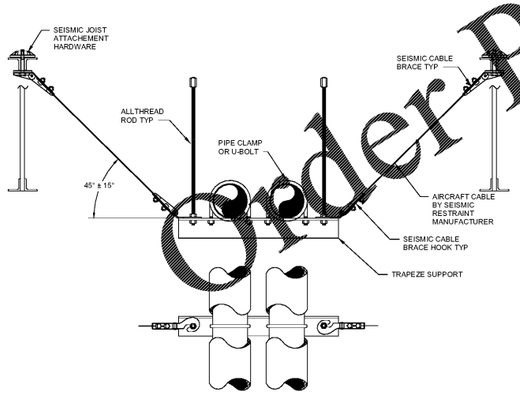

3 TRANSVERSE SEISMIC CABLE BRACE FOR TRAPEZE SUPPORTED PIPE/CONDUIT
NTS

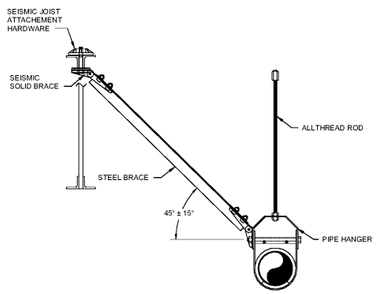

2 TRANSVERSE SEISMIC SOLID BRACE FOR CLEVIS SUPPORTED PIPE/CONDUIT
NTS

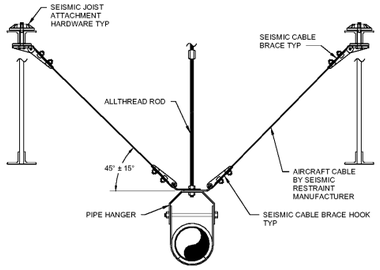

1 TRANSVERSE SEISMIC CABLE BRACE FOR CLEVIS SUPPORTED PIPE/CONDUIT
NTS

THE MECHANICAL, ELECTRICAL, AND REFRIGERATION SYSTEMS FOR THIS PROJECT SHALL BE SEISMICALLY RESTRAINED. THIS SHEET DEPICTS SCHEMATIC INSTALLATION DETAILS AND IS FOR INFORMATIONAL PURPOSES ONLY. SPECIFIC INSTALLATION INFORMATION REGARDING SEISMIC RESTRAINT SHALL BE OBTAINED FROM THE SEISMIC RESTRAINT MANUFACTURER. REFER TO THE SPECIFICATIONS FOR FURTHER INFORMATION.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

Order Plans @ WWW.LDILine.com

brr
ARCHITECT OF RECORD:
JOHN F. FRANK
8131 METCALF AVENUE
SUITE 300
OVERLAND PARK, KS 66204
www.brrarch.com
TEL: 913-262-9095
FAX: 913-262-9044

STIPULATION FOR REUSE
THESE DRAWINGS ARE PREPARED FOR USE ON THIS PROJECT ONLY AND ARE NOT TO BE USED IN WHOLE OR IN PART FOR CONSTRUCTION PURPOSES ON ANY OTHER PROJECT WITHOUT THE EXPRESS WRITTEN PERMISSION OF BRR ARCHITECTURE, INC. ANY UNAUTHORIZED USE OF THESE DRAWINGS WILL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO BRR ARCHITECTURE, INC. AND THE ARCHITECT'S CONSULTANTS. THE VISUAL CONTENT OF THESE DRAWINGS IS NOT TO BE USED FOR BIDDING PURPOSES.

CONSULTANTS

Walmart
ATLANTA (GRESHAM)
2407 N.E. BURNSIDE RD.
GRESHAM, OR 97030
STORE NO. 03709-2S3
GENERAL REMODEL
JOB NUMBER: 2109003709 | PROTO: SPRB

ISSUE BLOCK

CHECKED BY:	--
DRAWN BY:	--
PROTO CYCLE:	09/25/20
DOCUMENT DATE:	11/20/20

NOT FOR CONSTRUCTION

NOTE SHEET IS FOR INFORMATION ONLY

SEISMIC RESTRAINT

SHEET: SR1