LIGHT FIXTURE SCHEDULE

*OW' FIXTURES AND LAMPS ARE FURNISHED BY THE OWNER FOR INSTALLATION BY THE CONTRACTOR. "GC' FIXTURES AND LAMPS ARE FURNISHED AND INSTALLED BY THE CONTRACTOR.

TYPE	SUPPLIED BY	DESCRIPTION	VENDOR/MFR	MODEL	VOLTAGE	INPUT VA	COLOR TEMP	LIGHT SOURCE	LAMP QTY	MOUNTING	COUNT
7	OW	1' x 4' VOLUMETRIC TROFFER	CREE INC	ZR14M-4OL-40K-10V-FD	120/277	30 VA	4000K	INTEGRAL LED	-	RECESSED	7
8	OW	1' x 4' FLAT PANEL	REXEL INC	PT14030W	120/277	30 VA	4000K	INTEGRAL LED	-	RECESSED	12
9	OW	2' x 2' VOLUMETRIC TROFFER	CREE INC	ZR22C-40L-40K-10V-FD	120/277	32 VA	4000K	INTEGRAL LED	-	RECESSED	2
10	OW	2' x 4' VOLUMETRIC TROFFER	CREE INC	ZR24M-4OL-40K-10V-FD	120/277	30 VA	4000K	INTEGRAL LED	-	RECESSED	25
13	OW	EXIT SIGN (DOUBLE FACE)	ACUITY BRANDS LIGHTING INC	RED: LQM S W 2 R 120/277 EL N SD90 M6 GREEN: LQM S W 2 G 120/277 EL N SD90 M6	120/277	4 VA	4000K	INTEGRAL LED	-	STEM / CEILING	8
15	OW	EXIT SIGN (SINGLE FACE)	ACUITY BRANDS LIGHTING INC	RED: LQM S W 1 R 120/277 EL N SD90 M6 GREEN: LQM S W 1 G 120/277 EL N SD90 M6	120/277	4 VA	-	INTEGRAL LED	-	STEM / CEILING	8
16	OW	EMERGENCY LIGHT	REXEL INC	EVHC6IDP-WM	120/277	3 VA	-	INTEGRAL LED	-	WALL / CEILING	6
27A	OW	EMERGENCY LIGHT - TWO PAIRS OF REMOTE HEADS	REXEL INC	EVHC6IDP-0-WM W 2 SETS OF EVDOW	120/277	3 VA	-	INTEGRAL LED	-	WALL	4
28	OW	WEATHER-PROOF EXIT SIGN	ACUITY BRANDS LIGHTING INC	LV S W 1 R 120/277 EL N 4X SD	120/277	6 VA	-	INTEGRAL LED	-	WALL	2
68R	OW	CIRCULAR RECESSED DOWNLIGHT	CREE INC	LR6-10L-35K-277V w/ RR5-277V	277	12 VA	3500K	INTEGRAL LED	-	RECESSED	52
83	OW	2X2 RECESSED LED GRID LIGHT FOR T-BAR GRID CEILING	REGENCY	FP22-FS-WH	120/277	30 VA	3500K	INTEGRAL LED	-	RECESSED	2
85	OW	13" GLOBE PENDANT LIGHT WITH MEDIUM BASE LAMP SOCKET, CORD MOUNT, WHITE FINISH	REGENCY	P4406-29	120	14 VA	3000k	14A21 DIM/836 (GRC) (LED A19 LAMP, 1600L)	-	SUSPENDED	4
87	OW	3 LIGHT RECESSED MUTIPLE, WHITE FINISH	REGENCY	XAR13/XM20/25C/39K/1500/WH/WH	120	51 VA	3000K	MODULAR LED	-	RECESSED	30
91	OW	4FT SUSPENDED LED LINEAR SLOT LIGHT	REGENCY	OLS-D-LED-2-S-4'0"-750L-DIM10-MVOLT-30K-85-WH	120/277	27 VA	3000K	INTEGRAL LED	-	SUSPENDED	4
92	OW	8FT SUSPENDED LED LINEAR SLOT LIGHT	REGENCY	OLS-D-LED-2-S-8'0"-750L-DIM10-MVOLT-30K-85-WH	120/277	54 VA	3000K	INTEGRAL LED	-	SUSPENDED	4
93	OW	UNDER CABINET LIGHTING - 48"	QUALSERV SOLUTIONS LLC	RTSHO-LED46-30FR-2-000	120	18 VA	3000K	INTEGRAL LED	-	SURFACE	2

WWW.LDILine.com Order Plans@

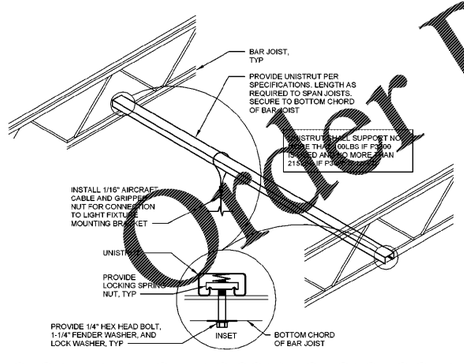

3 SUSPENDED LIGHTING CONNECTIONS TO STRUCTURE
NTS

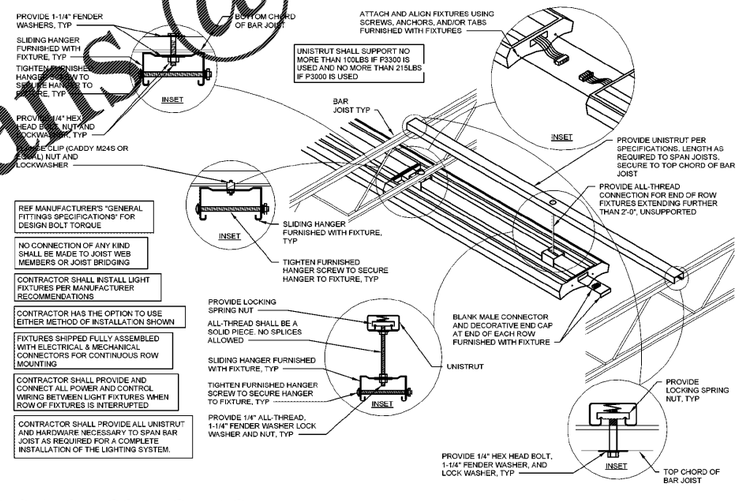

2 SALES FLOOR LIGHTING
NTS

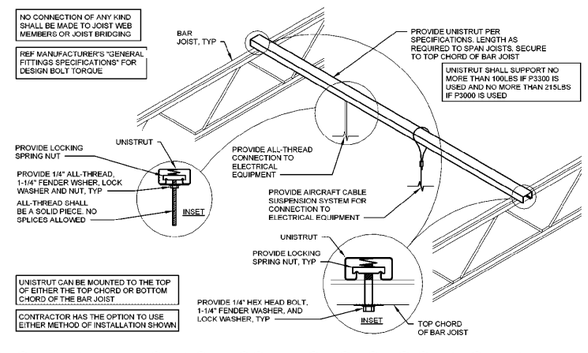

1 GENERAL ELECTRICAL CONNECTIONS TO STRUCTURE
NTS

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

WILLIAM R. WINSTON

brr
ARCHITECT OF RECORD:
DOHN P. FRANC
8121 METCALF AVENUE
SUITE 100
OVERLAND PARK, KS 66204
www.brrarch.com
TEL: 913-262-9095
FAX: 913-262-9044

STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND IS NOT TO BE USED FOR ANY OTHER PROJECT. ALL COPYRIGHTS AND OTHER PROPERTY RIGHTS IN THIS DRAWING ARE RESERVED BY THE ARCHITECT AND ARE NOT TO BE USED IN ANY FORM ON ANY OTHER PROJECT, EXCEPT BY AGREEMENT IN WRITING BY THE ARCHITECT. ANY UNAUTHORIZED USE OF THIS DRAWING WITHOUT THE ARCHITECT'S WRITTEN PERMISSION IS PROHIBITED AND ANY AUTHORIZED REUSERS WILL HOLD HARMLESS THE ARCHITECT FOR ALL DAMAGES RESULTING THEREFROM. REUSE OR UNAUTHORIZED REUSE OF THESE PLANS AND SPECIFICATIONS SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO THE ARCHITECT.

CONSULTANTS

HENDERSON ENGINEERS
8345 LENEXA DRIVE, SUITE 300
LENEXA, KANSAS 66214
TEL 913.422.0300 FAX 913.422.0021
WWW.HENDERSONENGINEERS.COM
JAMES SMITH
GA CORPORATE NO. PEC002734
EXPIRES 6/30/2021

Walmart
ATLANTA (GRESHAM)
2421 GRESHAM PARKWAY
STORE NO. 03709-2316
GENERAL REMODEL
JOB NUMBER: 2180603709 | PROTO: SPHB

ISSUE BLOCK

CHECKED BY:	BC/BW
DRAWN BY:	JRF
PROTO CYCLE:	09/25/20
DOCUMENT DATE:	11/20/20

NOT FOR CONSTRUCTION

LIGHTING DETAILS AND SCHEDULES

SHEET:
E1.4