POWER DROP SCHEDULE

07.20.17

NO.	DESCRIPTION
PD1	MOUNT RECEPTACLE(S) ON TOP OF DISPLAY UNIT(S)
PD2	MOUNT RECEPTACLE(S) 6" ABOVE BASE OF DISPLAY ON UNIT(S) SO THAT RECEPTACLE(S) AND CONDUIT DO NOT INTERFERE WITH SHELF HEIGHT ADJUSTMENTS
PD3	PROVIDE DIRECT CONNECTION TO EQUIPMENT
PD4	OPEN STRUCTURE: MOUNT RECEPTACLE AT BAR JOIST AND INSTALL FURNISHED CORD REEL OR LAY-IN CEILING: PROVIDE RECESSED CEILING RECEPTACLE AND INSTALL FURNISHED CORD REEL BELOW CEILING. CORD REEL SHALL BE MOUNTED TO CEILING FAN RATED JUNCTION BOX SECURED TO LAY-IN CEILING WITH T-BAR BOX HANGER. PROVIDE 1/2" THREADED STEEL ROD FROM JUNCTION BOX TO BOTTOM OF STRUCTURAL JOIST OR CHANNEL STRUT BRIDGING ABOVE FOR SUPPORT.

POWER DROP NOTES

09.29.20

1. POWER DROPS WILL BE IDENTIFIED BY AN IPTV TAG OR POWER TAG, I.E. 44A, 46E, ETC. ALL CHECKOUT POWER SHALL BE CONSIDERED POWER DROPS.
2. A REVISION OF THIS PLAN BASED ON THE FINAL MERCHANDISE LAYOUT MAY BE ISSUED TO SHOW FINAL LOCATIONS FOR THE POWER DROPS. IF THE MERCHANDISE PLAN DOES NOT CHANGE, THIS PLAN WILL NOT BE REISSUED. PROVIDE CIRCUITRY TO DISPLAY RACKS AS THE RACKS ARE SET. IN ADDITION, THE FOLLOWING POWER DROP NOTES APPLY:
   - A. THERE WILL BE NO ADDITIONAL CHARGE FOR DROP RELOCATION WITHIN POWER DROP ZONES DEFINED ON DRAWING.
   - B. AT CLOSE OF PROJECT THE GENERAL CONTRACTOR AND CONSTRUCTION MANAGER SHALL REVIEW ADDITIONAL OR DELETED POWER DROPS WITHIN EACH ZONE TO VERIFY ANY ADDITIONAL CHARGES OR CREDITS THAT APPLY DUE TO CHANGES.
   - C. ADDING OR SUBTRACTING A POWER DROP TO ANY ZONE WILL RESULT IN A CHARGE OR CREDIT ACCORDING TO SPECIAL CONDITIONS.
3. PROVIDE JUNCTION BOX AND CIRCUITRY TO NEAREST JOIST ABOVE LOCATION SHOWN ON DRAWING. RUN FLEX CONDUIT FOR CIRCUITRY FROM JUNCTION BOX TO TOP CAP OF DISPLAY RACK.
4. WHEN EXPOSED VERTICAL CONDUIT FROM STRUCTURE TO CONNECTION TO GONDOLA/EQUIPMENT EXCEEDS 10 FEET, INTERMEDIATE METALLIC CONDUIT (IMC) SHALL BE USED IN LIEU OF ELECTRICAL METALLIC CONDUIT (EMT). THE IMC CONDUIT AND COUPLINGS SHALL BE THREADED AND BE SECURELY FASTENED AT THE GONDOLA/EQUIPMENT AND AT STRUCTURE.
5. PROVIDE CONDUIT, RECEPTACLE(S) AND FINAL CONNECTIONS AT DISPLAY RACK SHELVING PER POWER DROP SCHEDULE UNLESS NOTED OTHERWISE ON DRAWING. VERIFY EXACT HEIGHT AND LOCATION OF RECEPTACLE(S) WITH STORE PLANNING SET-UP SUPERVISOR PRIOR TO INSTALLATION.
6. POWER DROPS FED FROM TRACK BUSWAY: INSTALL PLUG-IN UNIT AT A POINT ON TRACK BUSWAY NEAREST POWER DROP(S).

KEYNOTES

16.131	CONNECT TO EXISTING CIRCUIT.
16.145	CONNECT CIRCUIT(S) TO EXISTING BRANCH CIRCUITRY. MINIMUM WIRE SIZE AND PANELBOARD CIRCUIT ARE NOTED. VERIFY SIZE, RATING AND CONDITION OF EXISTING BRANCH CIRCUIT CONDUIT AND WIRE PRIOR TO USE TO ENSURE THAT THEY MEET REQUIRED SIZE, AND ALL J.I.L. RATINGS AND REPLACE AS REQUIRED.
16.416	FITTING ROOM POWER AND 3/4"DATA CONDUIT SHALL DROP AT THIS LOCATION. EXTEND DESK POWER AND DATA CONDUIT DOWN WALL, THEN +8" TO DESK. FITTING ROOM CONDUIT AND RECEPTACLES SHALL BE 6" ABOVE OPEN GRID. HARDWIRE (1) LIGHT PER ROOM DIRECTLY TO RECEPTACLE JUNCTION BOX.

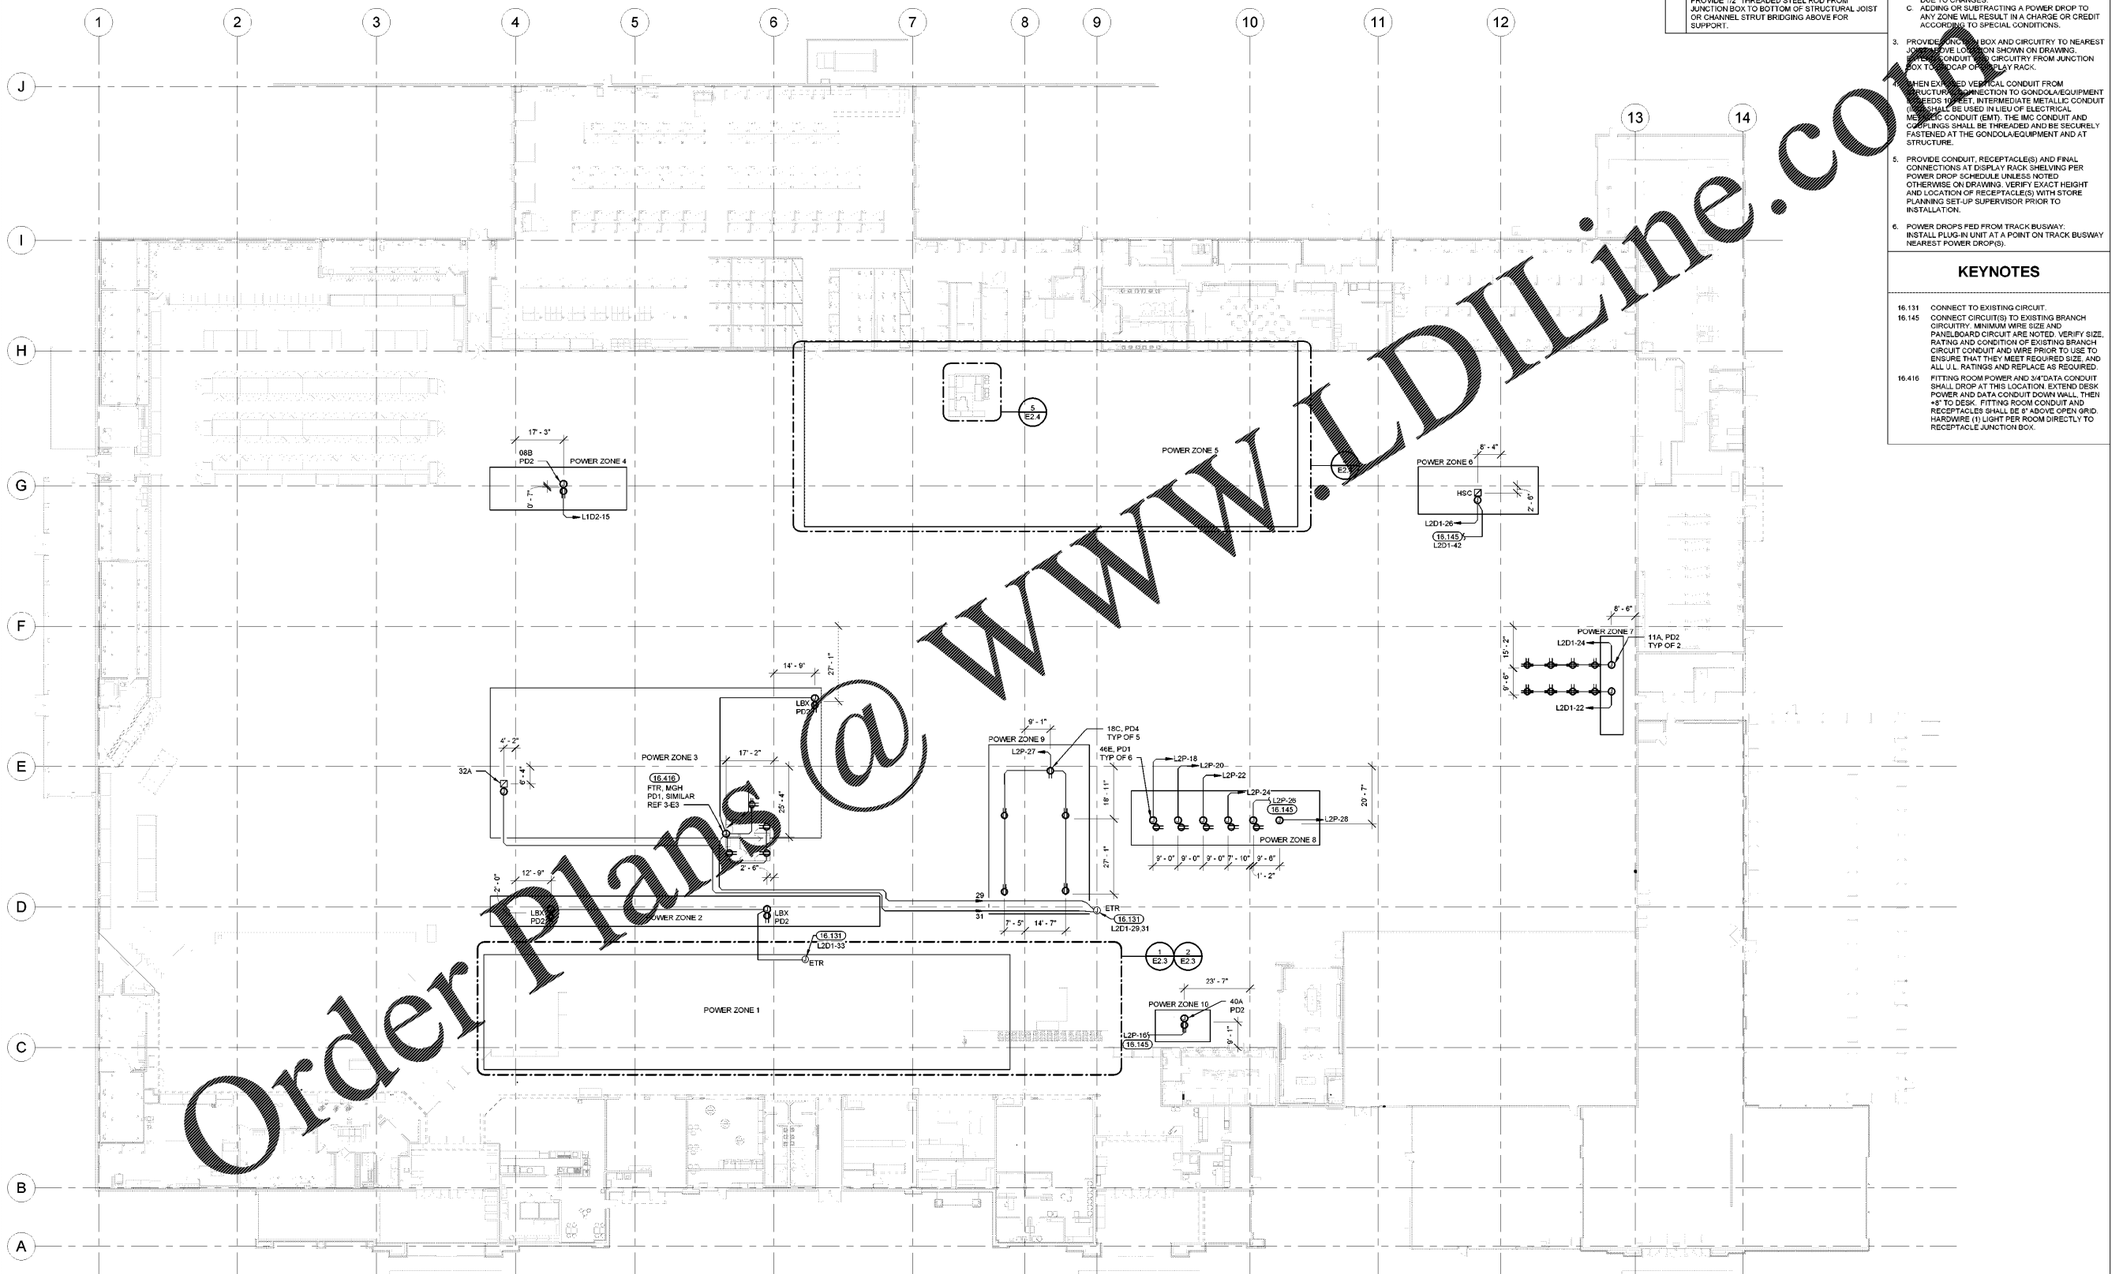

1 POWER DROP PLAN
1" = 20'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

Order Plans @ WWW.LDILine.com

brr
ARCHITECT OF RECORD:
DOHN R. FRANK
8131 METCALF AVENUE
SUITE 350
OVERLAND PARK, KS 66204
www.brrarch.com
TEL: 913-262-9095
FAX: 913-262-9044

STIPULATION FOR REUSE

THESE DRAWINGS WERE PREPARED FOR USE ON THIS PROJECT ONLY AND ARE NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT. THEY ARE NOT TO BE LOANED, COPIED OR REPRODUCED, OR OTHERWISE DISPOSED OF WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. ALL COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING COPYRIGHT, ARE HEREBY RESERVED. ALL DRAWINGS ARE INSTRUMENTS OF SERVICE AND SHALL REMAIN THE PROPERTY OF THE ARCHITECT. THE ARCHITECT SHALL RETAIN ALL PROPERTY RIGHTS. THE USE OF THESE DRAWINGS BY THE OWNER OR ANY OTHER PERSON OR ENTITY FOR ANY PURPOSE OTHER THAN AS SPECIFICALLY AGREED TO BY THE ARCHITECT IN WRITING IS PROHIBITED.

CONSULTANTS

HENDERSON ENGINEERS
9400 LEDBETTER DRIVE, SUITE 300
LENEXA, KS 66214
TEL: 913.422.0300 FAX: 913.422.0001
WWW.HENDERSONENGINEERS.COM
JOHNSTOWN, PA OFFICE
814.266.6008
GA. CORPORATE NO. RF0002734
EXPIRES 5/31/2021

Walmart
ATLANTA (GRESHAM)
2425 GRESHAM PARKWAY, 30316
STORE NO. 6370A-2535
GENERAL REMODEL
JOB NUMBER: 2180663709 | PROTO: SPRB

ISSUE BLOCK

CHECKED BY:	BC/BW
DRAWN BY:	JRF
PROTO CYCLE:	09/25/20
DOCUMENT DATE:	11/20/20

NOT FOR CONSTRUCTION

POWER DROP PLAN

SHEET: E2.1

WILLIAM R. WINSTON