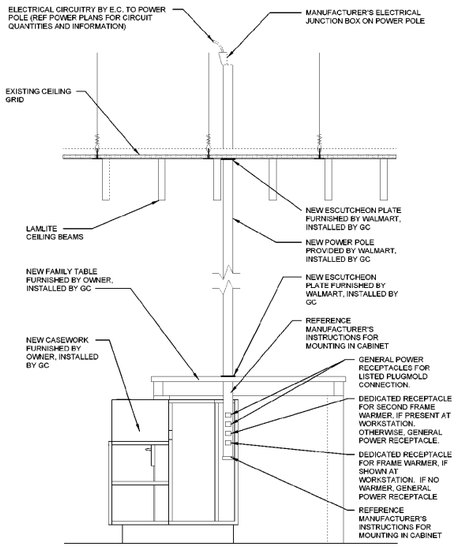


5 POWER POLE CONNECTIONS DETAIL
1" = 1'-0"

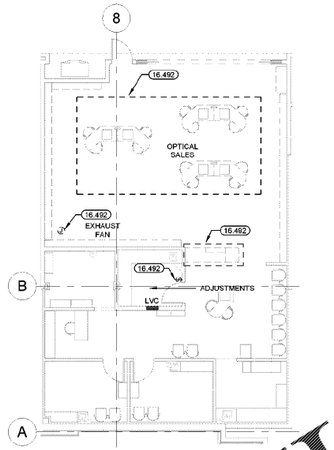


4 VISION CENTER POWER DEMO PLAN
1/8" = 1'-0"

## KEYNOTES

16.100 PROVIDE BI-LEVEL LIGHTING BY ALTERNATING SWITCH LEGS BETWEEN LIGHT FIXTURES. (CHECKERBOARD)

16.125 EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE.

16.445 ELECTROMAGNETIC LOCK: INSTALL PUSH BUTTON, MOTION SENSOR AND LOW VOLTAGE TRANSFORMER FURNISHED WITH DOOR HARDWARE PER MANUFACTURERS INSTRUCTIONS. PROVIDE JUNCTION BOX(ES), CONDUIT AND LOW VOLTAGE WIRING AS REQUIRED. MOTION SENSOR SHALL BE ON LUBE AND TIRE MOUNTING AREA SIDE OF DOOR. SET MOTION SENSOR TO RELEASE LOCK FOR 20 SECONDS UPON ACTIVATION.

16.453 PROVIDE A RECESSED SINGLE-GANG BOX WITH WIREMOLD V2448 SINGLE-GANG DEVICE BOX TO SERVE PLUGMOLD STRIP. PROVIDE THE RECEPTACLE AND COVER PLATE IN THE SURFACE DEVICE BOX.

16.492 E.C. SHALL COORDINATE WITH GENERAL CONTRACTOR AND ARCHITECTURAL DEMOLITION PLANS THE EXTENT OF ELECTRICAL DEMOLITION. REMOVE UNUSED DEVICES, BOXES, CONDUITS, AND WIRING BACK TO ORIGINATING JUNCTION BOXES OR PANELBOARDS. REFERENCE POWER PLANS FOR CIRCUITRY TO BE REUSED. DEMOLITION SHALL NOT AFFECT ADJOINING CIRCUITS. IF CIRCUIT IS DEMOLISHED ALL THE WAY TO PANELBOARD, REMOVE CIRCUIT BREAKER AND REPLACE WITH FILLER PLATE. UPDATE TYPEWRITTEN CIRCUIT DIRECTORY IDENTIFYING CIRCUIT AS "SPACE". COORDINATE EXACT REQUIREMENTS WITH EXISTING CONDITIONS PRIOR TO BID.

16.661 DATA AND PHONE CONDUIT: PROVIDE CONDUIT SLEEVE THROUGH WALL AND ROUTE ABOVE BAR JOIST, UNLESS NOTED OTHERWISE. ROUTE CONDUIT TO THE TOP SIDE OF CABLE TRAY WITH THE CONDUIT CONNECTOR AND BUSHING EXTENDING NO MORE THAN 1" OVER CABLE TRAY.

NEW RECEPTACLES IN OPTICAL SALES TO BE GRAY IN COLOR WITH GRAY COVERPLATES, TYP

ELECTRICAL CONTRACTOR SHALL PERMANENTLY INSTALL OWNER FURNISHED POWER STRIP TO MILL WORK, AND CONNECT TO POWER POLE. FRAME WARMER'S ARE NOT TO BE ATTACHED TO POWER STRIP.

ELECTRICAL CONTRACTOR TO REFERENCE ARCHITECTURAL SHEETS FOR POWER POLE LOCATIONS, COORDINATE WITH MILLWORK OPENING FOR POWER POLE INSTALLATION.

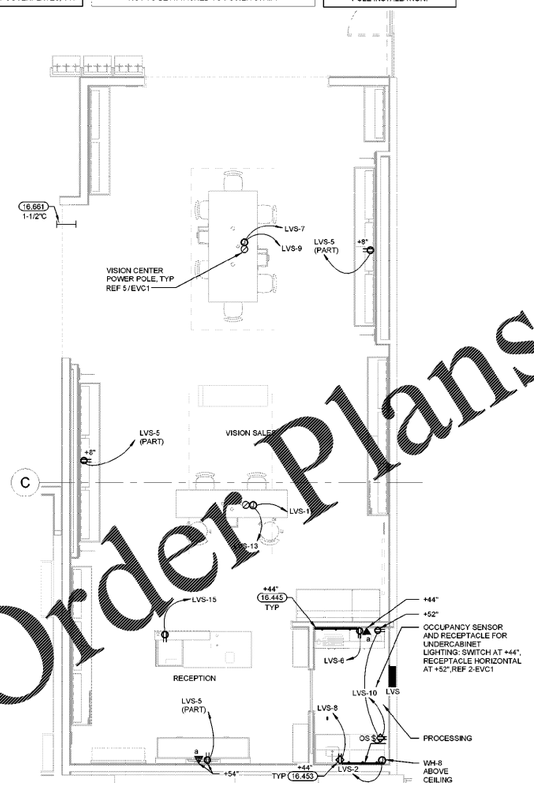


3 VISION SALES POWER PLAN
1/4" = 1'-0"

CONTRACTOR IS RESPONSIBLE FOR THE COMPLETE INSTALLATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR ADJUST FIXTURE LOCATION AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS WITH EVEN SPACING MAINTAINED.

REFERENCE ARCHITECTURAL SHEETS FOR TYPE 85 AND 91 MOUNTING HEIGHTS, TYP

TYPE 87 ALONG PERIMETER TO BE TRIMMED AT PRODUCT BY GC.

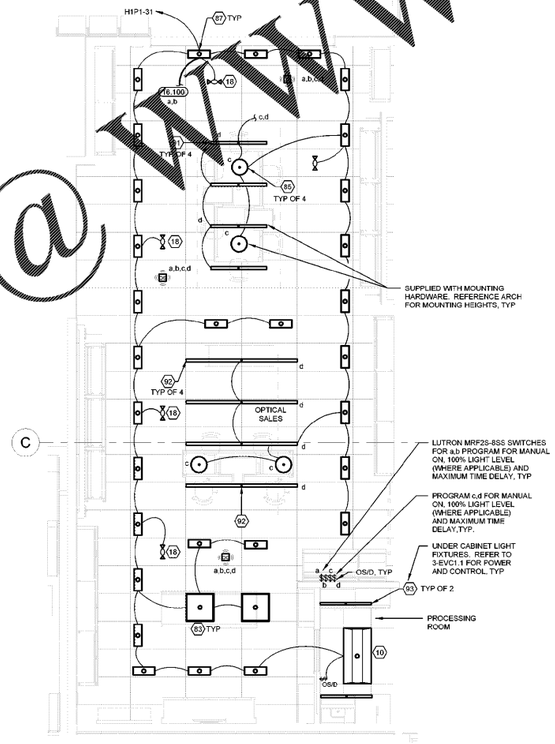


2 VISION SALES LIGHTING PLAN
1/4" = 1'-0"

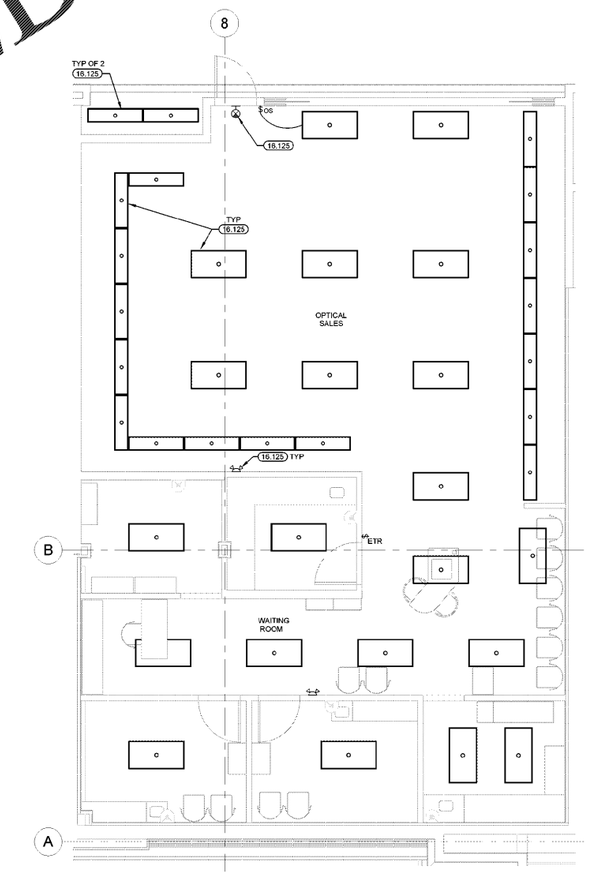


1 VISION CENTER LIGHTING PLAN
1/4" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

brr
ARCHITECT OF RECORD:
DOHN P. FRANK
8131 METCALF AVENUE
SUITE 300
OVERLAND PARK, KS 66204
www.brrarch.com
TEL: 913-262-9095
FAX: 913-262-9044

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND SHALL NOT BE USED IN CONNECTION WITH ANY OTHER PROJECT. THIS DRAWING IS NOT TO BE LOANED, COPIED OR REPRODUCED IN WHOLE OR IN PART FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF BRR ARCHITECTURE, INC. AND NO PROPRIETARY RIGHTS TO THIS DRAWING SHALL BE CONVEYED BY REASON OF ANY PUBLICATION, WHETHER INTENTIONAL OR UNINTENTIONAL. ANY REUSE OF THIS DRAWING WITHOUT WRITTEN VERIFICATION OR ADAPTATION BY BRR ARCHITECTURE, INC. FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO BRR ARCHITECTURE, INC. AND USER SHALL INDEMNIFY AND HOLD HARMLESS BRR ARCHITECTURE, INC. AGAINST ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM. ANY REUSE SHALL ENTITLE BRR ARCHITECTURE, INC. TO REASONABLE COMPENSATION.

CONSULTANTS
HENDERSON ENGINEERS
8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.422.0300 FAX 913.422.0001
WWW.HENDERSON-ENGINEERS.COM
JAMES SIMS
GA CORPORATE NO. PE000734
EXPIRES 9/30/2021

Walmart
ATLANTA (GRESHAM)
2400 GRESHAM PARKWAY
ATLANTA, GEORGIA 30316
STORE NO. 6370-2-2305
GENERAL REMODEL
JOB NUMBER: 2180663709 | PROTO: SPHB

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | BC/BW |
| DRAWN BY: | JRF |
| PROTO CYCLE: | 09/25/20 |
| DOCUMENT DATE: | 11/20/20 |

NOT FOR CONSTRUCTION

VISION CENTER ELECTRICAL PLANS

SHEET
EVC1

WILLIAM R. WINSTON

Order Plans @ WWW.LDILine.com