


DUCTWORK #1 PARTS - JOB#4613860 DOUBLE WALL

TAG	PART #	CFM	SP	WEIGHT	VELOCITY	QTY	DESCRIPTION	
P1	DW1017DWLT-2R-S	1100	-0.014	17.41	2016.81	1	DOUBLE WALL DUCT - 10" INNER DUCT, 17' LONG - 2 LAYERS REDUCED CLEARANCE - 14" STAINLESS STEEL OUTER SHELL.	
P2	DW1027DWAJD-2R-S	1100	-0.014	39.87	2016.81	1	DOUBLE WALL ADJUSTABLE DUCT - 10" INNER DUCT - 2 LAYERS REDUCED CLEARANCE - 14" STAINLESS STEEL OUTER SHELL. MIN LENGTH = 11' / MAX LENGTH = 25.5' / ADJUSTMENT = 14.5' / ADJUSTABLE SECTION MAY NEED TO BE CUT. INCLUDES SINGLE AND DOUBLE WALL "V" CLAMPS.	
P3	DW1090DWASY-2R-S	1100	-0.1391	20.35	2016.81	1	DOUBLE WALL DUCT - 10" INNER 90 DUCT - 2 LAYERS REDUCED CLEARANCE - 14" STAINLESS STEEL OUTER SHELL.	
P4	DW1027DWAJD-2R-S	1100	-0.012	39.87	2016.81	1	DOUBLE WALL ADJUSTABLE DUCT - 10" INNER DUCT - 2 LAYERS REDUCED CLEARANCE - 14" STAINLESS STEEL OUTER SHELL. MIN LENGTH = 11' / MAX LENGTH = 25.5' / ADJUSTMENT = 14.5' / ADJUSTABLE SECTION MAY NEED TO BE CUT. INCLUDES SINGLE AND DOUBLE WALL "V" CLAMPS.	
P5	ASSEMBLED W/P6	DW101DWTEASY-2R-S	1100	-0.214	27.71	2016.81	1	DOUBLE WALL DUCT - 10" INNER TEE DUCT - 2 LAYERS REDUCED CLEARANCE - 14" STAINLESS STEEL OUTER SHELL.
P6	ASSEMBLED W/P5 D=S	DW101DWACCDORCDV-2R-S		15.14		1	DOUBLE WALL DUCT - 10" INNER ACCESS DOOR & 14" ACCESS DOOR COVER WITH CLAMPS - 2 LAYERS REDUCED CLEARANCE - 14" STAINLESS STEEL OUTER SHELL.	
P7	DW1027DWAJD-2R-S	1100	-0.012	39.87	2016.81	1	DOUBLE WALL ADJUSTABLE DUCT - 10" INNER DUCT - 2 LAYERS REDUCED CLEARANCE - 14" STAINLESS STEEL OUTER SHELL. MIN LENGTH = 11' / MAX LENGTH = 25.5' / ADJUSTMENT = 14.5' / ADJUSTABLE SECTION MAY NEED TO BE CUT. INCLUDES SINGLE AND DOUBLE WALL "V" CLAMPS.	
SINGLE WALL FACTORY BUILT DUCTWORK								
- ALL DUCTWORK IS REQUIRED TO BE INSTALLED WITH THE MAXIMUM SUPPORT SPACING LISTED BELOW.								
- FOR A COMPLETE LIST OF APPROVED SUPPORT METHODS, SEE THE ENTIRE INSTALLATION AND OPERATION MANUAL.								
- DUCTWORK SHALL SLOPE NOT LESS THAN 1/16" PER LINEAR FOOT TOWARDS THE HOOD OR AN APPROVED GREASE COLLECTION RESERVOIR.								
- WHERE HORIZONTAL DUCTS EXCEED 75 FEET IN LENGTH, THE SLOPE SHALL NOT BE LESS THAN 3/16" PER LINEAR FOOT.								

DUCTWORK #1 FRONT VIEW DUCTWORK #1 SIDE VIEW DUCTWORK #1 TOP VIEW

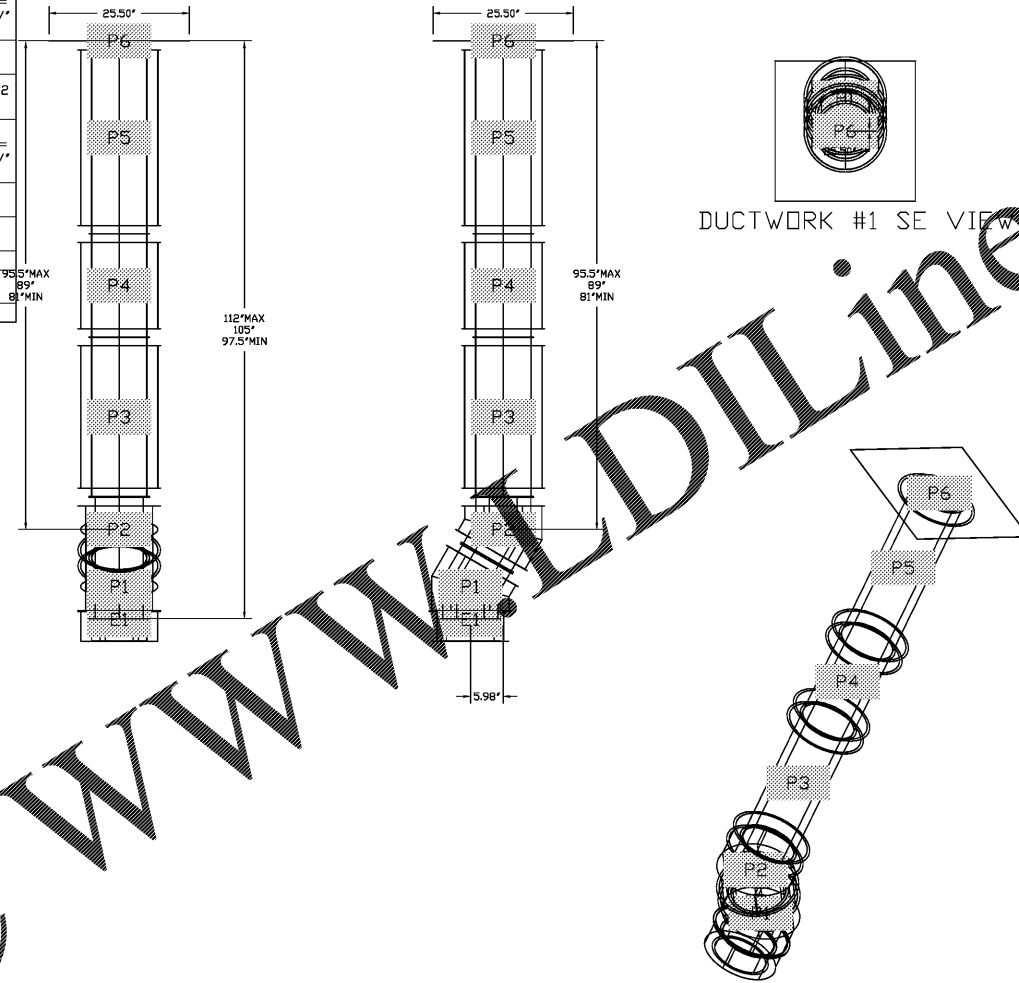

DUCT DIAMETER	HORIZONTAL SUPPORT (FT)	VERTICAL WALL SUPPORT (FT)	VERTICAL CURB SUPPORT (FT)
5"	10'	10'	24'
6"	10'	10'	24'
7"	10'	10'	24'
8"	10'	10'	24'
10"	10'	10'	24'
12"	10'	10'	24'
14"	10'	10'	24'
16"	10'	10'	24'
18"	10'	10'	24'
20"	10'	10'	24'
22"	10'	10'	24'
24"	10'	10'	24'
26"	10'	10'	24'
28"	10'	10'	24'
30"	10'	10'	24'
32"	10'	10'	24'
34"	10'	10'	24'
36"	10'	10'	24'

DOUBLE WALL FACTORY BUILT DUCTWORK

- ALL DUCTWORK IS REQUIRED TO BE INSTALLED WITH THE MAXIMUM SUPPORT SPACING LISTED BELOW.
- FOR A COMPLETE LIST OF APPROVED SUPPORT METHODS, SEE THE ENTIRE INSTALLATION AND OPERATION MANUAL.
- DUCTWORK SHALL SLOPE NOT LESS THAN 1/16" PER LINEAR FOOT TOWARDS THE HOOD OR AN APPROVED GREASE COLLECTION RESERVOIR.
- WHERE HORIZONTAL DUCTS EXCEED 75 FEET IN LENGTH, THE SLOPE SHALL NOT BE LESS THAN 3/16" PER LINEAR FOOT.

HORIZONTAL	
DUCT DIAMETER	SUPPORT SPACING (FT)
5"	7'
6"	7'
7"	7'
8"	7'
10"	7'
12"	7'
14"	7'
16"	7'
18"	5'
20"	5'
22"	5'
24"	5'
26"	5'
28"	5'
30"	5'
32"	5'
34"	5'
36"	5'

VERTICAL			
TYPE	WALL SUPPORT (FT)	CURB SUPPORT (FT)	FLOOR SUPPORT (FT)
2R & 2R HT (5'-16")	20'	24'	24'
2R (18")	18'	24'	24'
3R & 3Z (5'-24")	10'	24'	24'
3Z (26" -36")	10'	20'	20'

Order Plans @ WWW.DIline.com

DO NOT LEAK TEST USING SMOKE BOMBS CONTAINING CHLORINES/CHLORIDES. CONSULT WITH CAPTIVEAIRE FOR PROPER LEAK TESTING METHODS.

REVISIONS	
DESCRIPTION	DATE

**CAPTIVEAIRE**  
Seattle Office  
1309 Pacific Ave. Everett, WA 98201 PHONE: (425) 212-5606 FAX: (425) 212-5608 EMAIL: rep5@captivaire.com

7Eleven #41795 Ocala FL  
MARICAMP RD & CEDAR RADIAL,  
Ocala, FL, 34475

DATE: 12/11/2020  
DWG.#: 4651405  
DRAWN BY: A\_CASH 85  
SCALE: 3/4" = 1'-0"  
MASTER DRAWING

SHEET NO. 6

PROJECT NAME: 7-ELEVEN #1795 - OCALA, FL  
9000 BLOCK OF SE MARICAMP ROAD  
OCALA, FL 34470

CLIENT NAME: BLACKFIN PARTNERS INVESTMENTS, INC.  
4400 PCA BLVD, SUITE 600  
PALM BEACH GARDENS, FL 33410

SHEET TITLE: KITCHEN EXHAUST SUBMITTALS

1925 Prospect Ave.  
Orlando, FL 32814  
P (407) 661-9100  
P (407) 661-9101  
www.cp.com  
Florida Corporate Certificate #AA 000626

**Cuhaci & Peterson**  
Architects Engineers Planners

PROJECT NO. 2200355  
DATE 12/17/2020  
DRAWN FD  
CHECKED JD

M3.5