MATCH LINE - SEE SHEET E-101 FOR CONTINUATION

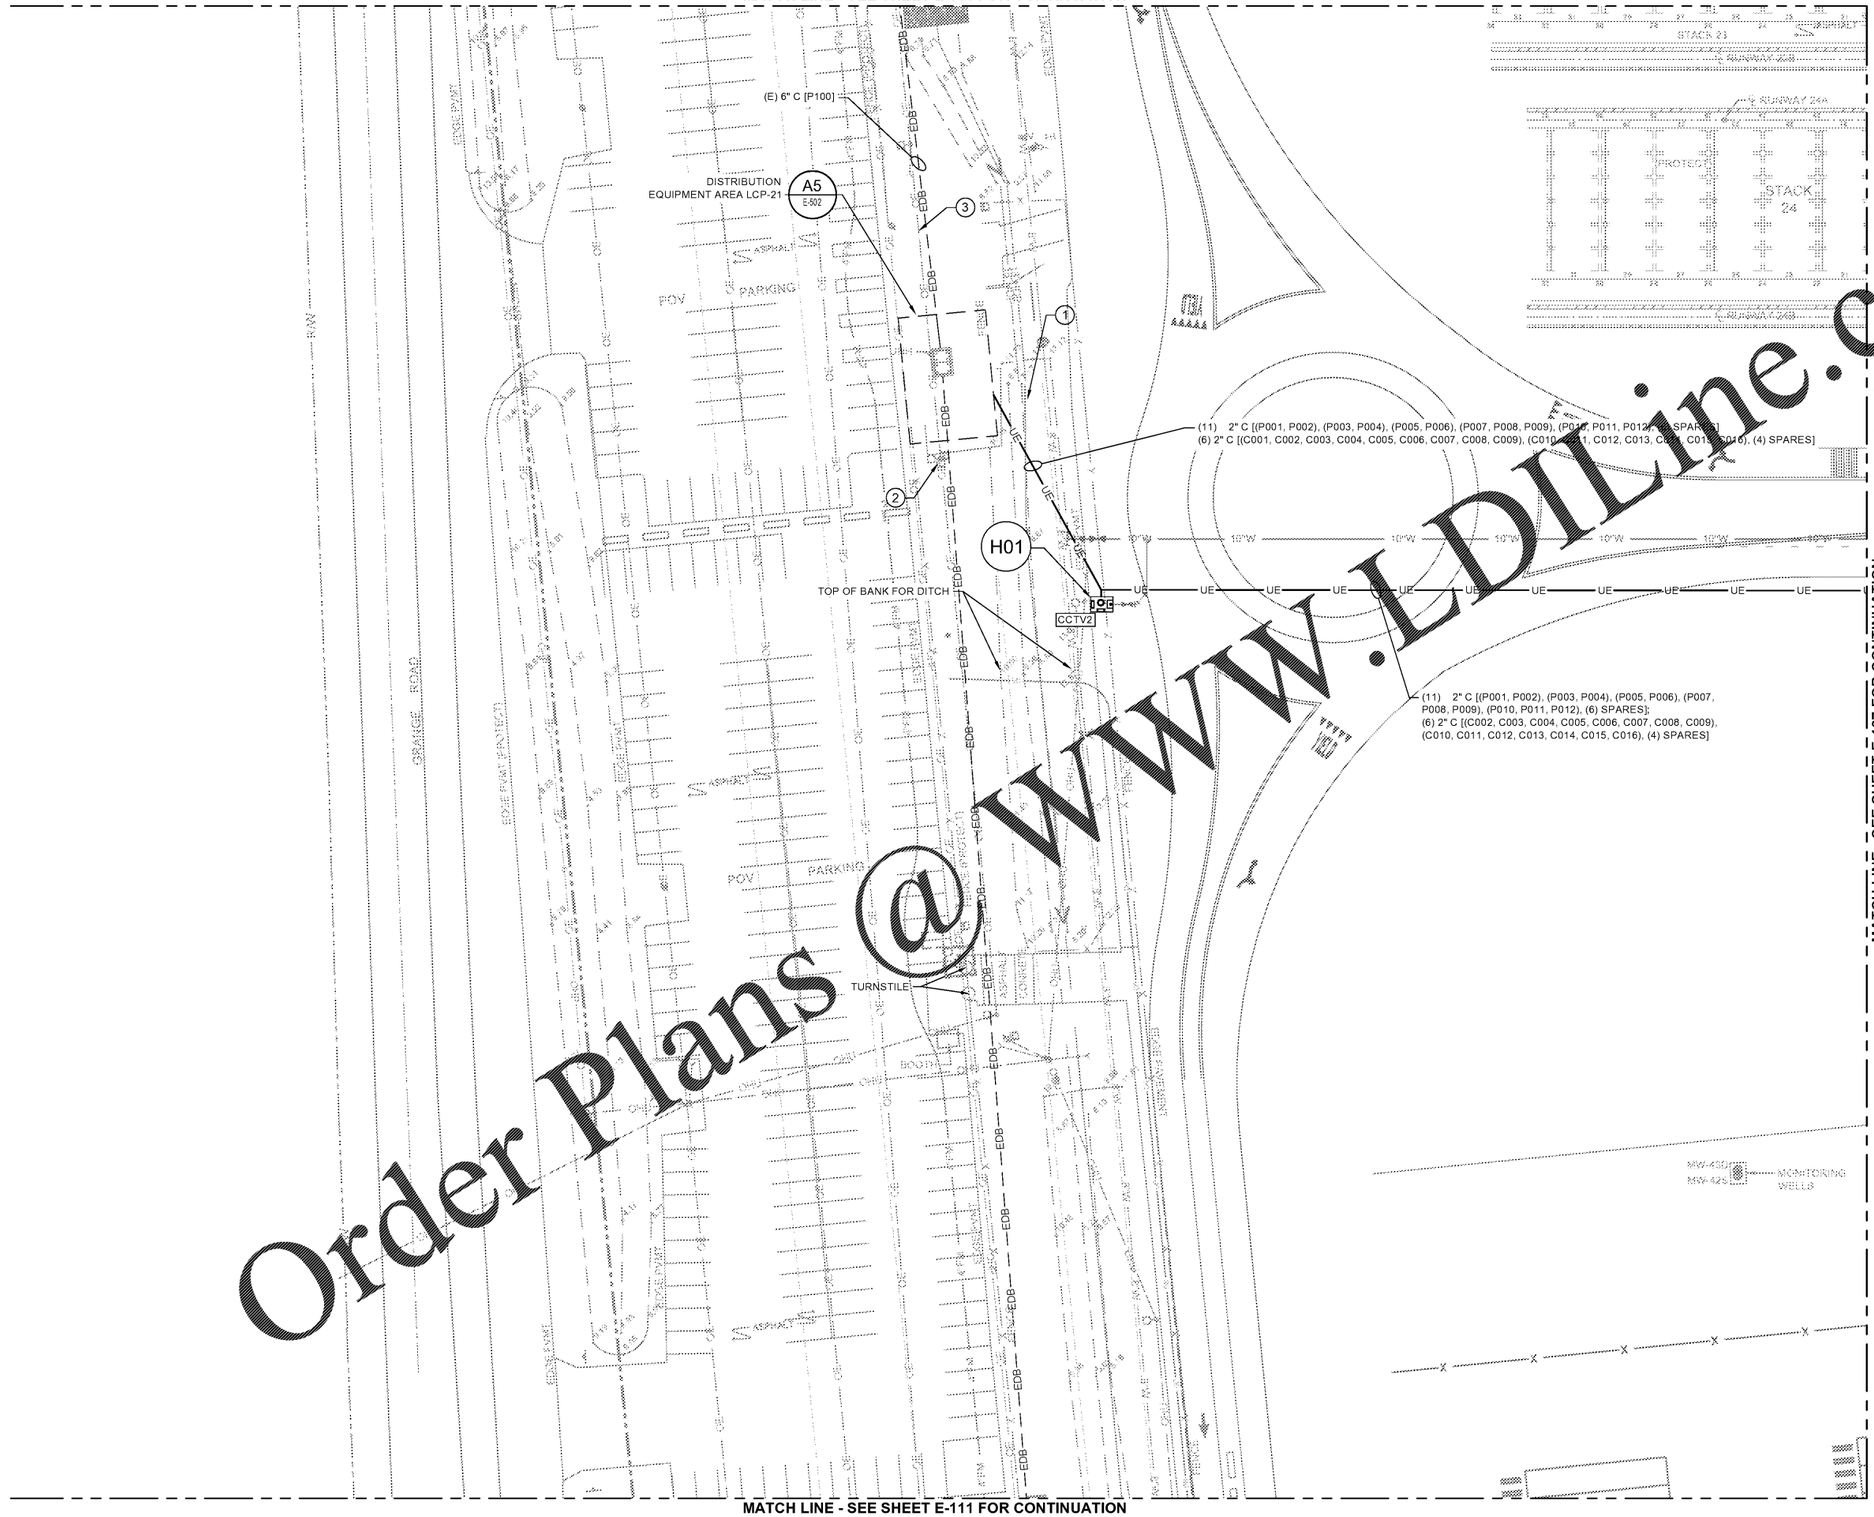

KEYNOTES

1. CONTRACTOR SHALL MODIFY DITCH AS NECESSARY TO ACCOMMODATE NEW CONDUIT.
2. EXISTING FIP 18. PROVIDE NEW 20A CIRCUIT FROM P2 WITH (2) #10, #10(G) IN 1" CONDUIT AND 12-STRAND FIBER TO LCP-21 COMMUNICATIONS CABINET.
3. PROVIDE 24-STRAND FIBER FROM LCP-21 COMMUNICATIONS CABINET OVERHEAD BACK TO LCP-20.

GENERAL SHEET NOTES

1. SEE SHEET E-001 FOR ELECTRICAL GENERAL NOTES.
2. SEE SHEET E-002 FOR ABBREVIATIONS AND LEGEND.



KEY PLAN

N

30' 0' 30' 60'

SCALE: 1"=30'

BID ISSUE
ISSUED: 2021-02-03
NOT TO BE USED FOR CONSTRUCTION

DRAWING SCALES SHOWN BASED ON 22"x34" DRAWING

Order Plans @ WWW.LDIline.com

GEORGIA PORTS

Mark	Description	Date	App'd

GEORGIA PORTS AUTHORITY
GCT CAPACITY IMPROVEMENTS - PHASE 2

ELECTRICAL PLAN

moffatt & nichol
2 EAST BRYAN ST., STE 501
SAVANNAH, GA 31401
912-231-0044

Designed by: JAG	Date: 12/21/20	Rev:	
Drawn by: BRL	Check by: DAW	M&N Project No. 5531-284B	
Reviewed by: JHP		GPA Project No. 19100-1011C	
Submitted by: MOFFATT & NICHOL	Drawing Scale: AS NOTED	Plot scale: 1:1 (D SHEET)	

SEAL

Sheet Reference No.
E-106
INDEX: OF

File: Q:\V\5531-264 2020 Capacity Improvements\600 CADD_Active_Phase2_2020 Peak_Elec\5531264-E106 - Plotted: 2/3/2021 11:30 AM by GREGG, ALAN - Saved: 2/3/2021 11:20 AM by BUCKEY