

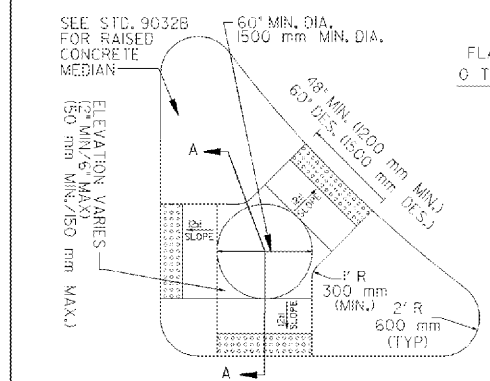


6/18/2009 11:48:33 File \\V:\D03\0281\GLOT\102\gplot.tbl opens V:\D03\0281\gplot.tbl default.plt 0/1/0/0

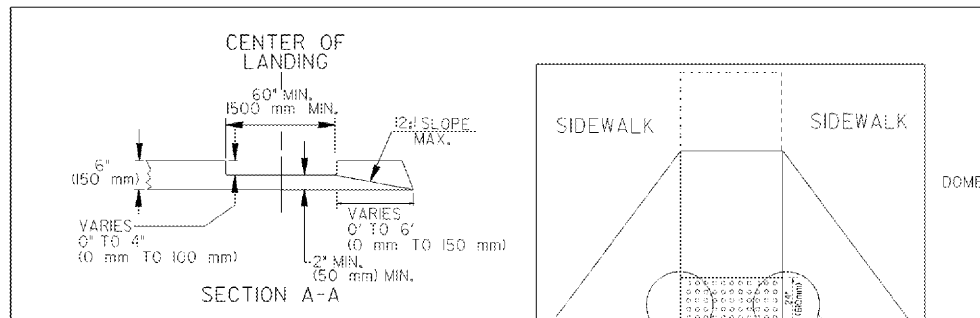

CONCRETE ISLAND WITH ELEVATED CUT THROUGH

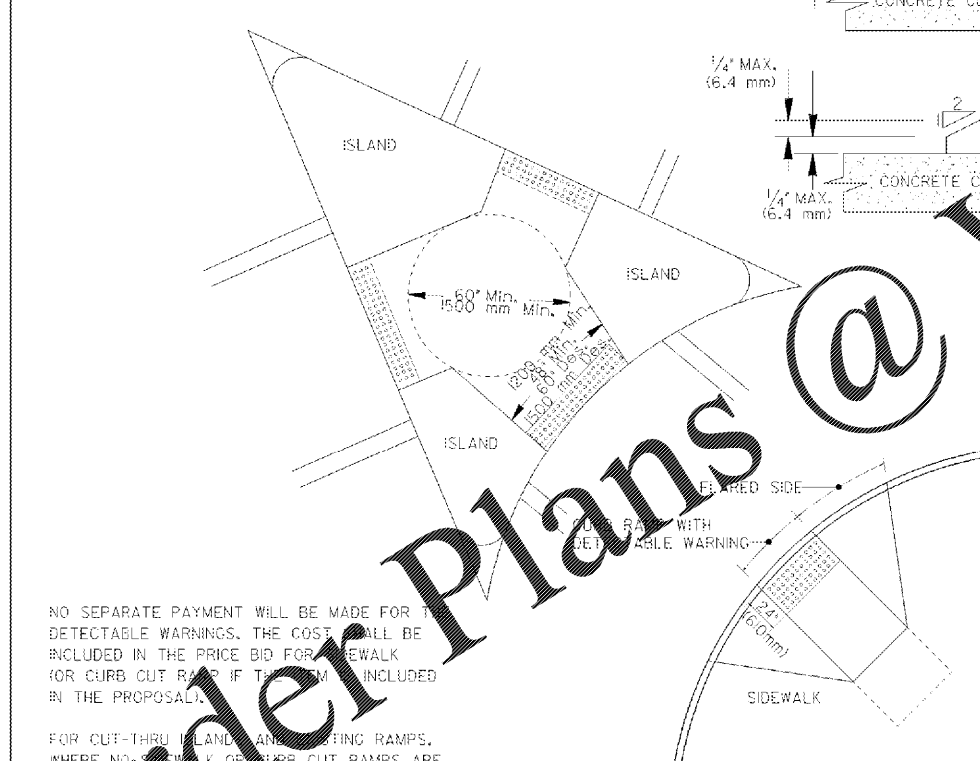


DETAIL FOR DETECTABLE WARNING AT CUT-THRU CONCRETE ISLAND

SIZE: DETECTABLE WARNINGS SHALL BE 24 INCHES (610 mm) IN THE DIRECTION OF PEDESTRIAN TRAVEL AND EXTEND THE FULL WIDTH OF THE CURB RAMP OR FLUSH SURFACE.
LOCATION: THE DETECTABLE WARNING SHALL BE LOCATED SO THAT THE EDGE NEAREST THE CURB LINE OR OTHER POTENTIAL HAZARD IS 6 TO 8 INCHES (150 mm TO 180 mm) FROM THE CURB LINE OR OTHER POTENTIAL HAZARD, SUCH AS A REFLECTIVE POOL EDGE OR THE DYNAMIC ENVELOPE OF RAIL OPERATIONS.


DOMES SIZE AND SPACING: TRUNCATED DOMES SHALL HAVE A BASE DIAMETER OF 0.9 INCH TO 1.4 INCH (23 mm-36 mm) AT THE BOTTOM, A DIAMETER OF 0.45 INCH TO 0.9 INCH (11 mm-23 mm) AT THE TOP, THE TOP DIAMETER SHALL BE A MINIMUM OF 50% AND A MAXIMUM OF 65% OF THE BASE DIAMETER, A HEIGHT OF 0.2 INCH (5 mm) AND A CENTER-TO-CENTER SPACING OF 2.40 INCHES (61 mm) DESIRABLE 1.60 INCHES (41 mm) MINIMUM MEASURED ALONG ONE SIDE OF A SQUARE ARRANGEMENT. DOMES SHALL HAVE A SQUARE ARRANGEMENT. DOMES SHALL BE ALIGNED ON A SQUARE GRID IN THE PREDOMINANT DIRECTION OF TRAVEL TO PERMIT WHEELS TO ROLL BETWEEN DOMES.

VISUAL CONTRAST: DETECTABLE WARNING SURFACES SHALL CONTRAST VISUALLY WITH THE ADJACENT WALKING SURFACE EITHER LIGHT-ON-DARK OR DARK-ON-LIGHT. THE MATERIAL USED TO PROVIDE VISUAL CONTRAST SHALL BE AN INTEGRAL PART OF THE DETECTABLE WARNING SURFACE.

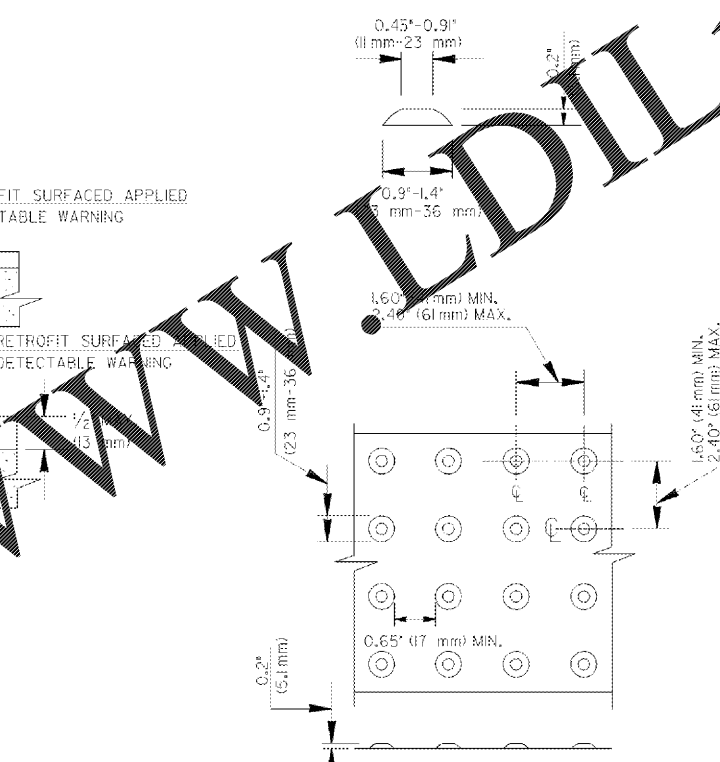

MATERIALS:
NEW CONSTRUCTION
THE DETECTABLE WARNINGS SHALL BE MADE OF MATERIALS SPECIFIED ON OPL 87.
RETROFIT OF EXISTING RAMPS
SURFACED APPLIED MATERIALS WILL ONLY BE APPROVED TO BE USED ON EXISTING WHEELCHAIR RAMPS.
INSTALLATION:
BRICK PAVERS SHALL BE SET IN A WET MORTAR BED. THE BEVEL SHALL BE PLACED ON CONCRETE. THE CONCRETE SHALL BE A MINIMUM 4" THICK.
CEMENT TILE SHALL BE EPOXIED IN PLACE OR SET IN A WET MORTAR BED. MANUFACTURER RECOMMEND ADHESIVE OR FASTENER SHALL BE USED IN THE INSTALLATION.
ALL OTHER MATERIALS SHALL BE INSTALLED ACCORDING TO MANUFACTURER'S DETAILS OR INSTRUCTION.

GENERAL NOTES:
RETROFIT SURFACED APPLIED MATERIALS ONLY:
1. CHANGES IN LEVEL OF 1/4" (6.4 mm) HIGH MAXIMUM SHALL BE PERMITTED VERTICALLY ON SURFACED APPLIED MATERIALS.
2. CHANGES IN LEVEL BETWEEN 1/4" (6.4 mm) HIGH MINIMUM AND 1/2" (13 mm) HIGH MAXIMUM SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 2:1.

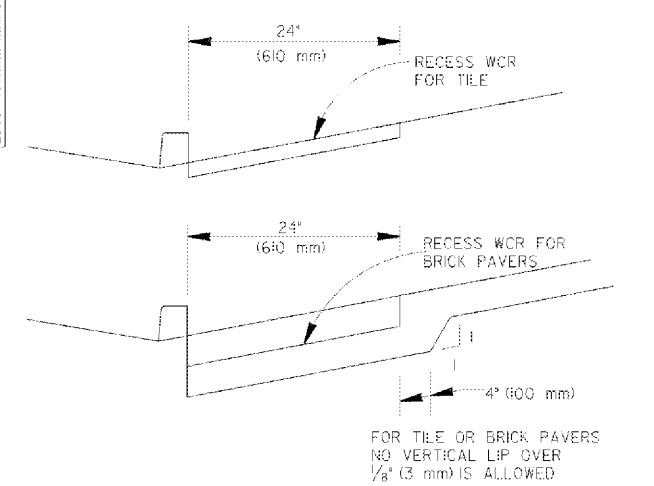

NO SEPARATE PAYMENT WILL BE MADE FOR DETECTABLE WARNINGS. THE COST SHALL BE INCLUDED IN THE PRICE BID FOR CURB RAMP (OR CURB CUT RAMP IF THE ITEM IS INCLUDED IN THE PROPOSAL).
FOR CUT-THRU ISLANDS AND CURB CUT RAMP, WHERE NO CURB RAMP OR CURB CUT RAMP IS IN THE PROPOSAL, THE COST OF THE DETECTABLE WARNING SHALL BE INCLUDED IN THE OVERALL BID PRICE SUBMITTAL.

| DEPARTMENT OF TRANSPORTATION STATE OF GEORGIA | |
|--|----------------|
| SPECIAL DETAIL | |
| DETECTABLE WARNING SURFACE TRUNCATED DOME SIZE, SPACING AND ALIGNMENT REQUIREMENTS | |
| NO SCALE | MARCH 12, 2002 |
| NUMBER A4 | |

| REVISION DATES | | CONSTRUCTION DETAILS SR 18 BRIDGE REPLACEMENT @ LONG CAME CREEK TROUP COUNTY | |
|----------------|-------|--|-------|
| CHECKED: | DATE: | CHECKED: | DATE: |
| BACKCHECKED: | DATE: | CORRECTED: | DATE: |
| CORRECTED: | DATE: | VERIFIED: | DATE: |
| VERIFIED: | DATE: | DRAWING No. 40-0003 | |