

NOTES:

- 4-FT. HT. CHAIN-LINK FENCE WITH TOP AND BOTTOM RAIL IS USED AS GUARD RAIL AT RETAINING WALL LOCATIONS.
- SHOP DRAWING SUBMITTAL SHALL CONFIRM THAT THE FENCE COMPLIES WITH 2018 IBC SECTION 1015 & 1607.8 (GENERALLY DESCRIBED BELOW).
 - TOP BAR & HAND RAIL: RESIST A LINEAR LOAD OF 50 POUNDS PER LINEAR FOOT & RESIST 200LB CONCENTRATED LOAD.
 - 4 INCH DIAMETER SPHERE CANNOT PASS THROUGH ANY OPENING UP TO A HEIGHT OF 34 INCHES. (VERTICAL PICKETS/POST OR BOTTOM RAIL)
- CONSTRUCTION OF UTILITIES SHOULD BE COMPLETED COINCIDENTLY WITH THE CONSTRUCTION OF THE RETAINING WALL(S). THERE WILL BE NO TRENCHING ALLOWED ONCE GEOGRID IS PLACED AND WALL IS CONSTRUCTED; UNDER NO CIRCUMSTANCE SHOULD THE GEOGRID BE SEVERED.

LEGEND:

- RIDGEROCK CAP UNITS, OR EQUIVALENT
- RIDGEROCK BLOCK UNITS, OR EQUIVALENT
- 8-INCH LEVELING PAD
- GRIDLOCK 370 STRUCTURAL GEOGRID, OR EQUIVALENT
- FINISHED GRADE AT TOP OF WALL
- FINISHED GRADE AT BOTTOM OF WALL



STA STATION ALONG RETAINING WALL ALIGNMENT
 "L" MINIMUM GEOGRID EMBEDMENT LENGTH
 "L1" MINIMUM GEOGRID EMBEDMENT LENGTH FOR UPPER MOST GEOGRID LAYER
 TOW ELEVATION AT TOP OF CAP BLOCK
 BOW ELEVATION AT BOTTOM OF BLOCK; TOP OF LEVELING PAD
 ● INDICATES CHANGE IN GRID TYPE AND/OR CHANGE IN GRID ELEVATION

WOOLPERT
 ARCHITECTURE | ENGINEERING | GEOSPATIAL


11301 Camel Commons Blvd
 Suite 300
 Charlotte, NC 28226
 704.525.6284
 FAX: 704.525.0115

Terracon
 Consulting Engineers and Scientists

486 SOUTH ASH AVENUE, SUITE H-4 TEMPE, AZ 85282
 PH: (480) 997-8200 FAX: (480) 997-1133

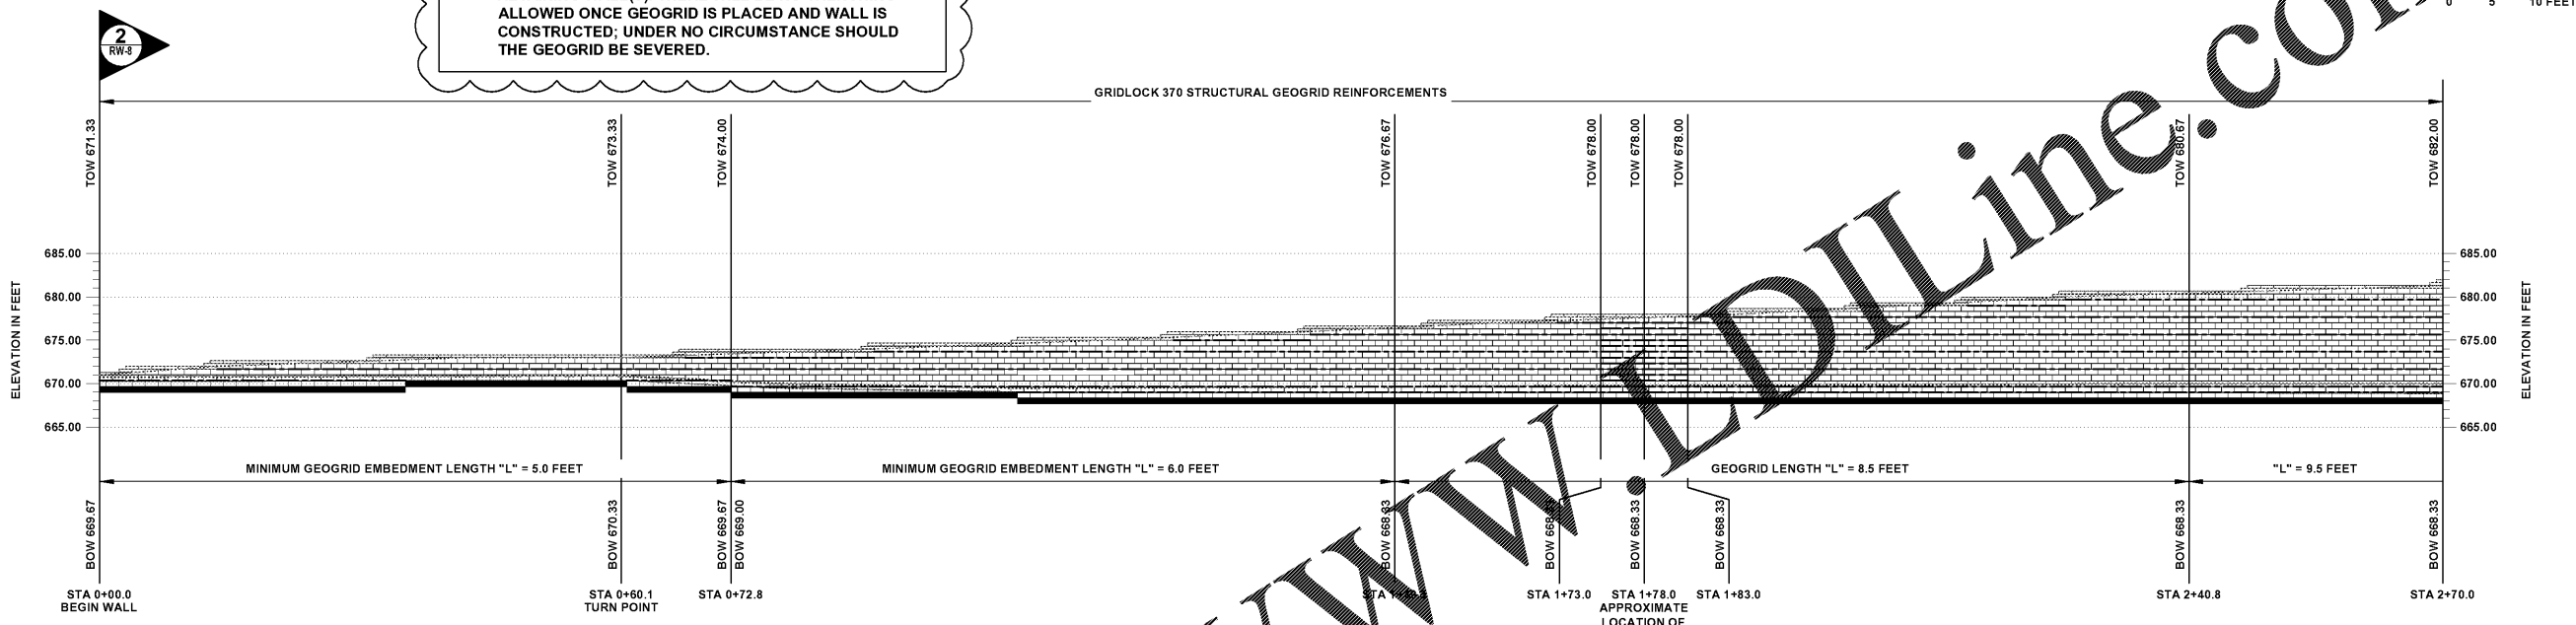

WALL 2 STA 0+00.0 TO 2+70.0: BLOCK AND GEOGRID PLACEMENT

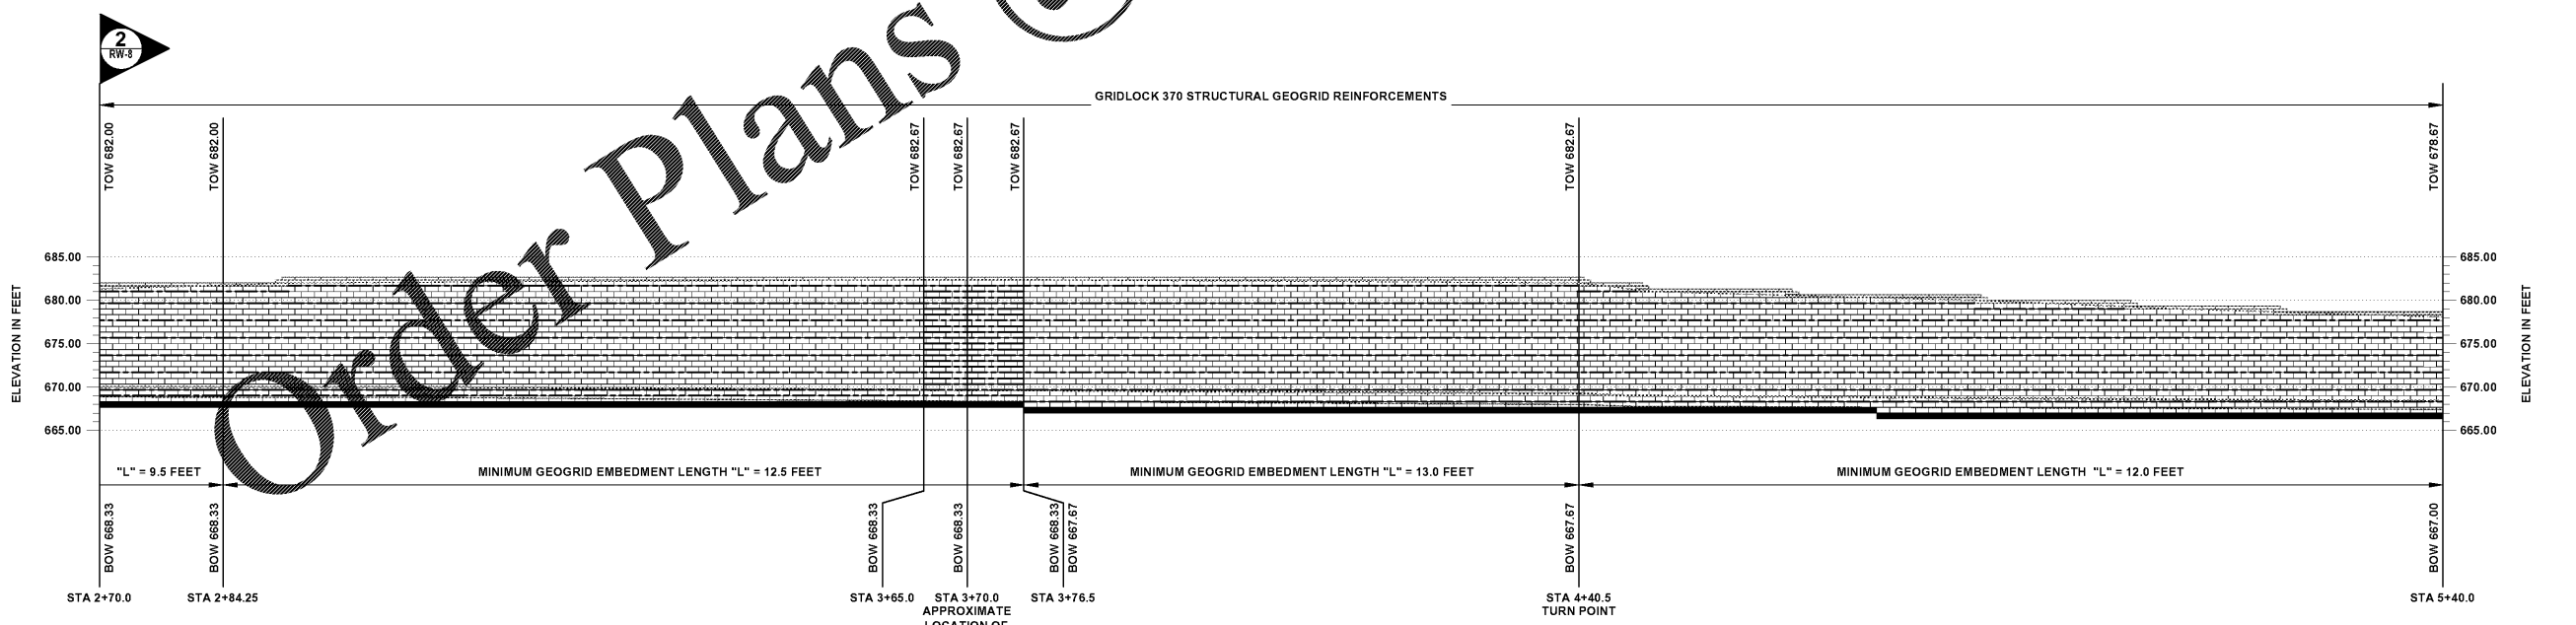

WALL 2 STA 2+70.0 TO 5+40.0: BLOCK AND GEOGRID PLACEMENT

Order Plans @ WWW.DIline.com

Lancaster County, South Carolina
Indian Land Soccer Complex

10167 Harrisburg Road
 Indian Land, SC 29707

Revisions:
 1/19/21 Added Note

Proj. No.: 80702
 Date: 11/16/2020

Sheet Name:
 Wall 2 Profile

RW-5