


NOTES:

1. REFER TO DRAWING E-3.0 FOR GENERAL NOTES AND SPECIFICATIONS.
2. COORDINATE LOCATION WITH GC AND/OR ARCHITECT PRIOR TO ROUGH-IN.
3. MOUNT RECEPTACLES ABOVE SHOW WINDOWS IN ACCORDANCE WITH 210.52.
4. ELECTRICAL CONTRACTOR SHALL ENSURE THAT A 120V MAINTENANCE RECEPTACLE IS AVAILABLE WITHIN 25 FEET OF THE HVAC EQUIPMENT PER NEC 210.63.
5. UNLESS OTHERWISE NOTED, CABLE RUNS FOR ALL 15 AND 20 AMP BRANCH CIRCUITS LONGER THAN 75 FEET SHALL BE AT LEAST 10 AWG.
6. MAINTAIN 24" (MIN) HORIZONTAL OFFSET BETWEEN ELECTRICAL BOXES ON OPPOSITE SIDES OF FIRE RATED WALLS.



1 POWER PLAN (SHELL)
SCALE: 3/16" = 1'-0"

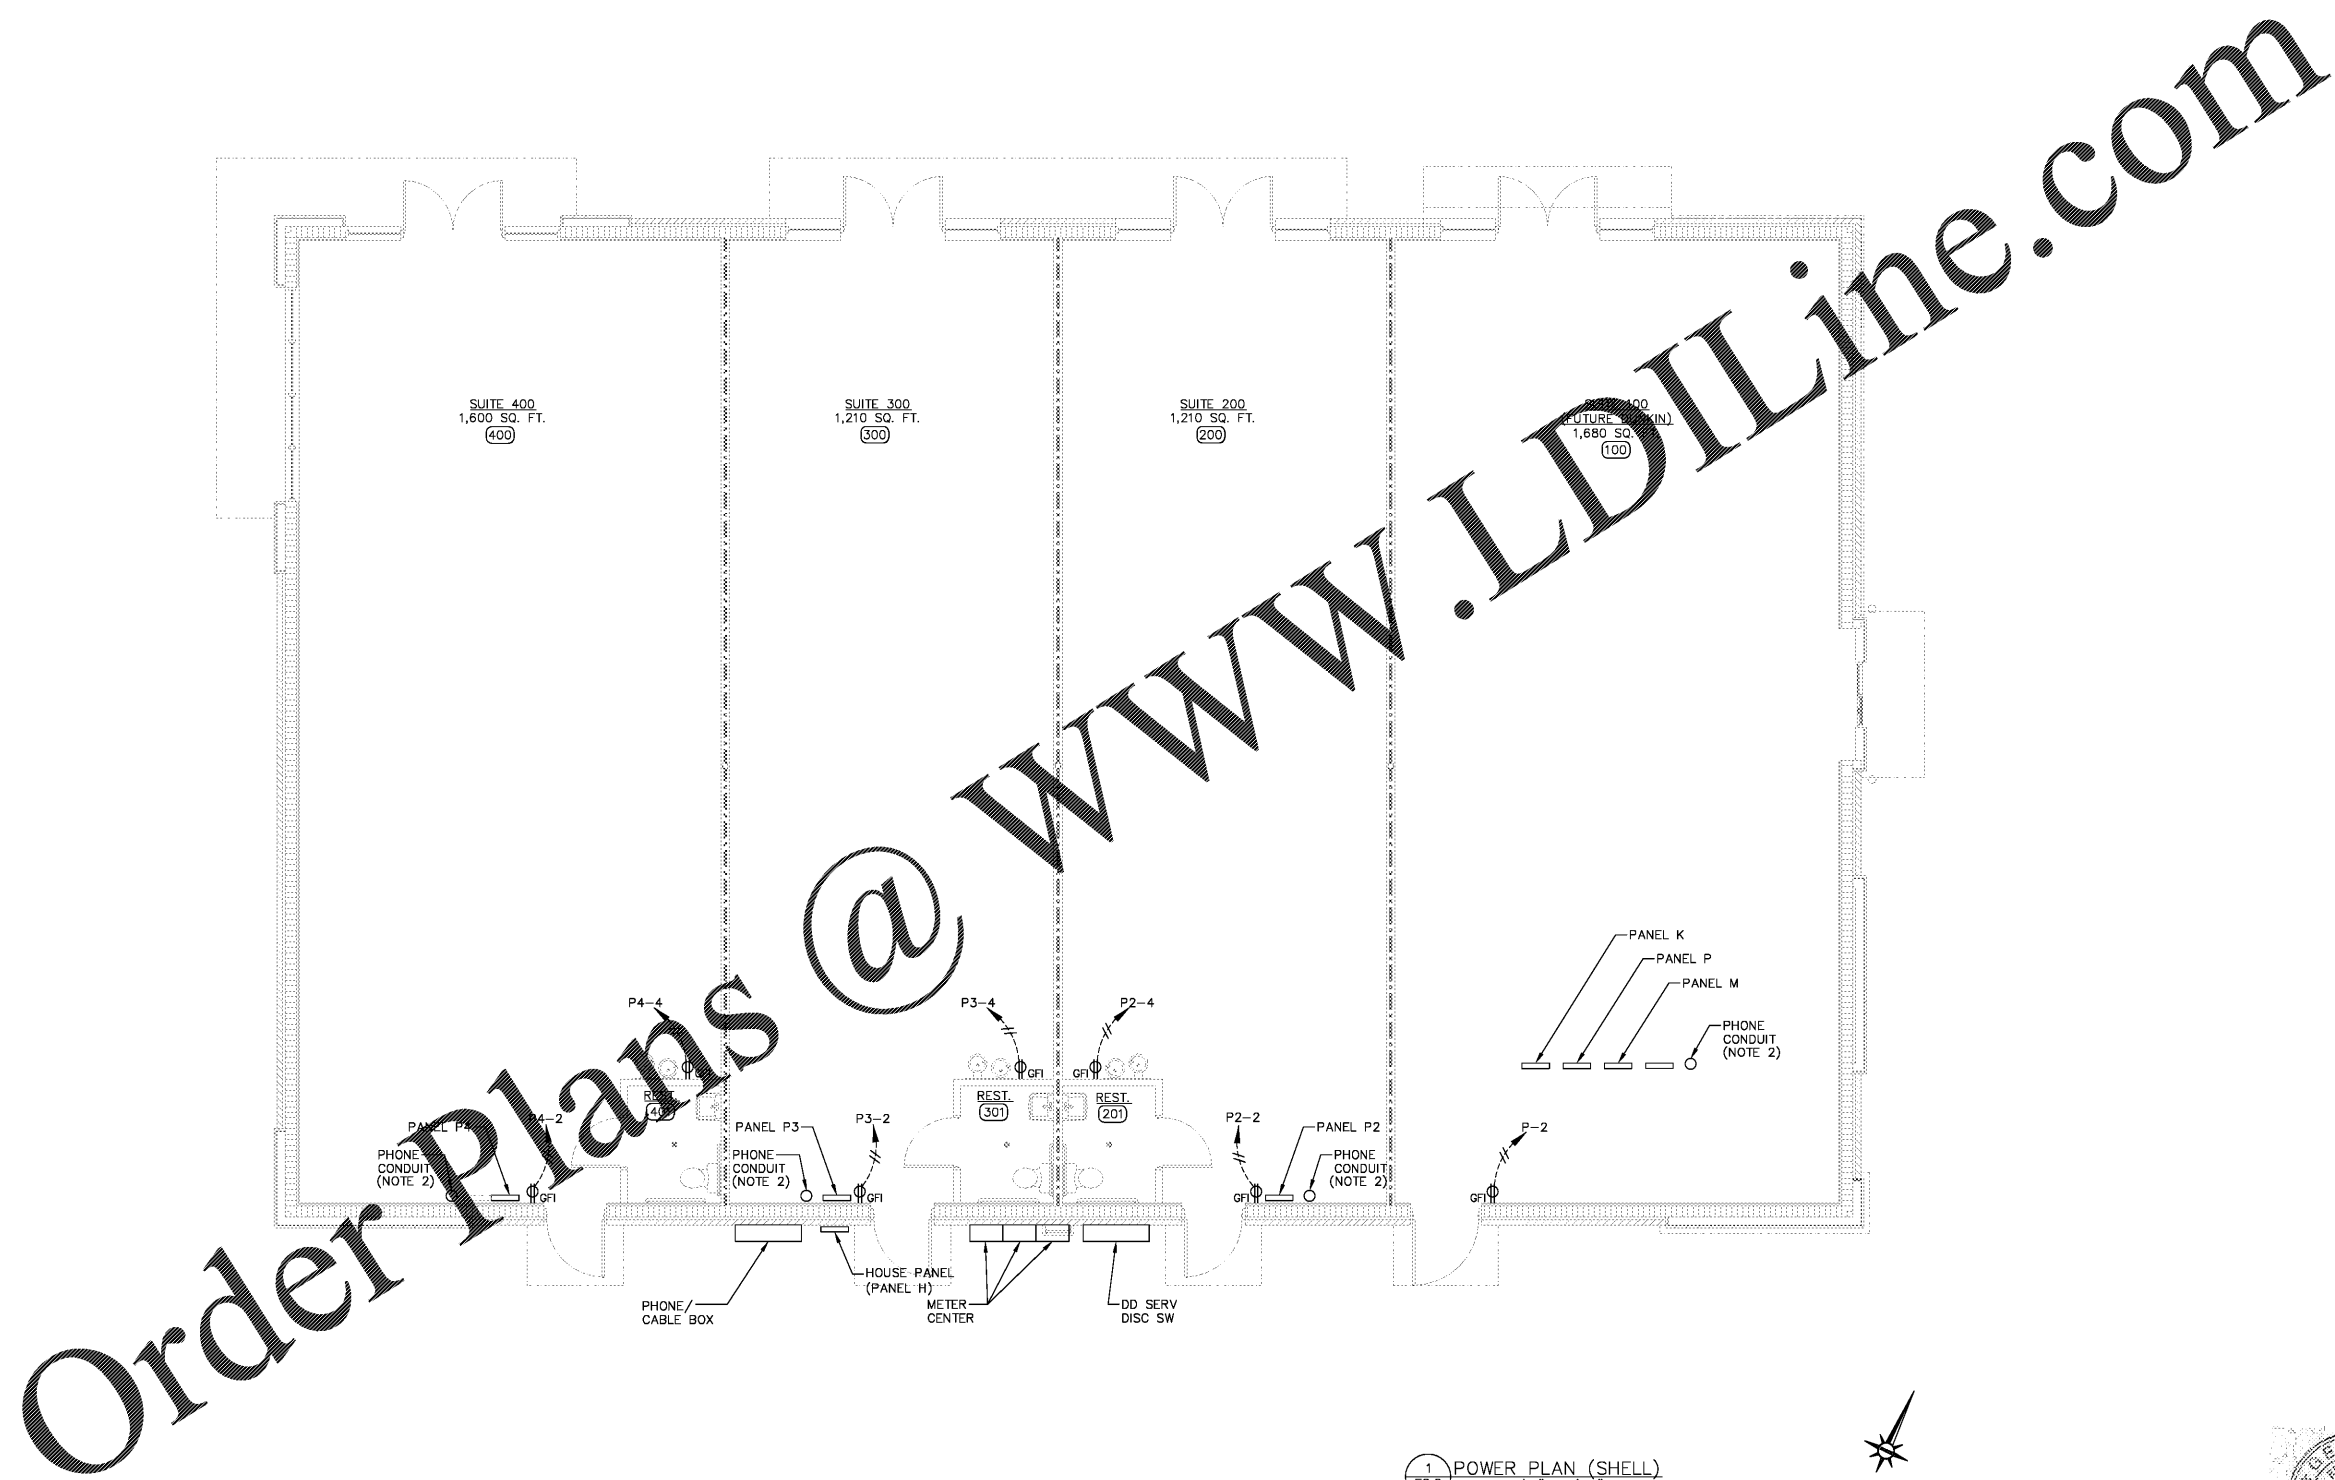

CLIFFORD LUSK, PE
ELECTRICAL ENGINEER
OFFICE: 803-652-7220
CELL: 803-645-3495
EMAIL: CLUSKPE@AOL.COM

SHELL DESIGN

DESIGN BY:	COL
CHECKED BY:	
DATE:	JANUARY 13, 2021
REVISIONS:	

JOB NO: 2052-A
SHEET NO:

E2.0