


NOTES:

1. REFER TO DRAWING E-3.0 FOR GENERAL NOTES AND SPECIFICATIONS.
2. PROVIDE MAINTENANCE RECEPTACLE WITHIN 25 FEET OF ALL HVAC EQUIPMENT PER NEC 210.63.
3. DIMENSIONS ARE FOR REFERENCE ONLY. COORDINATE FINAL LOCATION WITH GC AND/OR OWNER PRIOR TO ROUGH-IN.
4. UNLESS OTHERWISE NOTED, HOME RUNS FOR ALL 15 AND 20 AMP BRANCH CIRCUITS LONGER THEN 75 FEET SHALL BE AT LEAST 10 AWG.

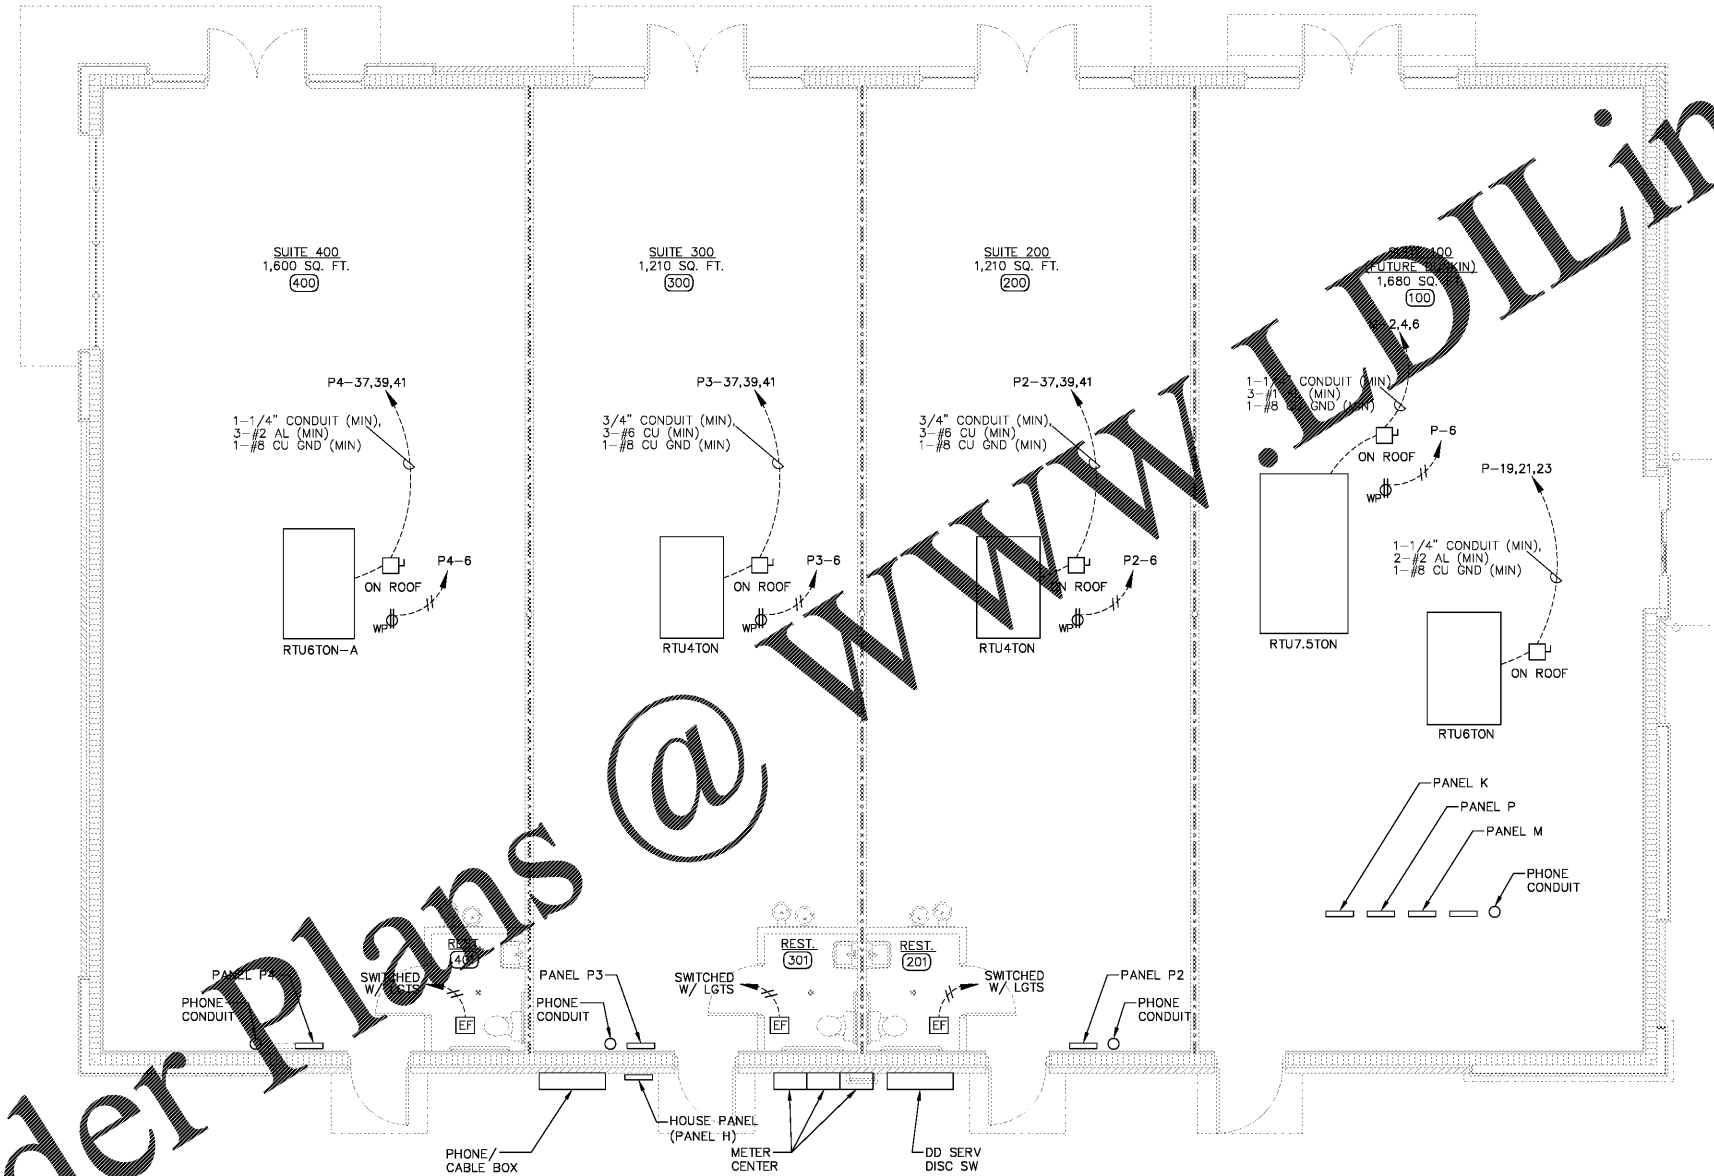

Order Plans @ WWW.IDIline.com


1 MECH POWER PLAN (SHELL)
E2.1 SCALE: 3/16" = 1'-0"



CLIFFORD LUSK, PE
ELECTRICAL ENGINEER
OFFICE: 803-652-7220
CELL: 803-645-3495
EMAIL: CLUSKPE@AOL.COM

SHELL DESIGN

ARCHITECTS
Christopher Booker & Associates, PC



PROPOSED BUILDING SHELL &
DUNKIN' DONUTS PC# 362912
APS INVESTMENT, INC.
5303 WRIGHTSBORO ROAD
GROVETOWN, GEORGIA 30813

MECH POWER PLAN

DESIGN BY:	CL
CHECKED BY:	
DATE:	JANUARY 13, 2021
REVISIONS:	

JOB NO: 2052-A
SHEET NO:

E2.1

670 BROAD STREET, AUGUSTA, GA 30901 | P: (706) 798-6792 | WWW.CBAARCHITECTSPC.COM