

bai - ARCHITECTS

778 Thimble Road - Raleigh, North Carolina 27607 - p:919.859.7003 - f:919.859.7121 - bai-architects.com
THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLISHED.
IF THESE PLANS AND SPECIFICATIONS ARE USED FOR ANY OTHER PROJECT, THE USER SHALL BE RESPONSIBLE FOR OBTAINING THE NECESSARY
VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE A BREACH OF THE ACCEPTANCE OF THESE RESTRICTIONS.

EXCEPT AS INDICATED OTHERWISE, ALL SHOWN ELECTRICAL DEVICES AND CONNECTIONS ARE TO BE REMOVED. WHERE DEVICES MEET THE REQUIREMENTS OF THE NEW PLANS, THEY CAN BE REUSED. CIRCUITS CAN BE REUSED IN SAME GENERAL AREA.

ELECTRICAL CONTRACTOR SHALL REPAIR ANY CUT WIRING IN CONCRETE SLAB AS SOON AS IT IS CUT SO CIRCUIT IS REPAIRED TO PREVENT THE LOSS OF POWER TO ANY PART OF THE STORE.



ALL STUB-UPS BEING ABANDONED SHALL BE CUT AND CAPPED. ALL WIRING SHALL BE REMOVED BACK TO PANEL.

ALL CIRCUITS SHOWN ARE TO BE FIELD VERIFIED. WHERE FOUND TO DIFFER CONTRACTOR SHALL ADJUST ACCORDINGLY.

NOTES:
1. EXISTING CASE TO BE RELOCATED. RELOCATE STUB-UP AS REQUIRED. RELOCATE ALL ASSOCIATED RECEPTACLES, SCALES, ETC. UND. MAINTAIN ALL CONNECTIONS. SEE SHEET E2.0.
2. EXISTING SCALE TO BE RELOCATED. RELOCATE ALL ASSOCIATED ELECTRICAL DEVICES AND CONNECTIONS. SEE SHEET E2.0.
3. EXISTING FLOOR RECEPTACLE CONNECTION. RELOCATE AS REQUIRED FOR NEW SHELVING ARRANGEMENT. SEE SHEET E2.0.

NO.	DATE	REVISIONS
	06/03/20	ISSUE PLAN APPROVED FOR BIDDING/CONSTRUCTION
	07/17/20	RELEASED FOR BIDDING/CONSTRUCTION

INTERIOR RENOVATION FOR
STORE # 182 AT
WALKERTOWN COMMONS
SHOPPING CENTER
5180 Piedville Road
Walkertown, North Carolina 27051

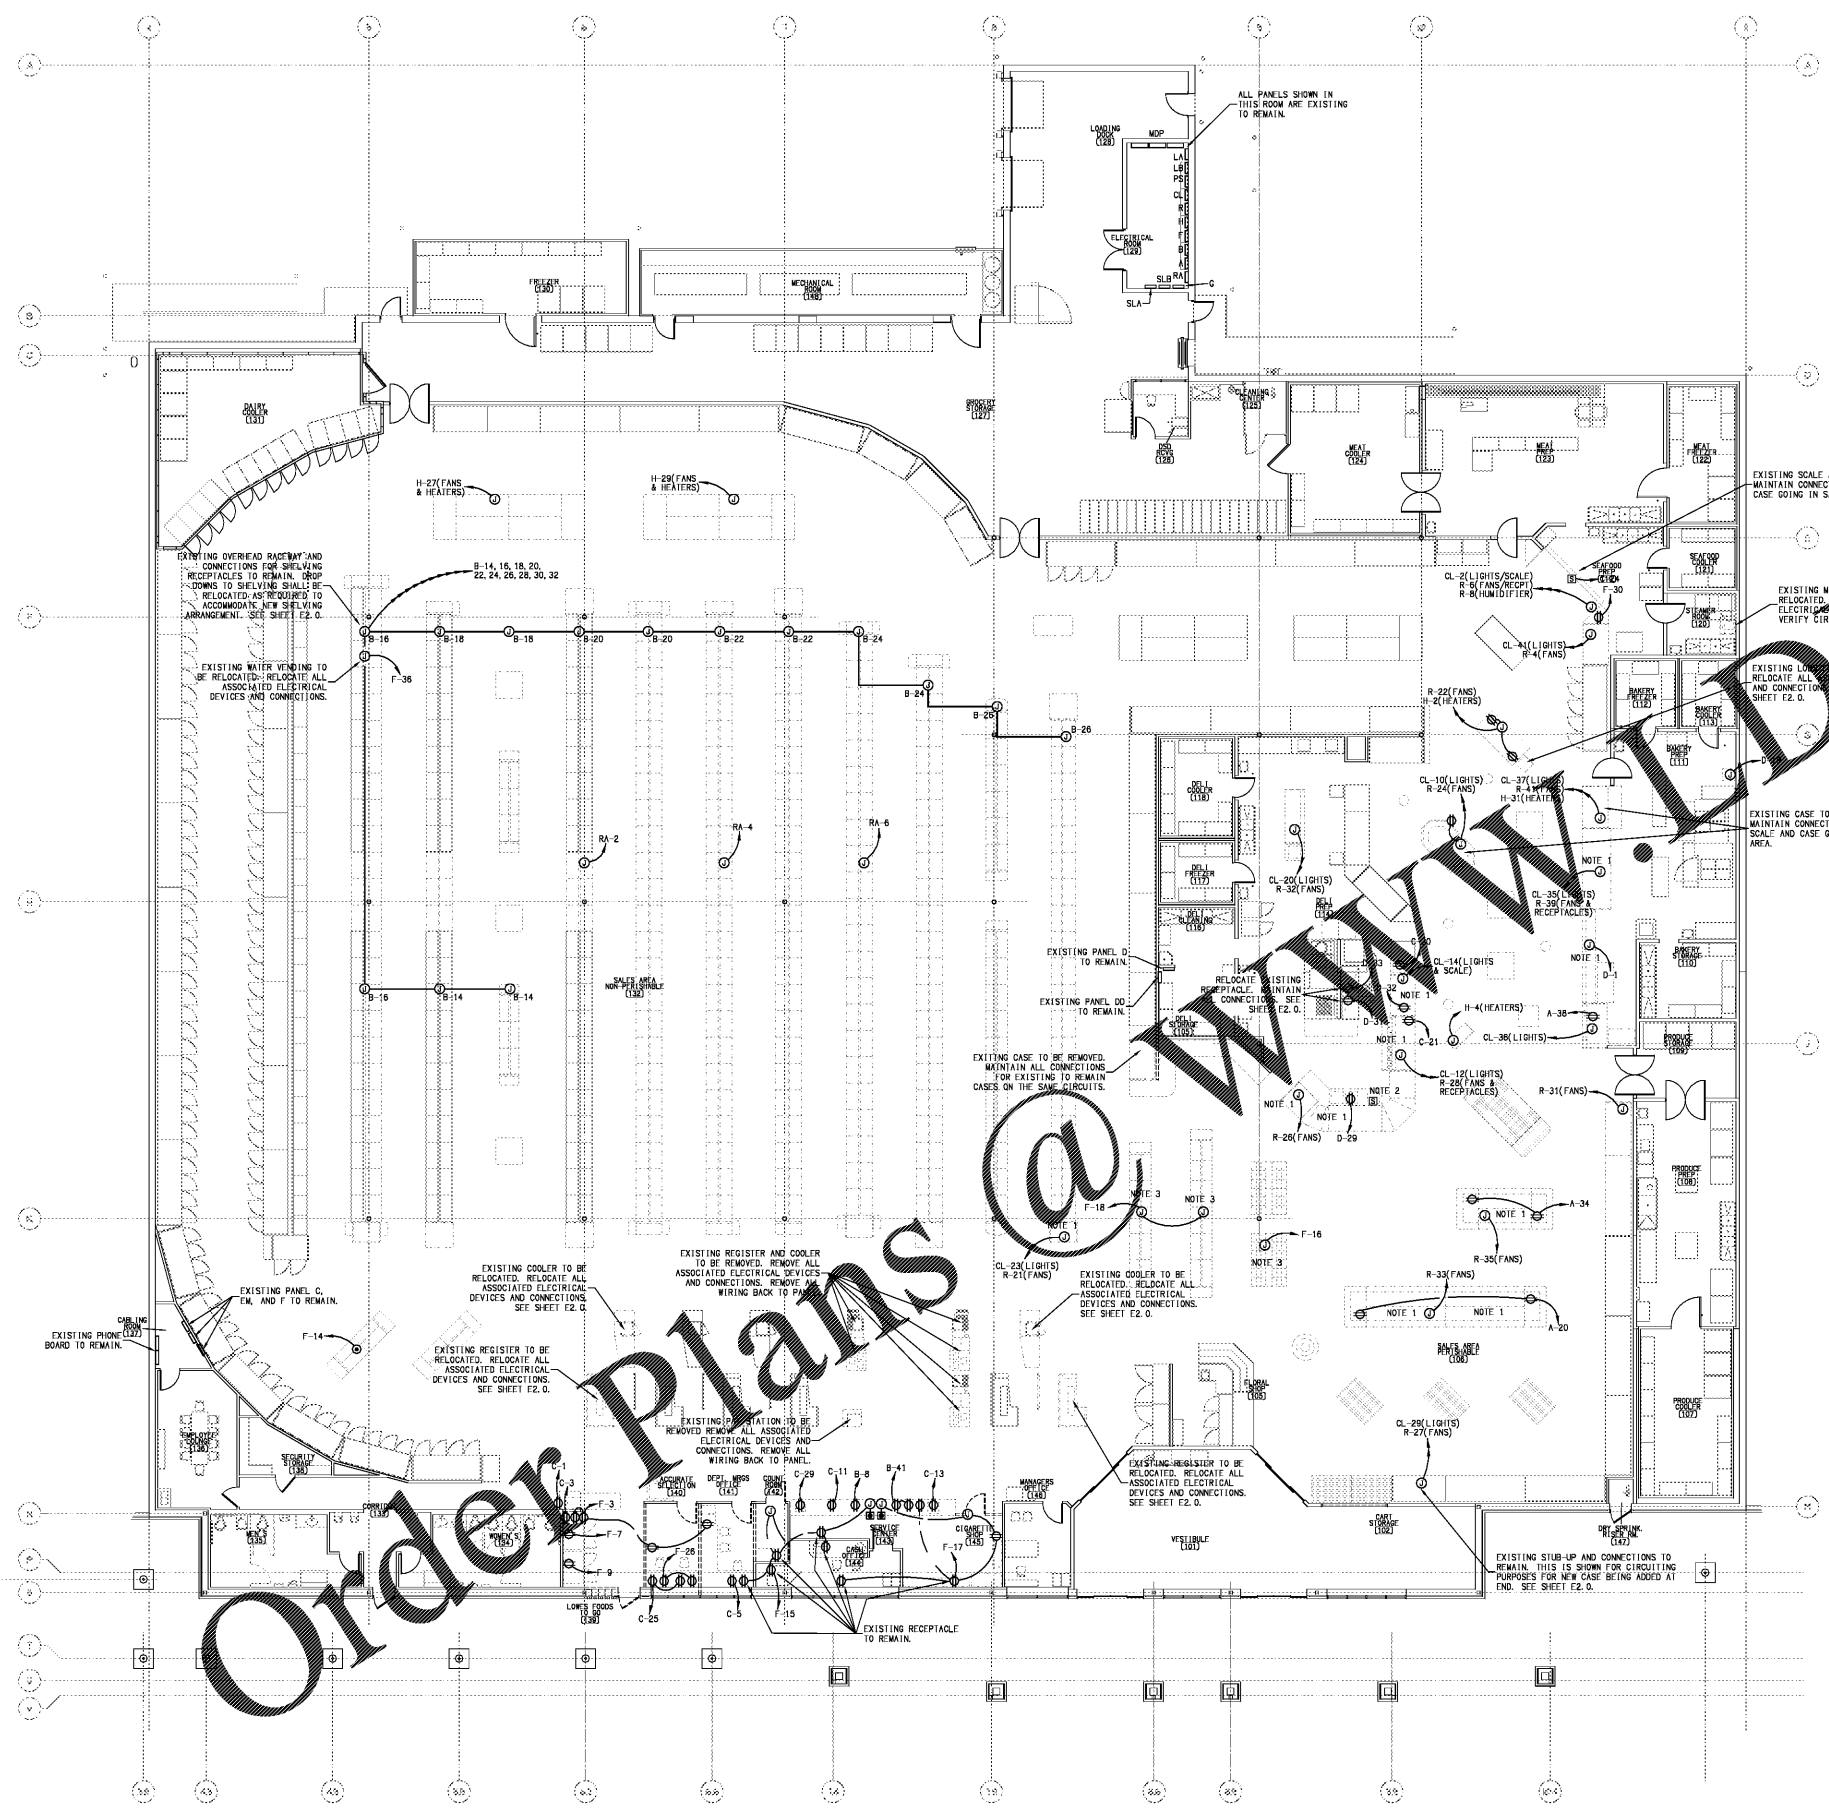

POWER PLAN - DEMOLITION
SCALE: 3/32" = 1'-0"