


**MECHANICAL KEY NOTES (X):**

- 1 6e OUTSIDE AIR DUCT DOWN TO MIXED AIR PLENUM. PROVIDE MOD AND MVD IN VERTICAL.
- 2 8e OUTSIDE AIR DUCT DOWN TO MIXED AIR PLENUM. PROVIDE MOD AND MVD IN VERTICAL.
- 3 10e OUTSIDE AIR DUCT DOWN TO MIXED AIR PLENUM. PROVIDE MOD AND MVD IN VERTICAL.
- 4 1 1/2" COND DN TO MOP SINK. TERMINATE WITH AIR GAP. ATTACH TO WALL IN MIN. 3 LOCATIONS.
- 5 14" DIA. EXHAUST DUCT UP TO RELIEF HOOD ON ROOF.

JOB NUMBER: 19221  
CHECKED BY: Checker

PLANNING  
ARCHITECTURE  
INTERIORS

**CALBERT**  
DESIGN GROUP

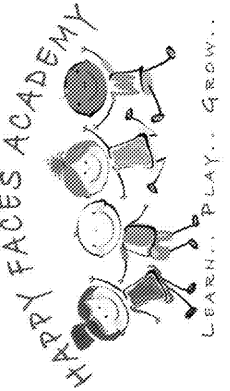



PROJECT LOCATION:  
2865 WEBB ROAD  
MILTON, GA 30004

REVISIONS		
NO	DATE	DESCRIPTION


FLOOR PLAN -  
MECHANICAL

**M1.1**

DATE 10/20/20



THOMPSON EHLE CO.  
50 TECHNOLOGY PKWY  
PEACHTREE CORNERS, GA 30092  
Tel 404.266.1400  
TEC #22021

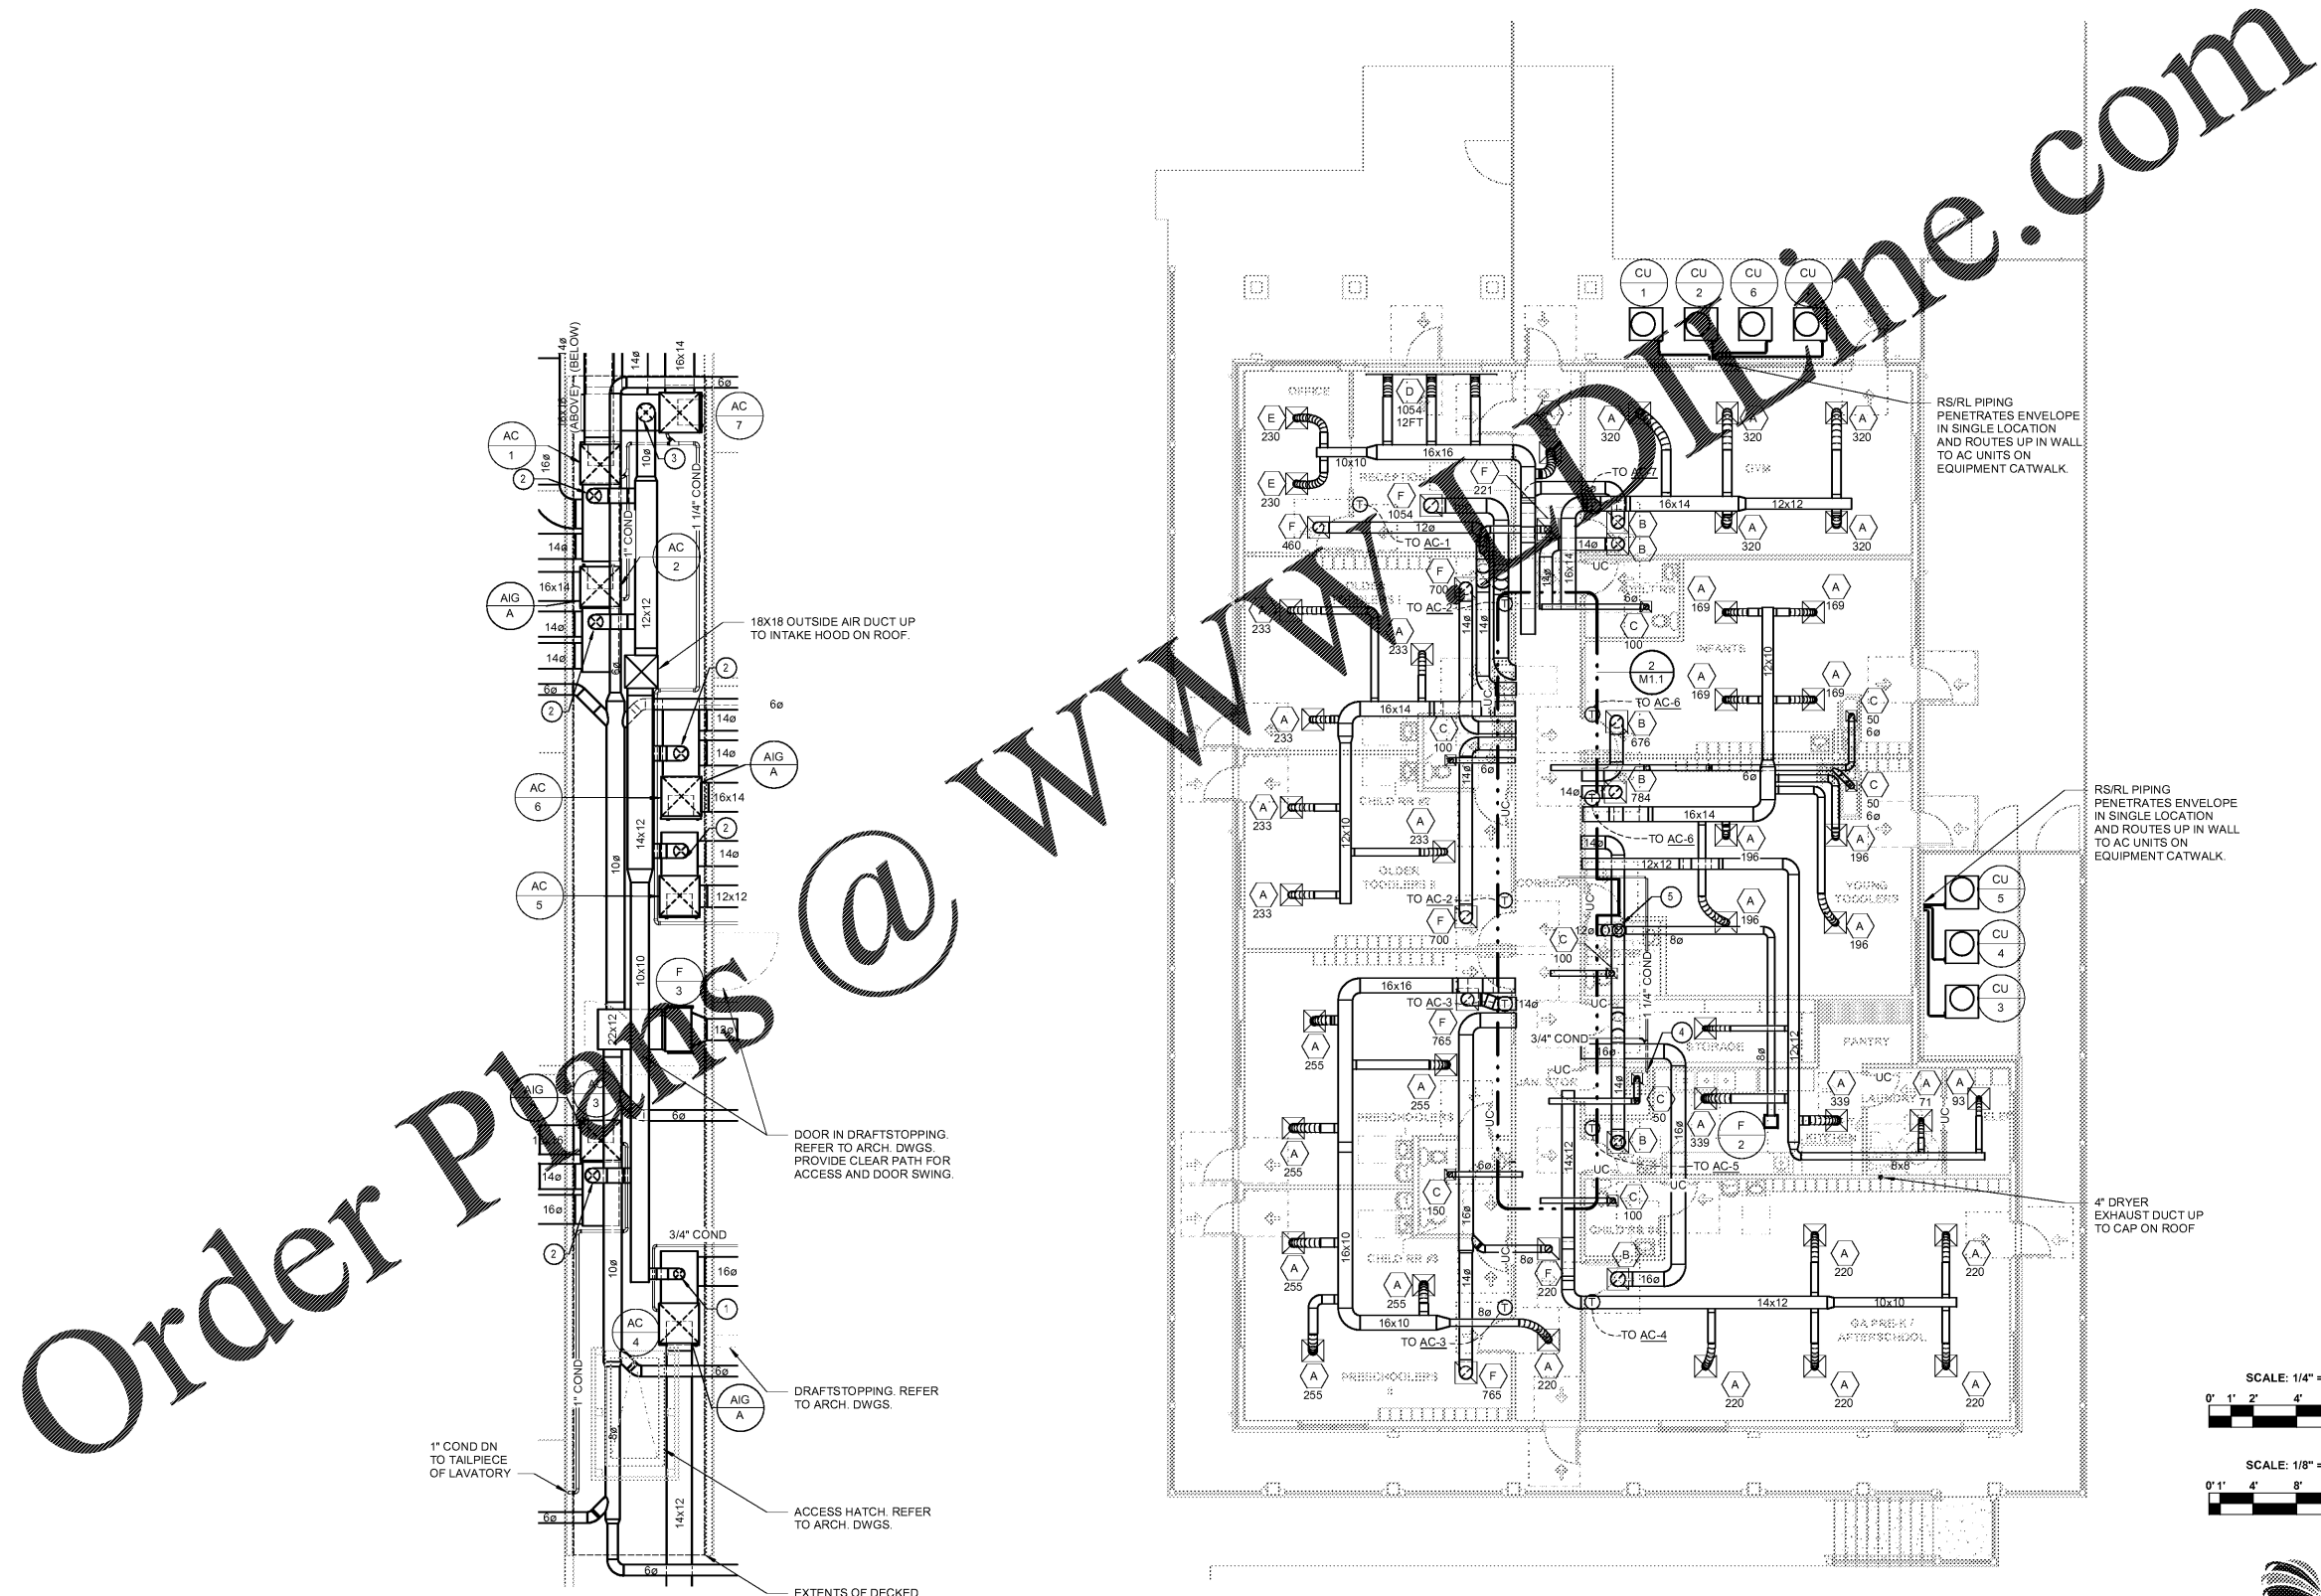

**2 ENLARGED CATWALK PLAN - MECHANICAL**  
1/4" = 1'-0"

**1 FLOOR PLAN - MECHANICAL**  
1/8" = 1'-0"

Order Plans @ WWW.DLINE.COM