


Order Plans @ WWW.WWLDIline.com

JOB NUMBER: 19221
 CHECKED BY: Checker

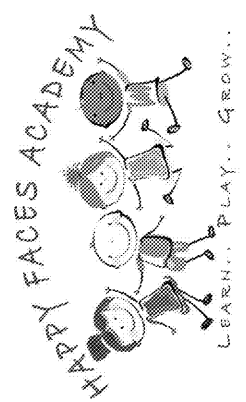

LIGHTING FIXTURE SCHEDULE									
TAG	DESCRIPTION	MANUFACTURER	MODEL	LAMP	WATTAGE	VOLTAGE	MOUNTING	NOTES	
A1	2X4 FIXTURE WITH ELECTRONIC DRIVER 0-10V DIMMING	METALUX	24GR-LD5-38-F1-UNV-L835-CD1-U OR EQUAL	LED	31W	120 V	GRID		
A1X	2X4 FIXTURE WITH ELECTRONIC DRIVER AND 90 MINUTE EMERGENCY BATTERY BACKUP 0-10V DIMMING	METALUX	24GR-LD5-38-F1-UNV-EL14W-L835-CD1-8 OR EQUAL	LED	31W	120 V	GRID		
BSX	1' X 4' FIXTURE WITH ELECTRONIC BALLAST AND 90 MINUTE EMERGENCY BATTERY BALLAST 0-10V DIMMING	METALUX	#WLEED-LD4-40SL-F-UNV-EL14W-L830-CD1-U OR EQUAL	LED	36W	120 V	SURFACE		
BX	8" RECESSED DOWNLIGHT AND 90 MINUTE EMERGENCY BATTERY BACKUP WET LOCATION 0-10V DIMMING	GOTHAM	EVO-30/30-8-DFR-120-ELR OR EQUAL	LED	50W	120 V	RECESSED		
DI	8" RECESSED DOWNLIGHT 0-10V DIMMING	GOTHAM	EVO-30/30-8-DFD-120-EZ10 OR EQUAL	LED	50W	120 V	RECESSED		
DIX	8" RECESSED DOWNLIGHT AND 90 MINUTE EMERGENCY BATTERY BACKUP 0-10V DIMMING	GOTHAM	EVO-30/30-8-DFD-120-EZ10-ELR OR EQUAL	LED	50W	120 V	RECESSED		
F1	ATTIC LIGHT 1'X4' FIXTURE	METALUX: AP SERIES	2WPLD2040R OR EQUAL	LED	24W	120 V	SURFACE		
F1X	ATTIC LIGHT 1'X4' FIXTURE AND 90 MINUTE EMERGENCY BATTERY BACKUP	METALUX: AP SERIES	2WPLD2040R-EL14W OR EQUAL	LED	24W	120 V	SURFACE		
TX	EMERGENCY DOUBLE HEAD FIXTURE WITH 90 MINUTE BATTERY BACKUP	EATON	AP2SOLE	LED	1.8W	120 V	SURFACE		
X	LED EXIT SIGN WITH 90 MINUTE BATTERY BACKUP PROVIDE DIRECTIONAL CHEVRON AND FACES AS INDICATED ON DRAWINGS.	MULE LIGHTING	#SQC-LED-U-G-WW-REM OR EQUAL	LED	5W	120 V	SURFACE		

LIGHTING RELAY PANEL					
RELAY NUMBER	ZONE DESIGNATION	ZONE DESCRIPTION	TOTAL WATTAGE	PANEL	CIRCUIT NUMBER
1	1	DI, DIX - CORRIDOR	550 VA	A	7
2	2	BX - EXTERIOR SOFFIT	650 VA	A	8

ELEC - HEATING EQUIPMENT SCHEDULE												
TYPE	UNIT DESCRIPTION	HEATER W	HP	FLA	TOTAL VA	VOLTAGE	POLES	PANEL	CIRCUIT NUMBER	CIRCUIT DESCRIPTION	DISCONNECT	NOTES
EW-1	WATER HEATER	24 W	0.0	0.0 A	24 VA	120 V	1					
HWRP-1	HOT WATER RECIRC PUMP	0 W	0.0	0.0 A	0 VA	0 V	1					

ELEC - MECHANICAL EQUIPMENT SCHEDULE - AC												
TYPE	UNIT NUMBER	HEATER W	HP	FLA	TOTAL VA	VOLTAGE	POLES	PANEL	CIRCUIT NUMBER	CIRCUIT DESCRIPTION	DISCONNECT	NOTES
AC	1	0 W	0.0	0.0 A	10816 VA	208 V	3					
AC	2	0 W	0.0	0.0 A	10816 VA	208 V	3					
AC	3	0 W	0.0	0.0 A	10816 VA	208 V	3					
AC	4	0 W	0.0	0.0 A	10816 VA	208 V	3					
AC	5	0 W	0.0	0.0 A	10816 VA	208 V	3					
AC	6	0 W	0.0	0.0 A	10816 VA	208 V	3					
AC	7	0 W	0.0	0.0 A	10816 VA	208 V	3					

ELEC - MECHANICAL EQUIPMENT SCHEDULE - CU												
TYPE	UNIT NUMBER	HEATER W	HP	FLA	TOTAL VA	VOLTAGE	POLES	PANEL	CIRCUIT NUMBER	CIRCUIT DESCRIPTION	DISCONNECT	NOTES
CU	1	0 W	18.2 A	4368 VA	480 V	2				2#8, 1#10G, 3/4"	60/2/3R	
CU	2	0 W	18.2 A	4368 VA	480 V	2				2#8, 1#10G, 3/4"	60/2/3R	
CU	3	0 W	18.2 A	4368 VA	480 V	2				2#8, 1#10G, 3/4"	60/2/3R	
CU	4	0 W	18.2 A	4368 VA	480 V	2				2#8, 1#10G, 3/4"	60/2/3R	
CU	5	0 W	18.2 A	4368 VA	480 V	2				2#8, 1#10G, 3/4"	60/2/3R	
CU	6	0 W	18.2 A	4368 VA	480 V	2				2#8, 1#10G, 3/4"	60/2/3R	
CU	7	0 W	18.2 A	4368 VA	480 V	2				2#8, 1#10G, 3/4"	60/2/3R	

ELEC - MECHANICAL EQUIPMENT SCHEDULE - FANS												
TYPE	UNIT NUMBER	HEATER W	HP	FLA	TOTAL VA	VOLTAGE	POLES	PANEL	CIRCUIT NUMBER	CIRCUIT DESCRIPTION	DISCONNECT	NOTES
F	2	0 W	0.0	0.0 A	0 VA	0 V	1					
F	3	0 W	0.0	0.0 A	0 VA	120 V	1					

PROJECT LOCATION:
 2865 WEBB ROAD
 MILTON, GA 30004

REVISIONS		
NO	DATE:	DESCRIPTION:

THOMPSON EHLE CO.
 50 TECHNOLOGY PKWY
 PEACHTREE CORNERS, GA 30092
 Tel: 404-266-1400
 TEC #22021

SCHEDULES AND COMCHECK - ELECTRICAL
E0.3
 DATE 10/21/20