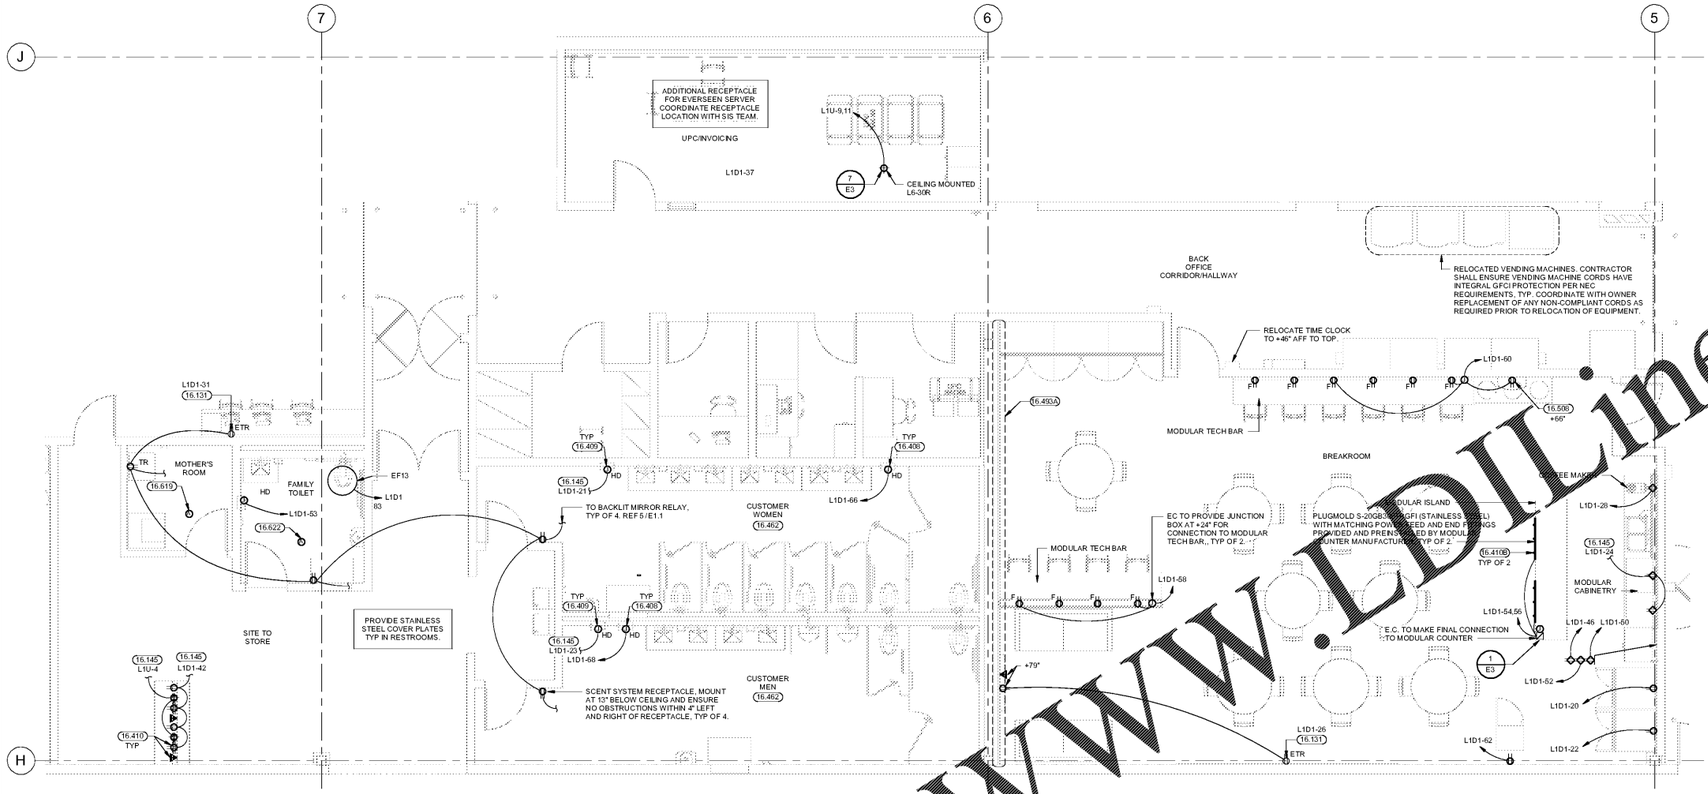

KEYNOTES

16.131	CONNECT TO EXISTING CIRCUIT.
16.145	CONNECT CIRCUIT(S) TO EXISTING BRANCH CIRCUITRY. MINIMUM WIRE SIZE AND PANELBOARD CIRCUIT ARE NOTED. VERIFY SIZE, RATING AND CONDITION OF EXISTING BRANCH CIRCUIT CONDUIT AND WIRE PRIOR TO USE TO ENSURE THAT THEY MEET REQUIRED SIZE, AND ALL U.L. RATINGS AND REPLACE AS REQUIRED.
16.249	E.C. TO PROVIDE MAINTENANCE RECEPTACLE. ROUTE CIRCUIT TO NEAREST RTU RECEPTACLE.
16.408	NEW HAND DRYER: REFER TO ARCHITECTURAL DETAILS AND MANUFACTURER'S INSTRUCTIONS FOR ROUGH-IN AND MOUNTING REQUIREMENTS.
16.409	HAND DRYER TO BE REPLACED: REFER TO ARCHITECTURAL DETAILS AND MANUFACTURER'S INSTRUCTIONS FOR ROUGH-IN AND MOUNTING REQUIREMENTS.
16.410	COUNTER MOUNTED DEVICES: STUB OUT OF WALL AT +8". ROUTE FLEXIBLE METAL CONDUITS ALONG BACK WALL OF CABINET. MOUNT DEVICES WITHIN CABINET AT +8", UNLESS NOTED OTHERWISE. EACH DATA BOX IS TO HAVE A SEPARATE CONDUIT ROUTED TO 12" ABOVE ACCESSIBLE CEILING SPACE. VERIFY LOCATIONS PRIOR TO INSTALLATION.
16.410B	COUNTER MOUNTED DEVICES: ROUTE BRANCH CIRCUITRY THROUGH OWNER FURNISHED BLANK POWER POLE. ROUTE FLEXIBLE METAL CONDUITS ALONG INSIDE BACK WALL OF CABINET.
16.488	EXISTING OFFICE AREAS AND/OR RESTROOMS, WILL BE REFURBISHED BY OTHERS. REMOVE ALL ELECTRICAL ITEMS FROM WALLS AND CEILING, INCLUDING HAND DRYERS, RECEPTACLES, SWITCHES, AND LIGHTING FIXTURES AS REQUIRED. INSTALL AND RECONNECT AFTER NEW FINISHES ARE IN PLACE. COORDINATE EXTENT OF WORK WITH GENERAL CONTRACTOR AND WAL-MART CONSTRUCTION MANAGER.
16.489	RELOCATE, EXTEND, AND RECONNECT CIRCUITRY AND ELECTRICAL DEVICES FOR RELOCATED AND/OR NEW EQUIPMENT. VERIFY CONDITION OF BRANCH CIRCUITRY, CONDUIT AND WIRE TO ENSURE THEY MEET ALL U.L. RATINGS AND REPLACE AS REQUIRED. VERIFY FINAL LOCATION OF RELOCATED/NEW EQUIPMENT WITH WALMART CONSTRUCTION MANAGER PRIOR TO ROUGH-IN.
16.492	E.C. SHALL COORDINATE WITH GENERAL CONTRACTOR AND ARCHITECTURAL DEMOLITION PLANS THE EXTENT OF ELECTRICAL DEMOLITION. REMOVE UNUSED DEVICES, BOXES, CONDUITS, AND WIRING BACK TO ORIGINATING JUNCTION BOXES OR PANELBOARDS. REFERENCE POWER PLANS FOR CIRCUITRY TO BE REUSED. DEMOLITION SHALL NOT AFFECT ACTIVE CIRCUITS. IF CIRCUIT IS DEMOLISHED ALL THE WAY TO PANELBOARD, REMOVE CIRCUIT BREAKER AND REPLACE WITH FILLER PLATE. UPDATE TYPEWRITTEN CIRCUIT DIRECTORY IDENTIFYING CIRCUIT AS "SPACE". COORDINATE EXACT REQUIREMENTS WITH EXISTING CONDITIONS PRIOR TO BID.
16.493A	WALL FINISH TO BE REPLACED. REMOVE AND REINSTALL ELECTRICAL DEVICES AND VOICE/DATA OUTLETS AS REQUIRED FOR INSTALLATION OF NEW WALL FINISH. UTILIZE UL LISTED BOX EXTENDERS AS REQUIRED TO ENSURE COMPLIANT INSTALLATION. RECEPTACLES SHALL BE REPLACED WITH NEW WHITE DEVICES. PROVIDE NEW WHITE COVERPLATES FOR ELECTRICAL AND VOICE/DATA DEVICES. IF SURFACE MOUNTED CONDUIT/DEVICES ARE ENCOUNTERED REPLACE WITH CONCEALED CONDUIT AND FLUSH MOUNTED DEVICES TO SLAT WALL BACKING BOARD.
16.508	INSECT CONTROL. PROVIDE BROWN DEVICE AND MATCHING COVERPLATE.
16.619	PROVIDE RECESSED ALARM JUNCTION BOX IN CEILING WITH 4"x4"x1-1/2" EXTENSION RING WITH RACEWAY ROUTED TO NEAREST ACCESSIBLE CEILING SPACE.
16.622	PROVIDE RECESSED 4"x4"x1-1/2" ALARM JUNCTION BOX (WITH VERTICAL RACEWAY) AT +46" WITH 4"x4"x1-1/2" EXTENSION RING AND 4"x4" TWO-GANG DEVICE RING.

Order Plans @ WWW.LDILine.com

4 BREAKROOM/RESTROOM POWER PLAN
1/4" = 1'-0"

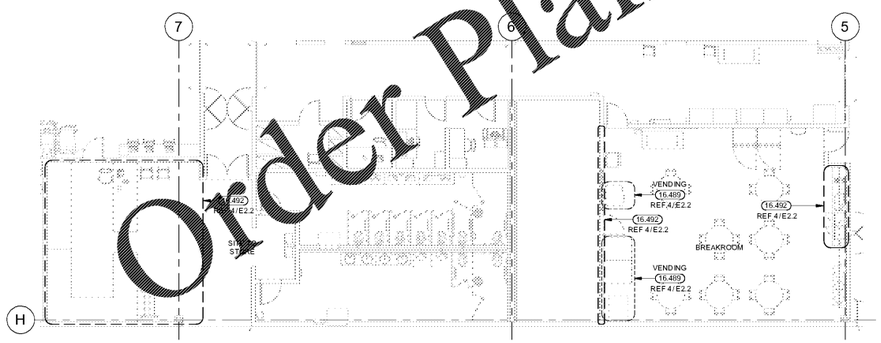

3 BREAKROOM/RESTROOM POWER DEMO PLAN
1/8" = 1'-0"

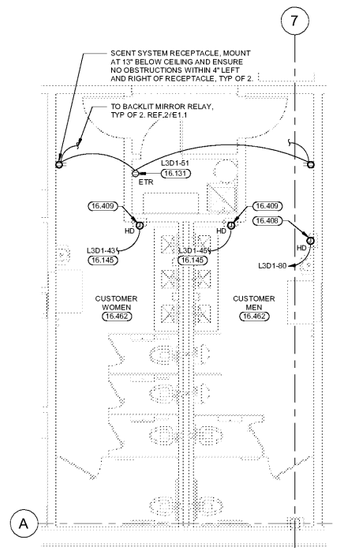

2 FRONT RESTROOM POWER PLAN
1/4" = 1'-0"

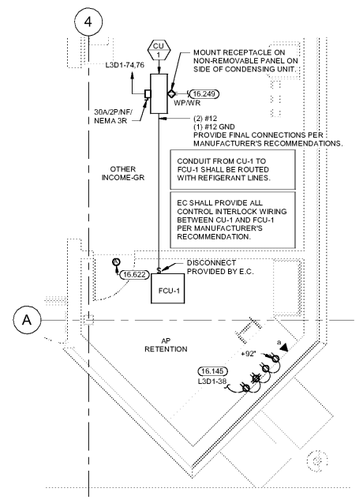

1 AP OFFICE POWER PLAN
1/4" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

STIPULATION FOR REUSE
THESE DRAWINGS AND SPECIFICATIONS ARE AND SHALL REMAIN THE PROPERTY OF HENDERSON ENGINEERS AND ARE NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT OR EXTENSION OF THIS PROJECT OR TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT THE EXPRESS WRITTEN CONSENT OF HENDERSON ENGINEERS. ALL REPRODUCTIONS OF THESE DRAWINGS AND SPECIFICATIONS MUST BEAR THIS NOTICE IN FULL.

CONSULTANTS
HENDERSON ENGINEERS
6360 I-55 NORTH, SUITE 200
JACKSON, MS 39211
TEL: 601-914-5000 FAX: 601-914-5001
WWW.HENDERSONENGINEERS.COM
(16.508)
AL CORPORATE LIC. CA-0166-E
EXPIRES: 12/31/2022

Walmart
PRATTVILLE, AL
1000 COBBS FORD ROAD
STORE NO. 00485-249
2021 MAJOR PROJECT
188
JOB NUMBER: 21800004B3 | PROTO:

ISSUE BLOCK

CHECKED BY:	MM
DRAWN BY:	SB/HDP
PROTO CYCLE:	01/29/21
DOCUMENT DATE:	03/31/21

ALABAMA LICENSED No. 39438-E PROFESSIONAL ENGINEER WILLIAM RAY WINSTON
03/30/2021

ENLARGED POWER PLANS

SHEET: E2.2

WILLIAM R. WINSTON