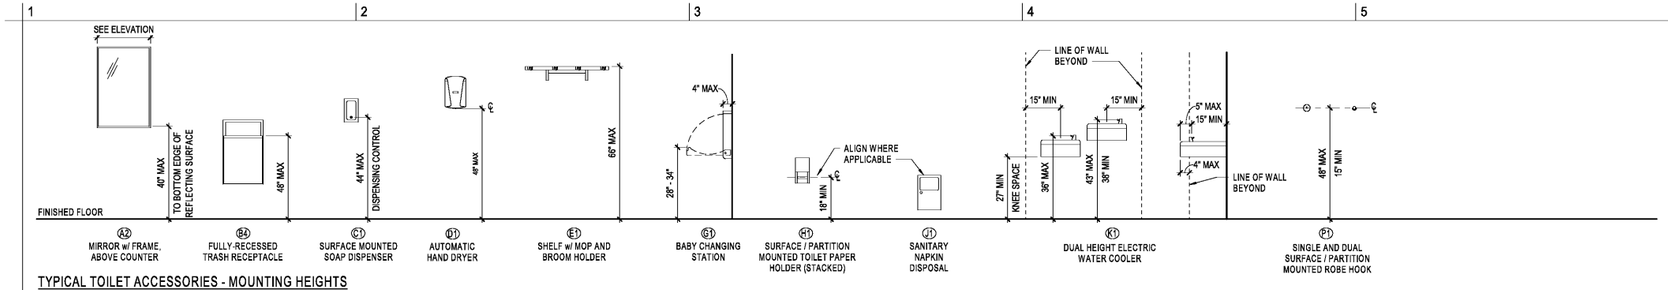

TYPICAL TOILET ACCESSORIES - MOUNTING HEIGHTS

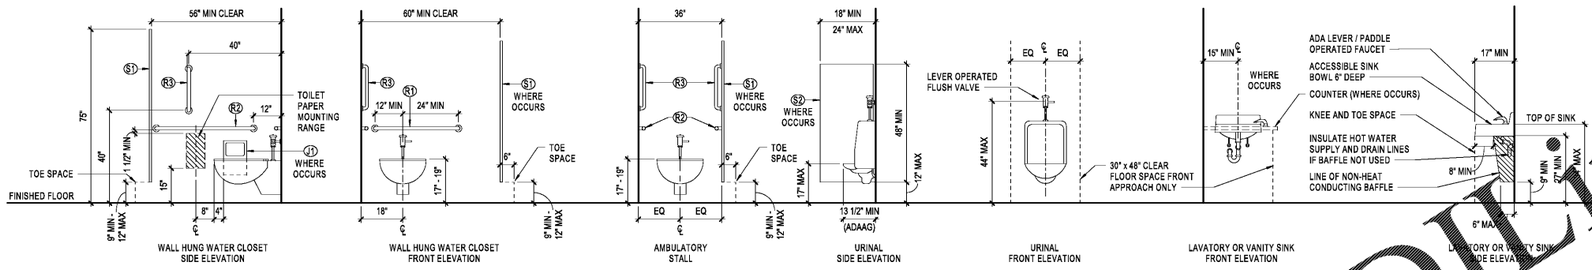

TYPICAL PLUMBING FIXTURES AND ACCESSORIES - MOUNTING HEIGHTS AND REQUIRED CLEARANCES

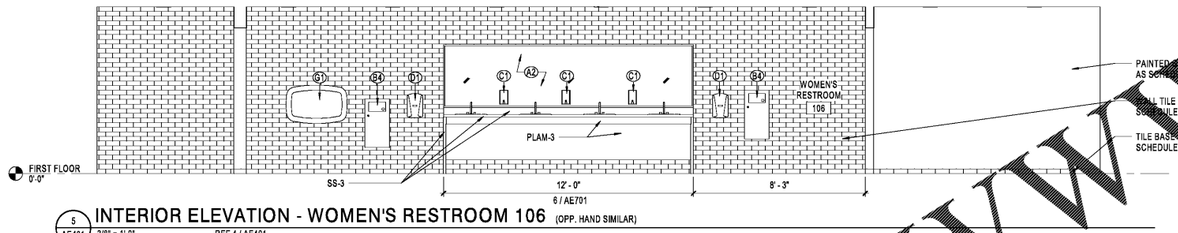

5 AE401 — INTERIOR ELEVATION - WOMEN'S RESTROOM 106 (OPP. HAND SIMILAR)
3/8" = 1'-0" REF 4 / AE401

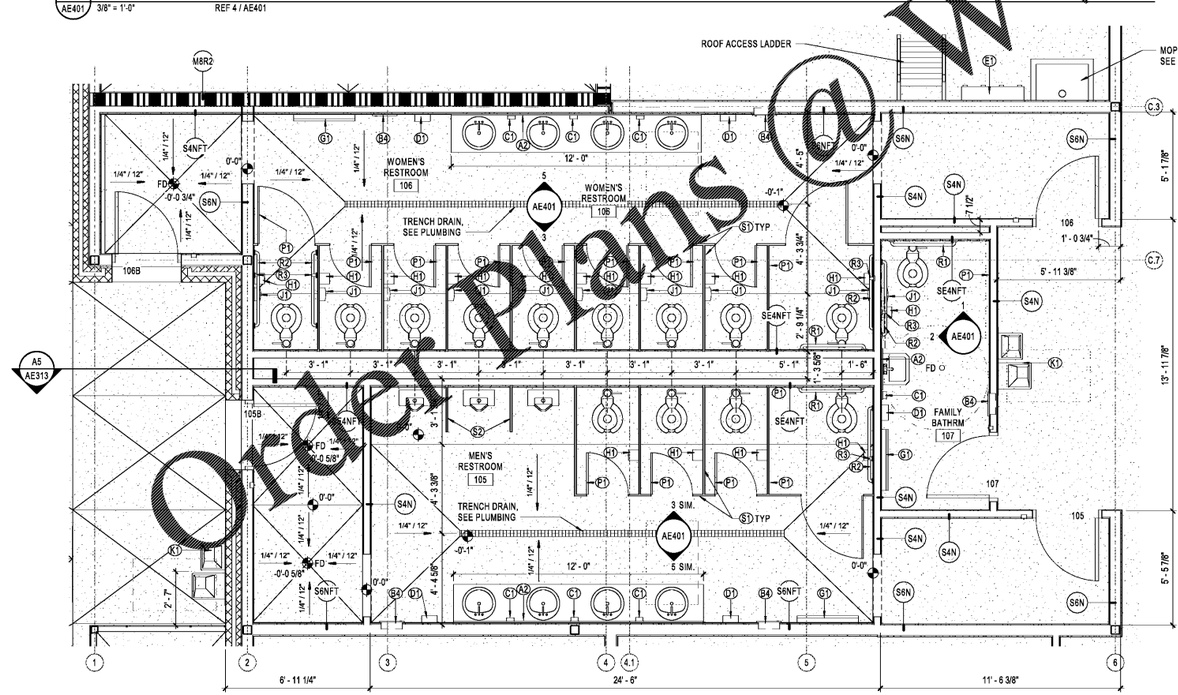

4 AE401 — ENLARGED TOILETS
3/8" = 1'-0" REF 1 / AE101

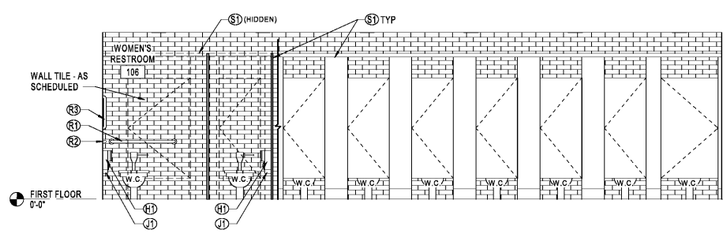

3 AE401 — INTERIOR ELEVATION - WOMEN'S RESTROOM 106 (OPP. HAND SIMILAR)
3/8" = 1'-0" REF 4 / AE401

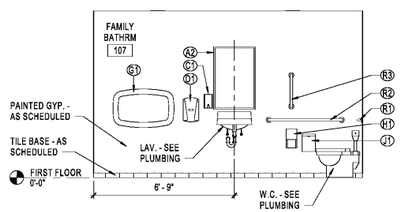

2 AE401 — INTERIOR ELEVATION - FAMILY 107
3/8" = 1'-0" REF 4 / AE401



1 AE401 — INTERIOR ELEVATION - FAMILY 107
3/8" = 1'-0" REF 4 / AE401

1. SEE SPECIFICATIONS FOR ACCESSORY MODELS & SHEET AE401 FOR TYPICAL ACCESSORY MOUNTING HEIGHTS.
2. ALL PARTITIONS ARE TYPE S8N UNLESS OTHERWISE NOTED. REFER TO SHEET AE601 FOR PARTITION TYPE DESCRIPTIONS.
3. REFER TO PLUMBING DRAWINGS FOR LOCATION OF HOSE BIBS.
4. REFER TO RCP SHEETS FOR ALL CEILING HEIGHT & MATERIAL DESIGNATIONS IN TOILET ROOMS.
5. GC TO PROVIDE & INSTALL ALL BLOCKING IN WALLS.
6. REFER TO AE601 FOR DETAILS CALLED OUT ON THIS SHEET.

A2 FULL WIDTH, 3'-0" HIGH, PLATE GLASS MIRROR w/ FRAME AT EDGES (4 POINTS)
B4 FULLY-RECESSED TRASH RECEPTACLE
C1 SURFACE MOUNTED SOAP DISPENSER
D1 ELECTRIC HAND DRYER (SINGLE)
E1 SHELF w/ MOP AND BROOM HOLDER
G1 BABY CHANGING STATION
H1 SURFACE / PARTITION MOUNTED TOILET PAPER HOLDER (SINGLE)
J1 SURFACE MOUNTED SANITARY NAPKIN DISPOSAL
K1 DUAL HEIGHT ELECTRIC WATER COOLER
P1 SURFACE MOUNTED ROBE HOOK
R1 36" GRAB BAR
R2 42" GRAB BAR
R3 18" VERTICAL GRAB BAR
S1 FLOOR MOUNTED, OVERHEAD BRACED TOILET PARTITIONS
S2 24" DEEP WALL HUNG URINAL SCREEN

GENERAL NOTES:

1. * = DENOTES AN ABSOLUTE DIMENSION AND IS INCLUSIVE OF ANY APPLIED FINISHES.
2. ACCESSORY AND FIXTURE MOUNTING HEIGHTS ARE BASED UPON 2010 ADAAG, ANSI A117.1 - 2009 AND 2012 NC BUILDING CODE. IT WILL BE THE RESPONSIBILITY OF THE GC TO ENSURE THAT ALL PLUMBING FIXTURES AND TOILET ROOM ACCESSORIES ARE INSTALLED IN ACCORDANCE WITH THESE GUIDELINES AND CODES.
3. HORIZONTAL GRAB BARS IN TOILET & SHOWERS TO BE MOUNTED SO THAT THE TOP OF THE GRIPPING SURFACE IS AT 33" MIN / 36" MAX AFF.
4. FLUSH CONTROLS SHALL BE LOCATED AT 44" MAX ABOVE FINISHED FLOOR ELEVATION AT WIDE SIDE OF WATER CLOSET.
5. HIGHEST CONTROL, OPERATING MECHANISM OR DISPENSING SLOT OF ALL TOILET ROOM ACCESSORIES SHALL BE 48" MAX ABOVE FINISHED FLOOR.
6. ALL OPERATING MECHANISMS SHALL REQUIRE 5 LB. MAX OPERATING FORCE.
7. PROVIDE BLOCKING AT ALL TOILET PLUMBING FIXTURE AND ACCESSORY LOCATIONS ADEQUATE TO SUPPORT MIN 250 LB. LOAD, UON.
8. OBJECTS WITH LEADING EDGES MORE THAN 27" ABOVE FINISHED FLOOR AND NOT MORE THAN 80" ABOVE FINISHED FLOOR SHALL PROTRUDE 4" MAX HORIZONTALLY INTO THE CIRCULATION PATH.
9. DIAMETER OF THE GRIPPING SURFACE OF A HANDRAIL MUST BE 1 1/4" - 1 1/2". THE SPACE BETWEEN A WALL AND A GRAB BAR MUST BE 1 1/2".

City of Asheville/ Parks & Recreation

DR. WESLEY GRANT SR. CENTER EXPANSION

885 LIVINGSTON STREET
ASHEVILLE, NC 28801

DESIGNER
CLARKNEXSEN
361 COLLEGE STREET, SUITE 300
ASHEVILLE, NORTH CAROLINA 28801
828.252.9808
CLARK NEXSEN LICENSE NUMBER: C-1928

CORPORATE SEAL

CLARK NEXSEN, INC. CERT. NO. C-1928 50680 ASHEVILLE, NC

PROFESSIONAL SEAL

2021.03.15 12:16:36-04'00'

SUBMITTAL
03.12.2021
CONSTRUCTION DOCUMENTS

REVISIONS

KEY PLAN

SHEET
TLT PLANS & TLT ACCESSORY LEGEND

AE401

DESIGN: Designer
DRAWN: Author
REVIEW: Checker

CN 7904-A

Order Plans @ WWW.LDRLine.com

2019/12/31 - 11:54:39 AM
C:\Users\mbeck\Desktop\Archive\AE401_EQUIPMENT AND TOILET ACCESSORIES.rvt