


3/11/2021 4:16:26 PM
C:\Users\johnd\Documents\7904_Southside Facilities M10_john.nesken.rvt

Order Plans

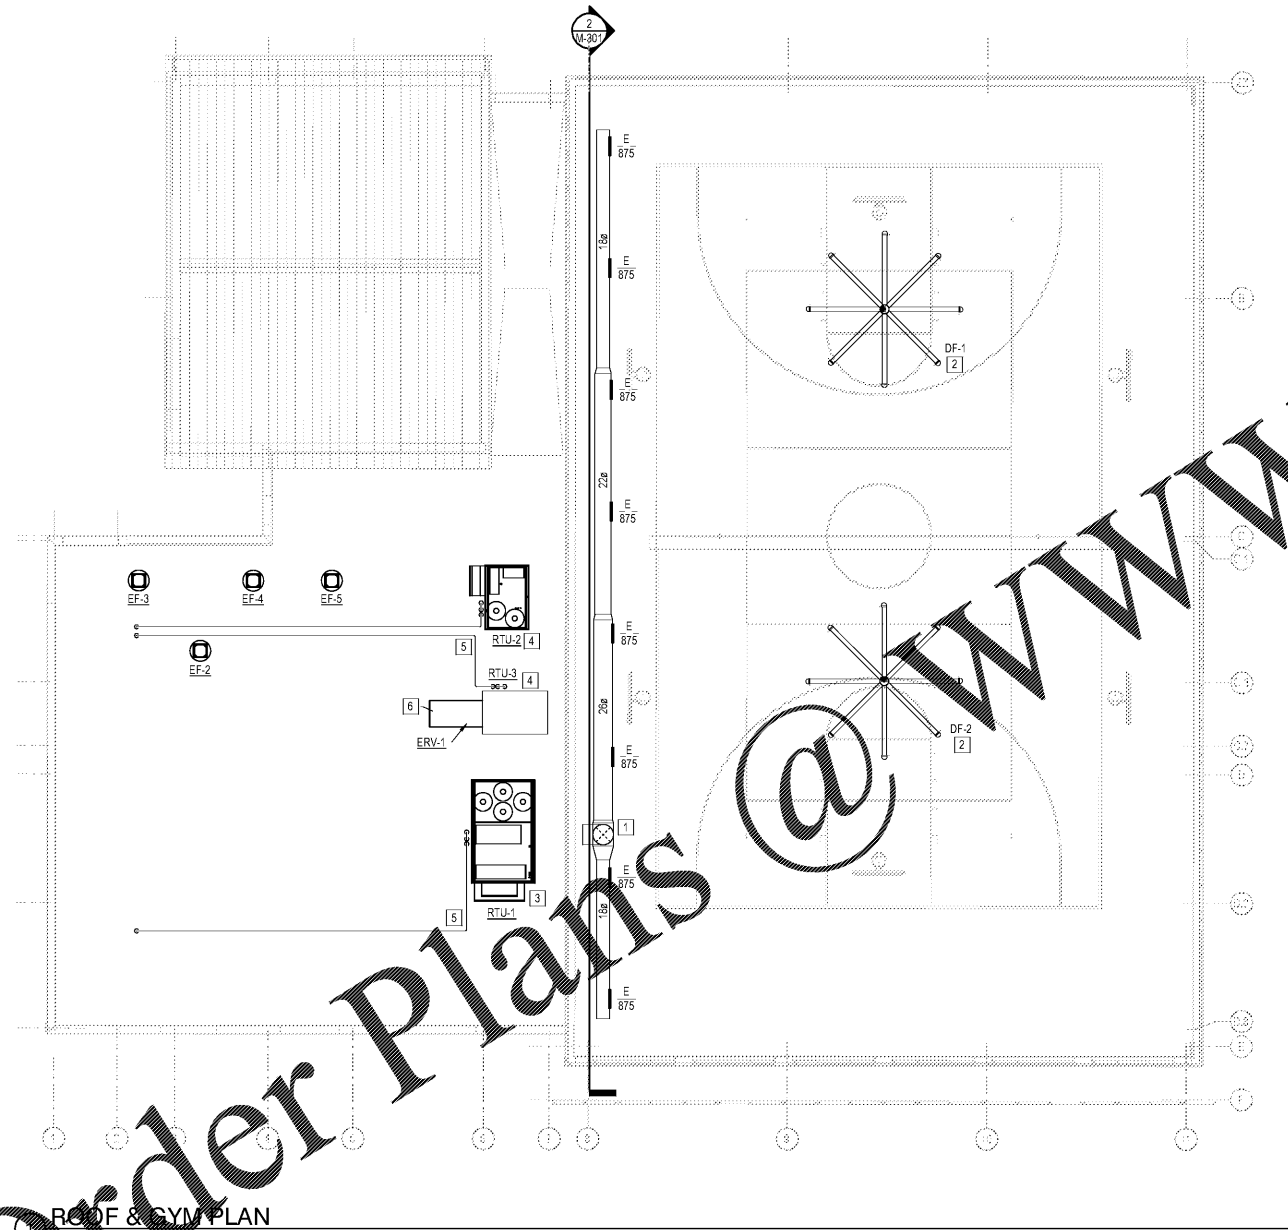

ROOF & GYM PLAN


GENERAL NOTES

A. COORDINATE PLACEMENT OF EQUIPMENT WITH OTHER DISCIPLINES.

KEY NOTES

1. INSULATED DOUBLE-WALL DUCT EXPOSED IN SPACE. SEE ARCHITECTURAL FOR PAINT INSTRUCTIONS.
2. FAN INSTALLATION MUST BE COORDINATED WITH LIGHTS. FANS AND LIGHTS ARE INSTALLED AT SAME HEIGHT ABOVE FINISHED FLOOR. SEE ELECTRICAL FOR LOCATIONS.
3. PROVIDE UNIT WITH VIBRATION ISOLATION RAIL ON STANDARD ROOF CURB AND ENSURE CLEARANCES PROVIDED BY MANUFACTURER.
4. PROVIDE UNIT WITH MANUFACTURER'S STANDARD ROOF CURB AND ENSURE CLEARANCES PROVIDED BY MANUFACTURER.
5. ROUTE CONDENSATE TO NEAREST ROOF DRAIN.
6. PROVIDE ADDITIONAL SUPPORT FOR ENERGY RECOVERY VENTILATOR.

GRAPHIC SCALE(S)



City of Asheville Parks & Recreation

DR. WESLEY GRANT SR. CENTER EXPANSION

285 LIVINGSTON STREET
ASHEVILLE, NC 28801

DESIGNER

CLARK NEXSEN

440 Martin Luther King Jr Blvd
Macon, Georgia 31201
478.743.8415
www.clarknexsen.com

SEALS



SUBMITTAL


3.12.2021

CONSTRUCTION DOCUMENTS

REVISIONS

NO.	DESCRIPTION

KEY PLAN



SHEET

HVAC ROOF & GYM PLAN

MH102

DESIGN: JPN
DRAWN: JPN
REVIEW: RHF

CN 7904-A