

**SPRINKLER NOTES:**

1. THE BUILDING SHALL BE COMPLETELY PROTECTED WITH A SPRINKLER SYSTEM INSTALLED IN ACCORDANCE WITH NFPA 13 AND STATE BUILDING CODE. REFER TO DRAWING FOR FIRE PROTECTION RISER. REFER TO SPECIFICATIONS BOOK FOR ADDITIONAL INFORMATION.
2. PROVIDE SHIELDING FOR ELECTRICAL PANELS IN ELECTRICAL/MECHANICAL ROOMS. VERIFY EXACT LOCATIONS IN FIELD. COORDINATE WITH ELECTRICAL PANEL LOCATIONS.
3. SPRINKLER CONTRACTOR TO COORDINATE WITH LOCAL FIRE MARSHAL LOCATION AND TYPE OF FIRE DEPARTMENT CONNECTION ON PROJECT. REFER TO DETAIL 6/FP1.0.
4. SPRINKLER CONTRACTOR SHALL PROVIDE HYDRAULIC CALCULATIONS AND DRAWINGS TO ENGINEER AND LOCAL AUTHORITY FOR APPROVAL.
5. COORDINATE SPRINKLER LAYOUT WITH DUCTWORK, PIPING, CONDUITS, LIGHT FIXTURES, EXIT SIGNS, BEAMS AND VARIED CEILING HEIGHTS TO AVOID OBSTRUCTIONS. PROVIDE ADDITIONAL SPRINKLERS AS REQUIRED. REFER TO 2/FP1.0 FOR ADDITIONAL INFORMATION.




JOHN J. MURPHY, P.E.  
 LICENSED PROFESSIONAL ENGINEER  
 LICENSE NO. 14031  
 STATE OF NORTH CAROLINA  
 5815 S. NEW YORK ST., SUITE 100  
 CHARLOTTE, NC 28216  
 704.366.4444  
 WWW.JMMARCHITECT.COM  
 ALL RIGHTS RESERVED. NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION IN WRITING FROM JMM ARCHITECT.


**LIFE STORAGE, INC.**

**Life Storage #497**

**5800 Brookshire Blvd. · Charlotte, NC 28216**

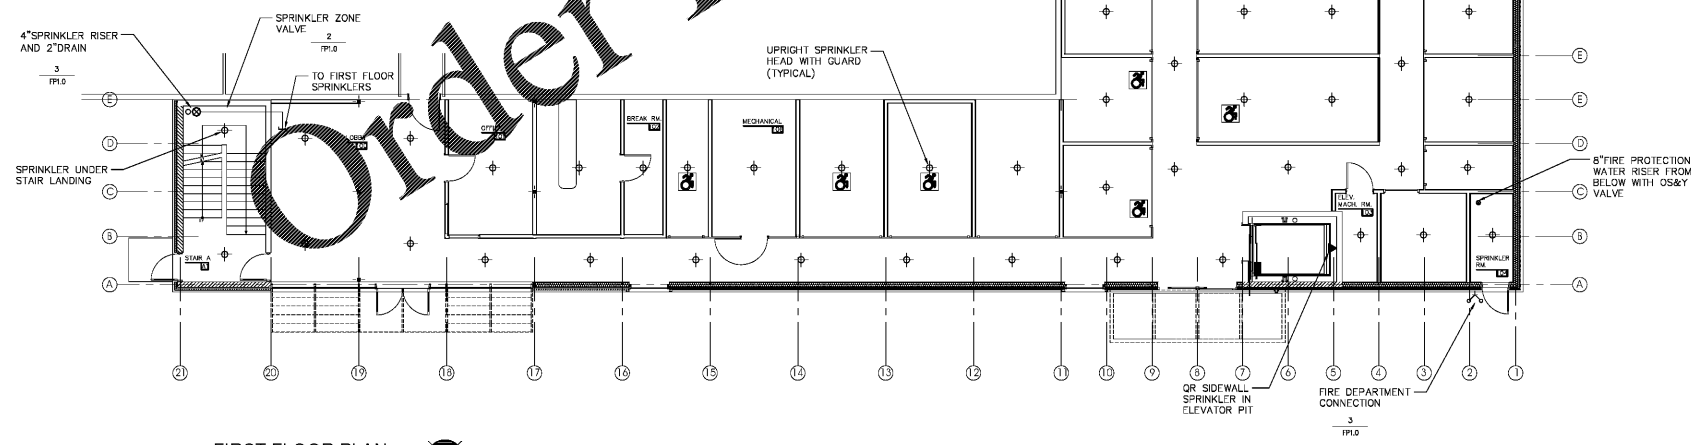

**1 FIRST FLOOR PLAN**  
 FP2.0 SCALE: 1/8" = 1'-0"

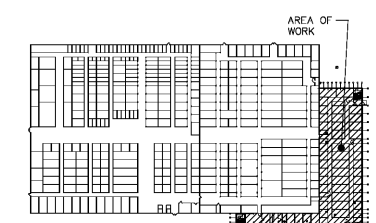

**KEY PLAN**  
 SCALE: NONE

KEVIN R. O'DONNELL, PE  
 10225 Main Street  
 Clarence, New York 14031  
 Phone: (716) 803-8787  
 Fax: (716) 407-0552 Project # 20-11-02

ISSUE	DATE	REVISIONS
1	11/02/2021	ISSUED FOR CLIENT REVIEW
2	1/04/2022	ISSUED FOR BID
3		

**FIRST FLOOR PLAN**

SCALE: AS NOTED  
 DATE: 14SEP2020  
 JOB NUMBER: 3771

**FP2.0**

Order Plans @ WWW.LDILine.com