


D
C
B
A

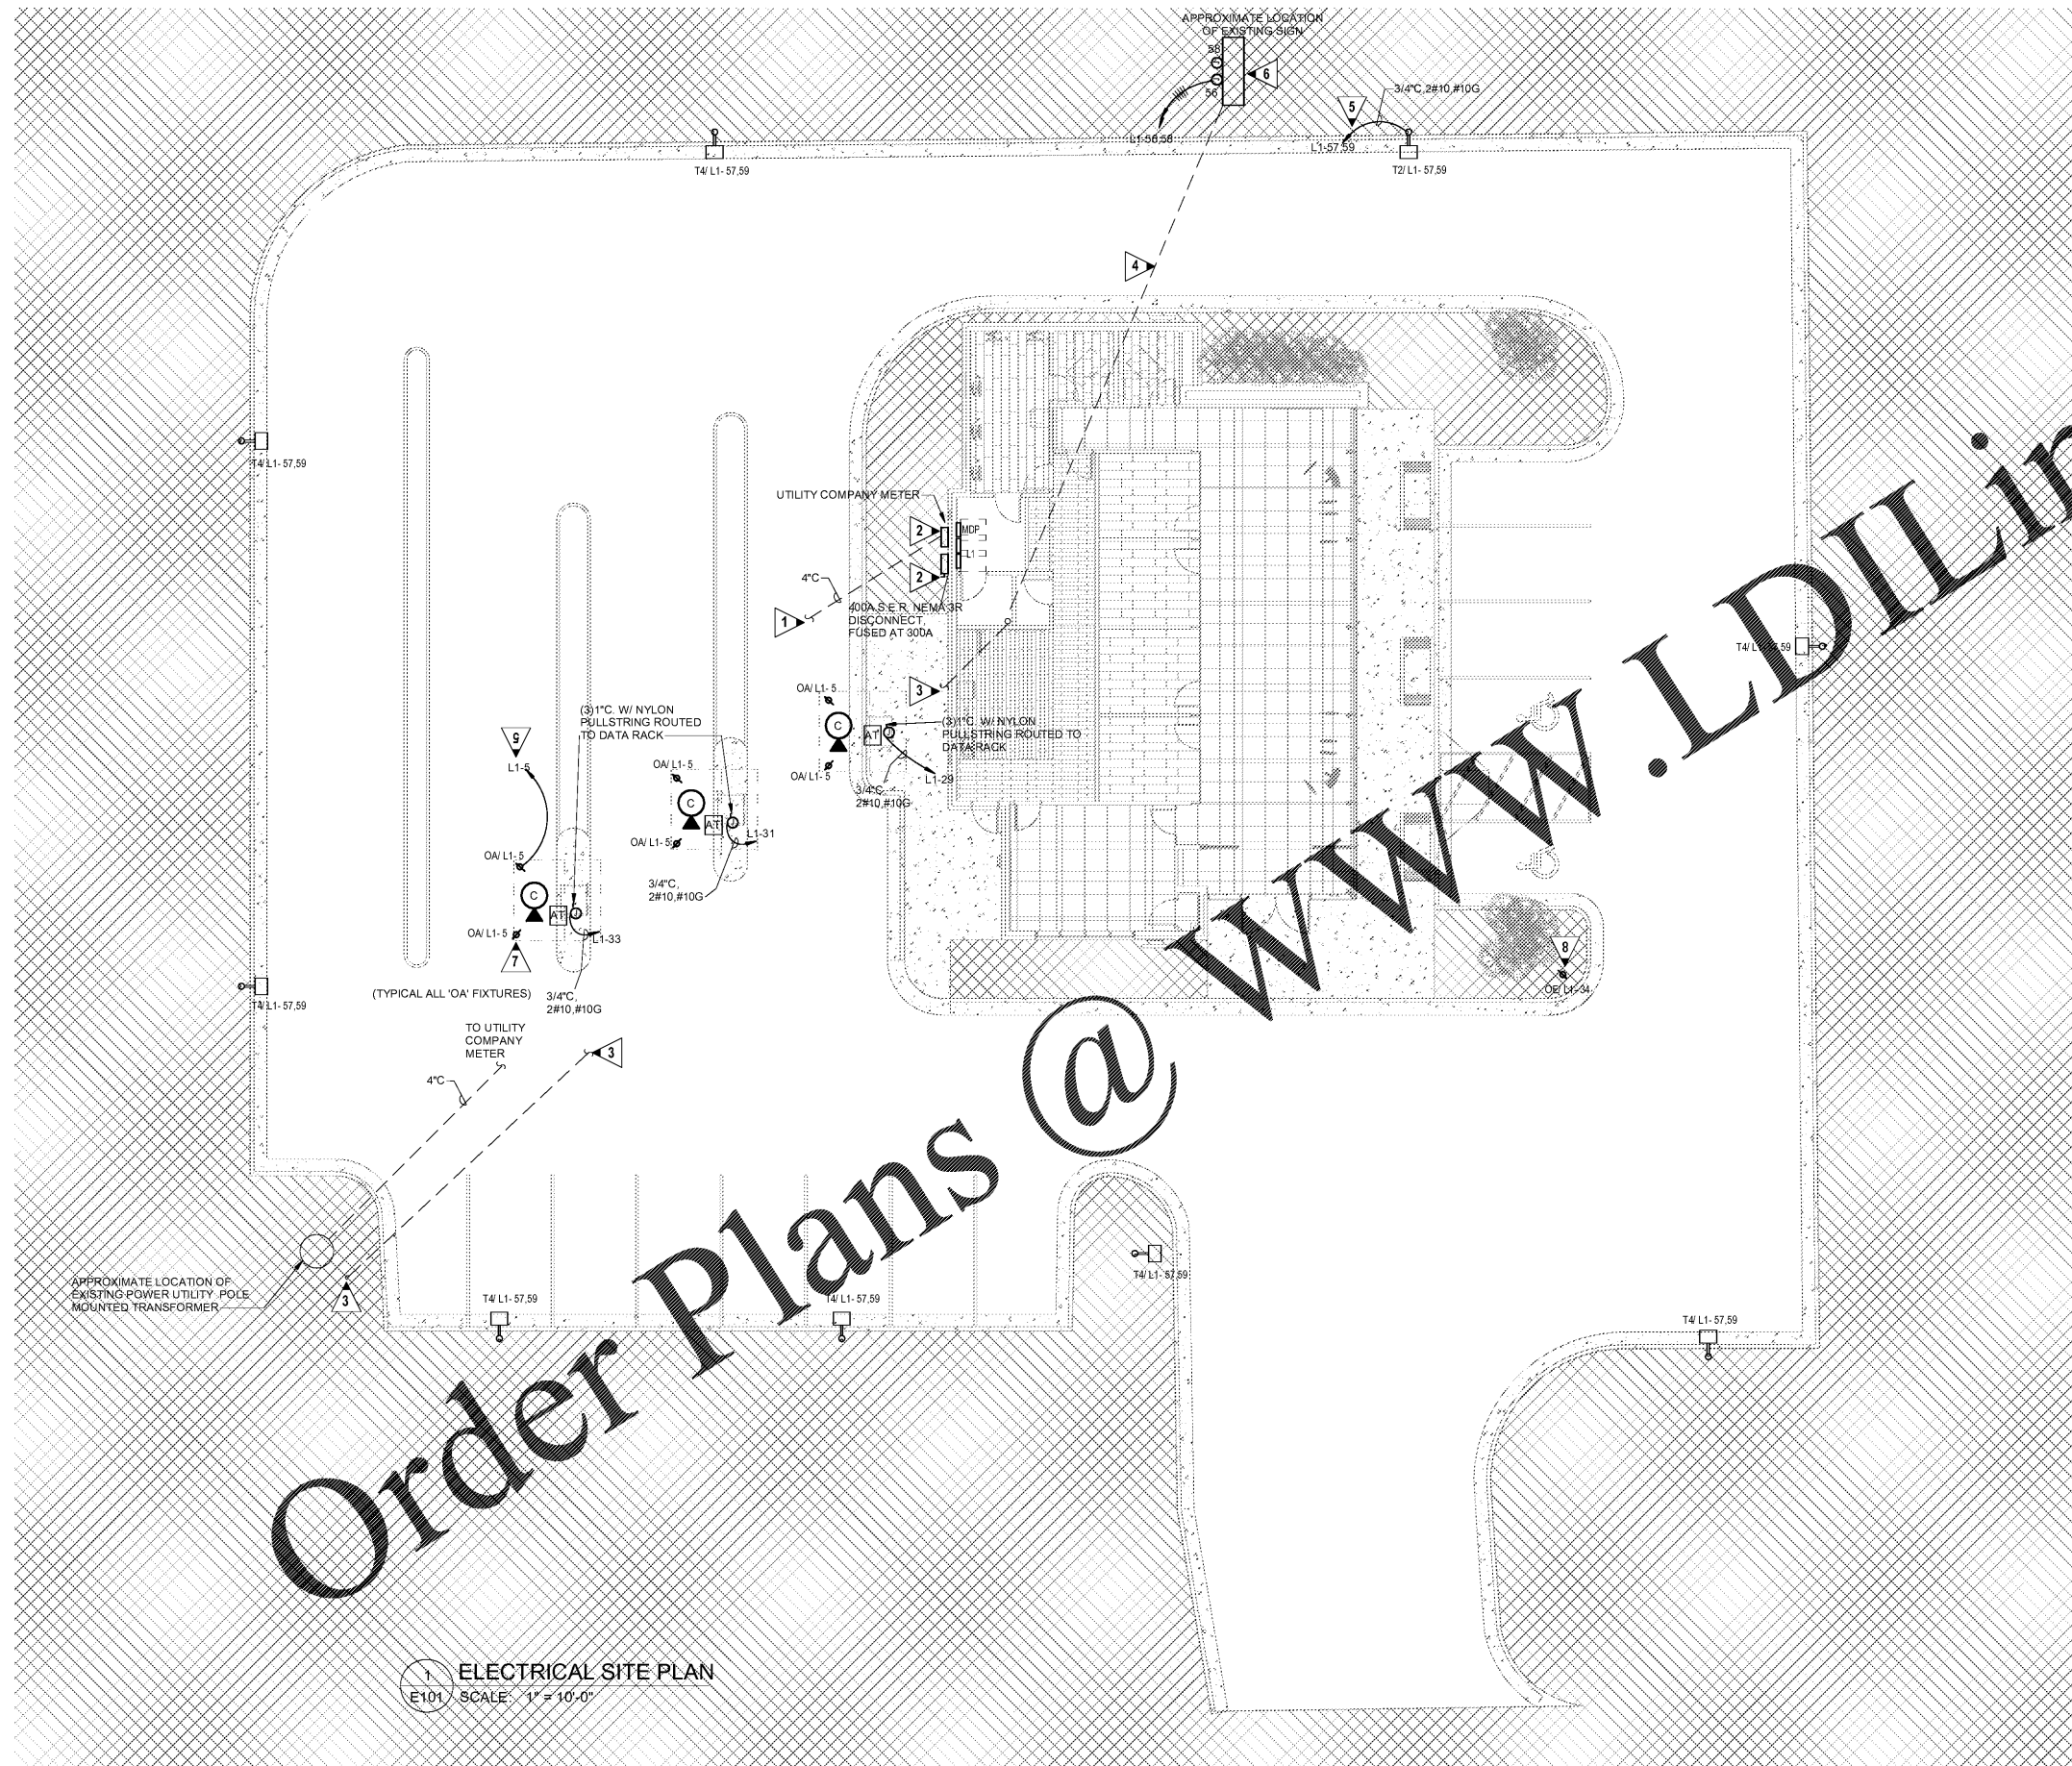

Order Plans @

WWW.LDILine.com

KEYED NOTES:

- 1 4" C TO TRANSFORMER SHOWN AT NORTHEAST CORNER. SEE POWER RISER DIAGRAM 1/E701 FOR REQUIREMENTS.
- 2 PRIOR TO INSTALLATION COORDINATE EXACT LOCATION OF METER AND DISCONNECT WITH POWER UTILITY COMPANY AND ARCHITECT.
- 3 PROVIDE (2) 3" C W/ NYLON PULLSTRING FROM SERVER ROOM TO TELEPHONE/FIBER DEMARCATION POINT. COORDINATE EXACT STUB-OUT LOCATION AT PROPERTY LINE WITH SERVICE PROVIDERS. PROVIDE HANDHOLES AS REQUIRED BY 2020 NEC.
- 4 PROVIDE (1) 2" C W/ NYLON PULLSTRING FROM SERVER ROOM TO EXISTING SIGN. COORDINATE EXACT LOCATION OF SIGNAGE WITH ARCHITECT.
- 5 ROUTE VIA 8-POLE LIGHTING CONTROL RELAY PANEL LOCATED ADJACENT TO PANEL. PHOTOCELL SHALL INTERRUPT CIRCUIT DURING MIDNIGHT HOURS. TIMECLOCK SHALL BE 365 DAY DIGITAL PROGRAMMABLE WITH 20 CONTACTS. PROVIDE FERRULE SWITCH ADJACENT TIMECLOCK.
- 6 THE EXISTING SIGN IS CONTROLLED BY WIRELESS CONTROLS. PROVIDE ALL NECESSARY COMPONENTS AT NEW BUILDING TO CONTROL EXISTING SIGN.
- 7 COORDINATE EXACT MOUNTING LOCATION AND BEAM ANGLE WITH ARCHITECT. (TYPICAL ALL TYPE 'OA' FIXTURES).
- 8 COORDINATE EXACT MOUNTING LOCATION AND BEAM ANGLE TO PROPERLY ILLUMINATE FLAGPOLE.

GENERAL NOTES:

- A SURVEY AND SITE INFORMATION PROVIDED BY OTHERS. VERIFY ALL CONDITIONS ON SITE AND WITH OFFICIAL SURVEYS AND OTHER TRADES.
- B CALL UNDERGROUND UTILITY CENTER AND VERIFY ALL UNDERGROUND UTILITIES.
- C UNDERGROUND CONDUIT SHALL BE SCHEDULE 40 PVC.
- D CONTRACTOR SHALL STAKE-OFF ALL EXISTING UTILITIES PRIOR TO ROUGH-IN. ALL NEW INSTALLATION SHALL BE COORDINATED WITH EXISTING UTILITY LOCATIONS.
- E PROVIDE HANDHOLES AS REQUIRED BY NEC FOR UNDERGROUND FEEDERS SHOWN.
- F PRIOR TO ELECTRICAL ROUGH-IN, REVIEW WITH ARCHITECT THE INSTALLATION OF CONDUITS AND LIGHT FIXTURES AT ALL CANOPIES.

ELECTRICAL SITE PLAN
E101 SCALE: 1" = 10'-0"

dickinson ARCHITECTS
 Architecture|Interior Design|Planning
 771 Broad Street Suite 200
 Augusta, Georgia 30901
 (706) 722-7488
 mail@dickinsonarchitects.com
 www.dickinsonarchitects.com

Member of the American Institute of Architects

THIS DRAWING IS THE PROPERTY OF DICKINSON ARCHITECTS, P.C. AND IS NOT TO BE REPRODUCED OR COPIED IN WHOLE OR IN PART OR USED FOR FURNISHING INFORMATION TO OTHERS, OR FOR ANY OTHER PURPOSE, WITHOUT THE WRITTEN CONSENT OF DICKINSON ARCHITECTS, P.C., AND IS TO BE RETURNED UPON REQUEST. DICKINSON ARCHITECTS, P.C.

PROJECT TITLE:
SRP BRANCH BANK

REVISIONS

REV #	DATE	APRVD BY	REVISION
1	3/17/21	AF	ISSUE FOR PERMIT

(Professional Engineer Seal)

(Professional Engineer Seal)

DA PROJECT NUMBER & NAME:
 2092
 DRAWING TITLE:
ELECTRICAL SITE PLAN

DRAWING NO:
E101

EDC ELECTRICAL DESIGN CONSULTANTS, INC.
 1201 BROAD ST., SUITE 1-A
 AUGUSTA, GA 30901
 PH: (706) 724-3551
 FAX: (706) 724-8507
 EDC PROJECT # 21017