

GENERAL NOTES:

1. LOWER CASE LETTERS AT SWITCHES AND LIGHT FIXTURES ON THIS SHEET ARE SHOWN TO CLARIFY THE FIXTURES BEING CONTROLLED BY THE ASSOCIATED SWITCHES.
2. OCCUPANCY SENSOR SHALL BE LOCATED TO PROVIDE MAXIMUM COVERAGE FOR ROOM. REFER TO DETAILS AND MANUFACTURER LAYOUT FOR CONNECTIONS.
3. PROVIDE UN-SWITCHED EMERGENCY "HOT" CONDUCTOR TO EACH EXIT SIGN, EMERGENCY LIGHT FIXTURE, AND NIGHT LIGHT.
4. PROVIDE NEUTRAL CONDUCTOR TO ALL WALL MOUNTED OCCUPANCY SENSORS. IF SENSOR DOES NOT REQUIRE NEUTRAL, CAP NEUTRAL IN BOX.
5. CONTRACTOR SHALL PROVIDE CLASS 2 600 VOLT RATED, 0-10 VOLT CONTROL WIRING FOR ALL L.E.D. FIXTURES WHERE CONTROLLED BY LOW-VOLTAGE CONTROLLERS OR WALL BOX DIMMERS.
6. FOR ALL CONDUIT INSTALLATIONS, CONTRACTOR SHALL PULL #18 AWG TFN SOLID COPPER CONTROL WIRING IN SAME CONDUIT AS LINE-VOLTAGE CONDUCTORS SHALL BE PURPLE AND GRAY. FIXTURE WHIPS SHALL BE PROVIDED WITH CONTROL WIRING INSTALLED IN WHIPS TO MATCH INSTALLATION. FIXTURE WHIPS SHALL NOT EXCEED 6'-0" IN LENGTH. NO EXCEPTIONS.
7. HOMERUN CIRCUITS ARE SHOWN AS NOTED. PROVIDE ALL BRANCH CIRCUIT CONDUIT/CONDUCTORS/TRAVELERS AS NECESSARY TO CONNECT ALL DEVICES SHOWN ON THE CIRCUIT. PROVIDE DEDICATED NEUTRALS FOR ALL CIRCUITS.

KEYED NOTES:

1. ROUTE VIA 6" RIGID LIGHTING CONTROL RELAY PANEL LOCATED ADJACENT TO PANEL PH/OCCELL SHOWN. INTERRUPT CIRCUIT DURING MIDNIGHT HOUSE TIMELOCK. SHALL BE 60 AMPERAL PROGRAMMABLE WITH 20A RATED CONTACTS. PROVIDE OVERRIDE SWITCH ADJACENT TIMELOCK.
2. COORDINATE EXACT LOCATION AND BEAM ANGLE TO ILLUMINATE VERTICAL SIGNAGE.
3. ROUTE CIRCUIT THROUGH INVERTER LOCATED IN MECH/ELEC 112.
4. SEE DETAIL 7/E702.
5. MOUNTED IN SOFFIT AT TOP OF TOWER. SEE ARCHITECTURAL ELEVATIONS.
6. MOUNTED IN SIDEWALK. COORDINATE EXACT LOCATION WITH ARCHITECT.

Order Plans @ WWW.LDOLINE.com

1 LIGHTING PLAN
E201 SCALE: 1/4" = 1'-0"


dickinson
ARCHITECTS
Architecture|Interior Design|Planning
771 Broad Street Suite 200
Augusta, Georgia 30901
(706) 722-7488
mail@dickinsonarchitects.com
www.dickinsonarchitects.com

Member of the
American Institute of
Architects

THIS DRAWING IS THE PROPERTY OF DICKINSON ARCHITECTS, P.C. AND IS NOT TO BE REPRODUCED OR COPIED IN WHOLE OR IN PART OR USED FOR FURNISHING INFORMATION TO OTHERS, OR FOR ANY OTHER PURPOSE, WITHOUT THE WRITTEN CONSENT OF DICKINSON ARCHITECTS, P.C. AND IS TO BE RETURNED UPON REQUEST. DICKINSON ARCHITECTS, P.C.

PROJECT TITLE:
**SRP
BRANCH
BANK**

REVISIONS			
REV #	DATE	APRVD BY	REVISION
1	3/17/21	AF	ISSUE FOR PERMIT

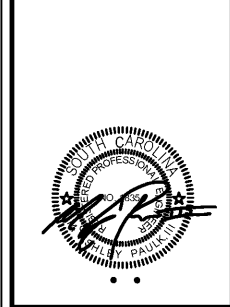

DA PROJECT NUMBER & NAME:
2092
DRAWING TITLE:
LIGHTING PLAN
DRAWING NO:
E201

EDC ELECTRICAL DESIGN CONSULTANTS, INC.
ELECTRICAL ENGINEERS
1201 BROAD ST., SUITE 1-A
AUGUSTA, GA 30901
PH: (706) 724-3551
FAX: (706) 724-8507
EDC PROJECT # 21017