LINE TYPES:

COLD WATER PIPING

FILTERED COLD WATER PIPING

110 DEG HOT WATER PIPING

140 DEG HOT WATER PIPING

HOT WATER RETURN PIPING

UNDER SLAB WATER PIPING

EXISTING PIPING SHOWN IN A LIGHTER SHADE.

CROSS CONNECTION CONTROL SCHEDULE

FIXTURE	MAKE	MODEL	ASSE, ASME OR ANSI STANDARD
ICE MAKER (ABOVE SODA)	AIR GAP	INTERNAL	ASME A112.1.2
ICE MACHINE	AIR GAP	INTERNAL	ASME A112.1.2
CARBONATOR/BAG-N-BOX	WATTS	SD-3	ASSE 1022
TEA BREWER	WATTS	SD-3	ASSE 1022
WATER FILTER SYSTEM	WATTS	LF009QT	ASSE 1013
HAND SINKS	AIR GAP	–	ASME A112.1.2

PROVIDE APPROPRIATE BACK FLOW PREVENTER AT OTHER EQUIPMENT AS REQUIRED BY CODE.

GENERAL NOTES:

1. PLUMBING CONTRACTOR SHALL VERIFY WITH THE LOCAL HEALTH DEPARTMENT AND/OR WATER COMPANY AS TO THE METER AND VALVING ARRANGEMENTS OF THE DOMESTIC WATER SERVICE WHICH ENTERS THE BUILDING. IF A BACKFLOW PREVENTER AND/OR PRESSURE REDUCING VALVE IS REQUIRED, THE PLUMBER SHALL FURNISH AND INSTALL SAME PER LOCAL AND STATE REQUIREMENTS.
2. PLUMBING CONTRACTOR SHALL PROVIDE AND INSTALL STOP VALVES AT FINISHED WALL SURFACE.
3. ALL PIPING SHOWN ON THIS PLAN IS CONCEALED ABOVE THE LAY-IN CEILING, BELOW THE FLOOR AND IN WALLS. EXPOSE PIPING IN SPACE ONLY AT EQUIPMENT AND FIXTURES.
4. SEE ARCHITECTURAL PLANS FOR FINAL EQUIPMENT LOCATIONS. COORDINATE WITH EQUIPMENT SUPPLIER AND THE GENERAL CONTRACTOR FOR FINAL WALL LOCATIONS.
5. PROVIDE WATER CONNECTIONS AS REQUIRED, ANGLE STOP AND ESCUTCHEON PLATE FOR ALL FINAL WATER CONNECTIONS.
6. FURNISH BURST PROOF BRAIDED FLEXIBLE CONNECTORS FOR FINAL CONNECTIONS TO SINKS AND OTHER EQUIPMENT.
7. FURNISH TUBING AND FITTINGS, AS REQUIRED, FOR ALL FINAL CONNECTIONS.

KEYED NOTES:

1. EXISTING GAS TANKLESS WATER HEATERS (RINNAI NO. RU98i, 199,000 BTU NATURAL GAS, INTERNAL INSTALLATION, DIRECT IGNITION, 9.8 GAL./MIN. WITH MC-91 REMOTE CONTROLLER) TO REMAIN AND BE REUSED. VERIFY GOOD WORKING CONDITION AND REPAIR AND/OR REPLACE AS REQUIRED.
2. EXISTING ELECTRIC TANK TYPE WATER HEATER (LOCHINVAR NO. JRC012E, 12 GALLON, 1.5KW, 120 VOLT, WITH HEAT TRAPS, EXPANSION TANK AND CODE APPROVED DRAIN PAN.) TO REMAIN AND BE REUSED. VERIFY GOOD WORKING CONDITION AND REPAIR AND/OR REPLACE AS REQUIRED.
3. EXISTING WATER SOFTENER SYSTEM TO REMAIN AND BE REUSED. VERIFY GOOD WORKING CONDITION AND REPAIR AND/OR REPLACE AS REQUIRED.
4. EXISTING HOT WATER RETURN PUMP TO REMAIN AND BE REUSED. VERIFY GOOD WORKING CONDITION AND REPAIR AND/OR REPLACE AS REQUIRED.
5. EXISTING RESTROOM FIXTURES TO REMAIN AND BE REUSED. FIELD VERIFY GOOD WORKING CONDITION AND REPAIR AND/OR REPLACE AS REQUIRED.
6. MAKE CONNECTION TO EXISTING CW LINE (MIN. 3/4") AND ROUTE NEW 3/4" CW TO WATER FILTER. SEE FOOD SERVICE EQUIPMENT DRAWINGS FOR ROUGH-IN HEIGHT.
7. ROUTE 3/4" FCW FROM WATER FILTER TO MAKE CONNECTION TO EXISTING 3/4" LINE ABOVE CEILING IN APPROXIMATE LOCATION SHOWN. FIELD VERIFY ROUTING OF PIPING PRIOR TO COMMENCING WORK.
8. MAKE NEW CONNECTION TO EXISTING CW, HW, AND HWR (MIN. 1/2") LINES ABOVE CEILING IN APPROXIMATE LOCATION SHOWN AND ROUTE 1/2" CW AND HW TO NEW SINK. CONNECT EXISTING HWR PIPING AS REQUIRED PER CODE. FIELD VERIFY ROUTING OF PIPING PRIOR TO COMMENCING WORK.
9. MAKE NEW CONNECTION TO EXISTING 3/4" FCW LINE ABOVE CEILING AND ROUTE 1/2" FCW TO MAKE CONNECTION TO NEW ICE MACHINE AS REQUIRED. SEE FOOD SERVICE EQUIPMENT DRAWINGS FOR ROUGH-IN HEIGHTS AND EQUIPMENT INFORMATION.
10. MAKE NEW CONNECTION TO EXISTING 3/4" FCW LINE ABOVE CEILING AND ROUTE 3/4" TO MAKE CONNECTION TO NEW BAG-N-BOX SYSTEM AS REQUIRED. SEE FOOD SERVICE EQUIPMENT DRAWINGS FOR ROUGH-IN HEIGHTS AND EQUIPMENT INFORMATION.
11. MAKE NEW CONNECTION TO EXISTING 3/4" FCW LINE ABOVE CEILING AND ROUTE 1/2" FCW TO MAKE CONNECTION TO NEW TEA BREWER AS REQUIRED. SEE FOOD SERVICE EQUIPMENT DRAWINGS FOR ROUGH-IN HEIGHTS AND EQUIPMENT INFORMATION.

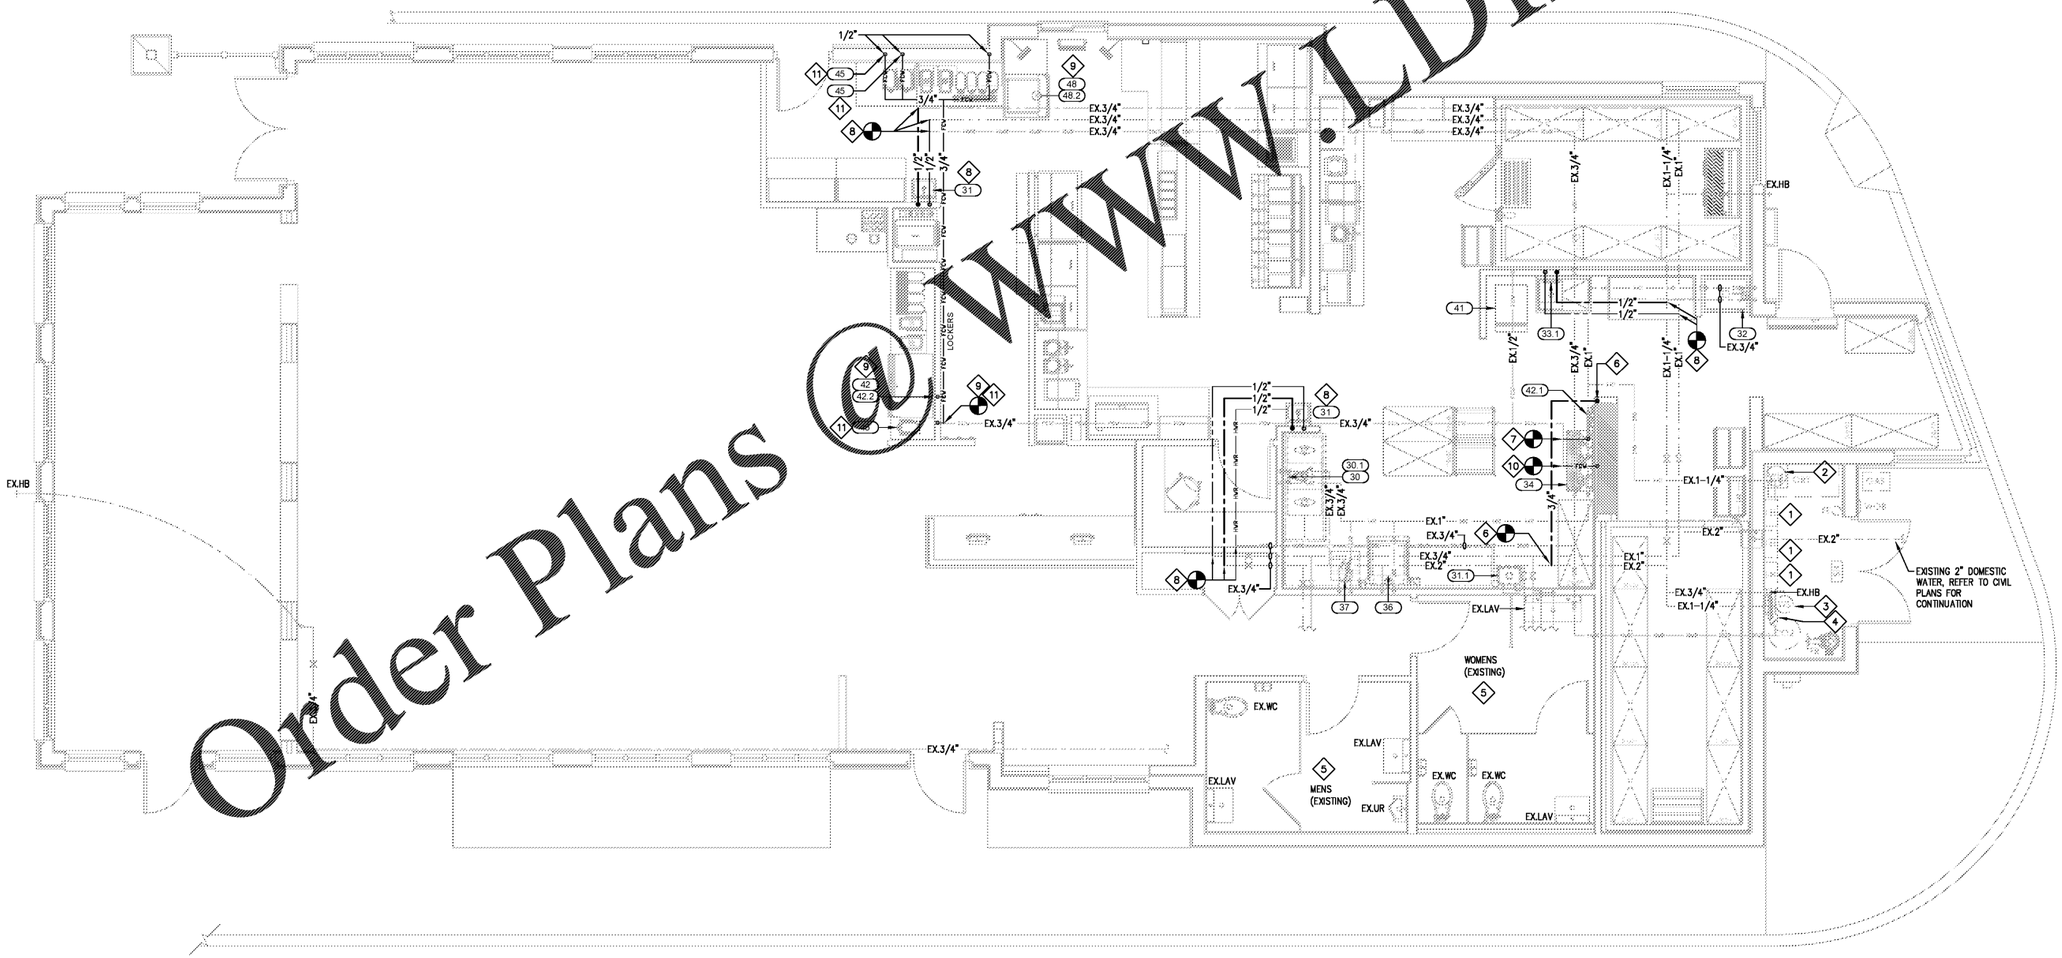

Order Plans @ WWW.LDILine.com

DOMESTIC WATER PLAN 1 P2.0
SCALE 1/4" = 1'-0"

ARCHITECT:
JSO
JOHN S. ODOM, ARCHITECT
P.O. BOX 410394
SAINT LOUIS, MISSOURI 63141
PH. 1.417.343.2602
WWW.JOHNSODOM.COM
E-MAIL: JOHN@JOHNSODOM.COM
CONTACT: JOHN S. ODOM

PROJECT:
TENANT MODIFICATIONS FOR:
SLIM CHICKENS
4311 WASHINGTON ROAD
EVANS, GEORGIA 30809

GEORGIA REGISTERED No. 25568 PROFESSIONAL WILLIAM J. ALKEMA
03-18-21

REGISTERED ENGINEER LICENSE/ NUMBER REQUIRED

SPECIAL NOTICES

Drawn: MK/TT Date: 12/19/20

P2.0

DOMESTIC WATER PLAN