


SYMBOL LEGEND			
NOT ALL SYMBOLS ARE USED			
⊕	JUNCTION BOX	⊕	120 V RECEPTACLE, DUPLEX GFCI
⊕	120 V RECEPTACLE, DUPLEX	⊕	120 V RECEPTACLE, DUPLEX ISOLATED GROUND GFCI
⊕ ^{TR}	120 V RECEPTACLE, DUPLEX, TAMPER-RESISTANT	⊕	120 V RECEPTACLE, DUPLEX WEATHERPROOF GFCI
⊕	120 V RECEPTACLE, DUPLEX ISOLATED GROUND	⊕	1P WALL SWITCH
⊕	120 V RECEPTACLE, CEILING MOUNT DUPLEX	⊕ ^{OS}	OCCUPANCY SENSOR WALL SWITCH
⊕	120 V RECEPTACLE, SIMPLEX	⊕	COMBINATION TELEPHONE/DATA OUTLET
⊕	120 V RECEPTACLE, DOUBLE DUPLEX	⊕	COMBINATION TELEPHONE/DATA QUAD OUTLET
⊕	SPECIAL RECEPTACLE (SEE NEMA CONFIG)	⊕	TELEPHONE OUTLET
⊕	FUSED DISCONNECT	⊕	FLUSH MOUNTED PANEL BOARD
⊕	NON-FUSED DISCONNECT	⊕	SURFACE MOUNTED PANEL BOARD
⊕	T-STAT	⊕	TV OUTLET(VIDEO)
⊕	HOOD PULL STATION	⊕	SPEAKER (AUDIO)
		⊕	CAMERA

GENERAL NOTES:

- ALL ISOLATED GROUND RECEPTACLES SHALL BE OF THE ISOLATED GROUND TYPE. ALL CIRCUITS SHALL CONTAIN A HOT, NEUTRAL, GROUND AND ISOLATED GROUND CONDUCTOR.
- AMPCACITY OF ALL CONDUCTOR SIZES SHOWN ON PLANS IS BASED ON 75°C RATED TERMINATIONS AND CONDUCTOR INSULATION. CONTRACTOR SHALL FIELD VERIFY EQUIPMENT TEMPERATURE RATINGS OF ALL TERMINATIONS AND ADJUST CONDUCTOR SIZES PER NEC 110.14(C)
- ALL WIRING IS COPPER. REFER TO ELECTRICAL SPECIFICATIONS FOR FURTHER INFORMATION.
- ALL WALL MOUNTED RECEPTACLES SHALL BE 18" A.F.F ON CENTER. UNLESS NOTED OTHERWISE.
- DEVICES SHALL BE NEMA 5-20 UNLESS NOTED OTHERWISE. TYPICAL OF 120V-20A CIRCUITS.
- EACH MULTIWIRED BRANCH CIRCUIT SHALL BE PROVIDED WITH A MEANS THAT WILL SIMULTANEOUSLY DISCONNECT ALL UNGROUNDED CONDUCTORS AT THE POINT WHERE THE BRANCH CIRCUITS ORIGINATES. REF NEC (210.4)
- THE UNGROUNDED AND GROUNDED CONDUCTORS OF EACH MULTIWIRED BRANCH CIRCUIT SHALL BE GROUPED BY WIRE TIES OR SIMILAR MEANS IN AT LEAST ONE LOCATION WITHIN THE PANELBOARD OR OTHER POINT OF ORIGINATION. REF NEC (210.4(D))
- FURNISH AND INSTALL CORD AND CAP FOR ALL EQUIPMENT CONNECTED TO NEMA L-14R RECEPTACLE.
- CONDUITS THAT ARE EXPOSED TO WIDELY DIFFERENT TEMPERATURES, SUCH AS COOLERS, FREEZERS OR SERVICE ENTRANCE CONDUCTORS, SHALL BE SEALED TO PREVENT CIRCULATION OF AIR AND/OR MOISTURE. REF NEC (300.7 (A))
- CONDUIT AND WIRING IN AREAS WHERE EXPOSED SHALL BE ROUTED AT 90 DEGREE ANGLES PERPENDICULAR OR PARALLEL TO JOISTS. COORDINATE PAINTING OF CONDUIT WITH ARCHITECTURAL FINISHES.
- ALL 120V OUTLETS IN KITCHEN AREA ARE TO BE GFCI PROTECTED, EITHER BY RATED BREAKERS OR DEVICES.
- SEE ARCHITECTURAL DEMO PLANS FOR NOTES ON EQUIPMENT TO BE REUSED. ELECTRICAL CONTRACTOR TO COORDINATE WITH GC TO RETAIN ANY ELECTRICAL CONNECTIONS REQUIRED FOR EQUIPMENT TO BE REUSED.
- EXISTING LIGHTING AND CONTROLS TO REMAIN AND BE REUSED. ELECTRICAL CONTRACTOR TO WORK WITH GENERAL CONTRACTOR PRIOR TO DEMOLITION.

KEYED NOTES:

- EXISTING ELECTRICAL SERVICE AND PANELS TO REMAIN AND BE REUSED. CONTRACTOR TO VERIFY ALL DETAILS OF EXISTING SERVICE.
- ALL ELECTRICAL PENETRATIONS INTO THE COOLER/FREEZER SHALL BE SEALED PER N.E.C. ARTICLE 300.7. ALL CONDUITS TO BE EXPOSED AT COOLER PANEL WALLS.
- E.C. TO PROVIDE WIRING FOR COOLER AND/OR FREEZER DOOR HEATERS.
- ALL WIRING DEVICES IN FRONT COUNTER/CONSOLIDATION WALL SHALL BE INSTALLED IN CABINETRY OR IN CASING. INSTALL GROMMETS IN WALL TO CONNECT EQUIPMENT TO DEVICES.
- E.C. TO INSTALL WEATHERPROOF J-BOX FOR HEAT TRACE WHICH SUPPLIES FREEZE PROTECTION FOR FREEZER CONDENSATE LINES. FURNISH HEAT TRACE AND PROVIDE GFI-EPD CIRCUIT BREAKER AND INSTALL PER MANUFACTURER'S REQUIREMENTS. REFERENCE ELECTRICAL SPECIFICATIONS.
- AIR CURTAIN. CONNECT TO DOOR SWITCH. REUSE EXISTING CIRCUIT WHERE POSSIBLE, REPLACE AS NECESSARY.
- INTERLOCK FRYER CONTROLS WITH HOOD CONTROL PANEL TO SHUT OFF FRYER CONTROLS IN CASE OF EMERGENCY.
- PROVIDE ROUGH-IN AND FINAL CONNECTION FOR AIR CURTAIN. AIR CURTAIN TO BE ACTIVATED WHEN DRIVE-THRU WINDOW IS OPEN.
- PROVIDE FINAL CONNECTION TO NEW EXHAUST FAN SHOWN. COORDINATE CONNECTION WITH MECHANICAL CONTRACTOR IN FIELD. SEE HOOD SHOP DRAWINGS FOR MORE INFORMATION.
- NEW HOOD TO BE INSTALLED AND BE INTERCONNECTED TO EXISTING HOOD CONTROL SYSTEM. SEE HOOD SHOP DRAWINGS FOR ADDITIONAL WIRING REQUIREMENTS.
- EXISTING HOOD TO REMAIN AND BE REUSED. VERIFY ANY RECONNECTION REQUIREMENTS ONCE DEMO WORK IS COMPLETE. ELECTRICAL CONTRACTOR TO SURVEY ALL SYSTEMS TO REMAIN AND MARK AS SUCH FOR REUSE.

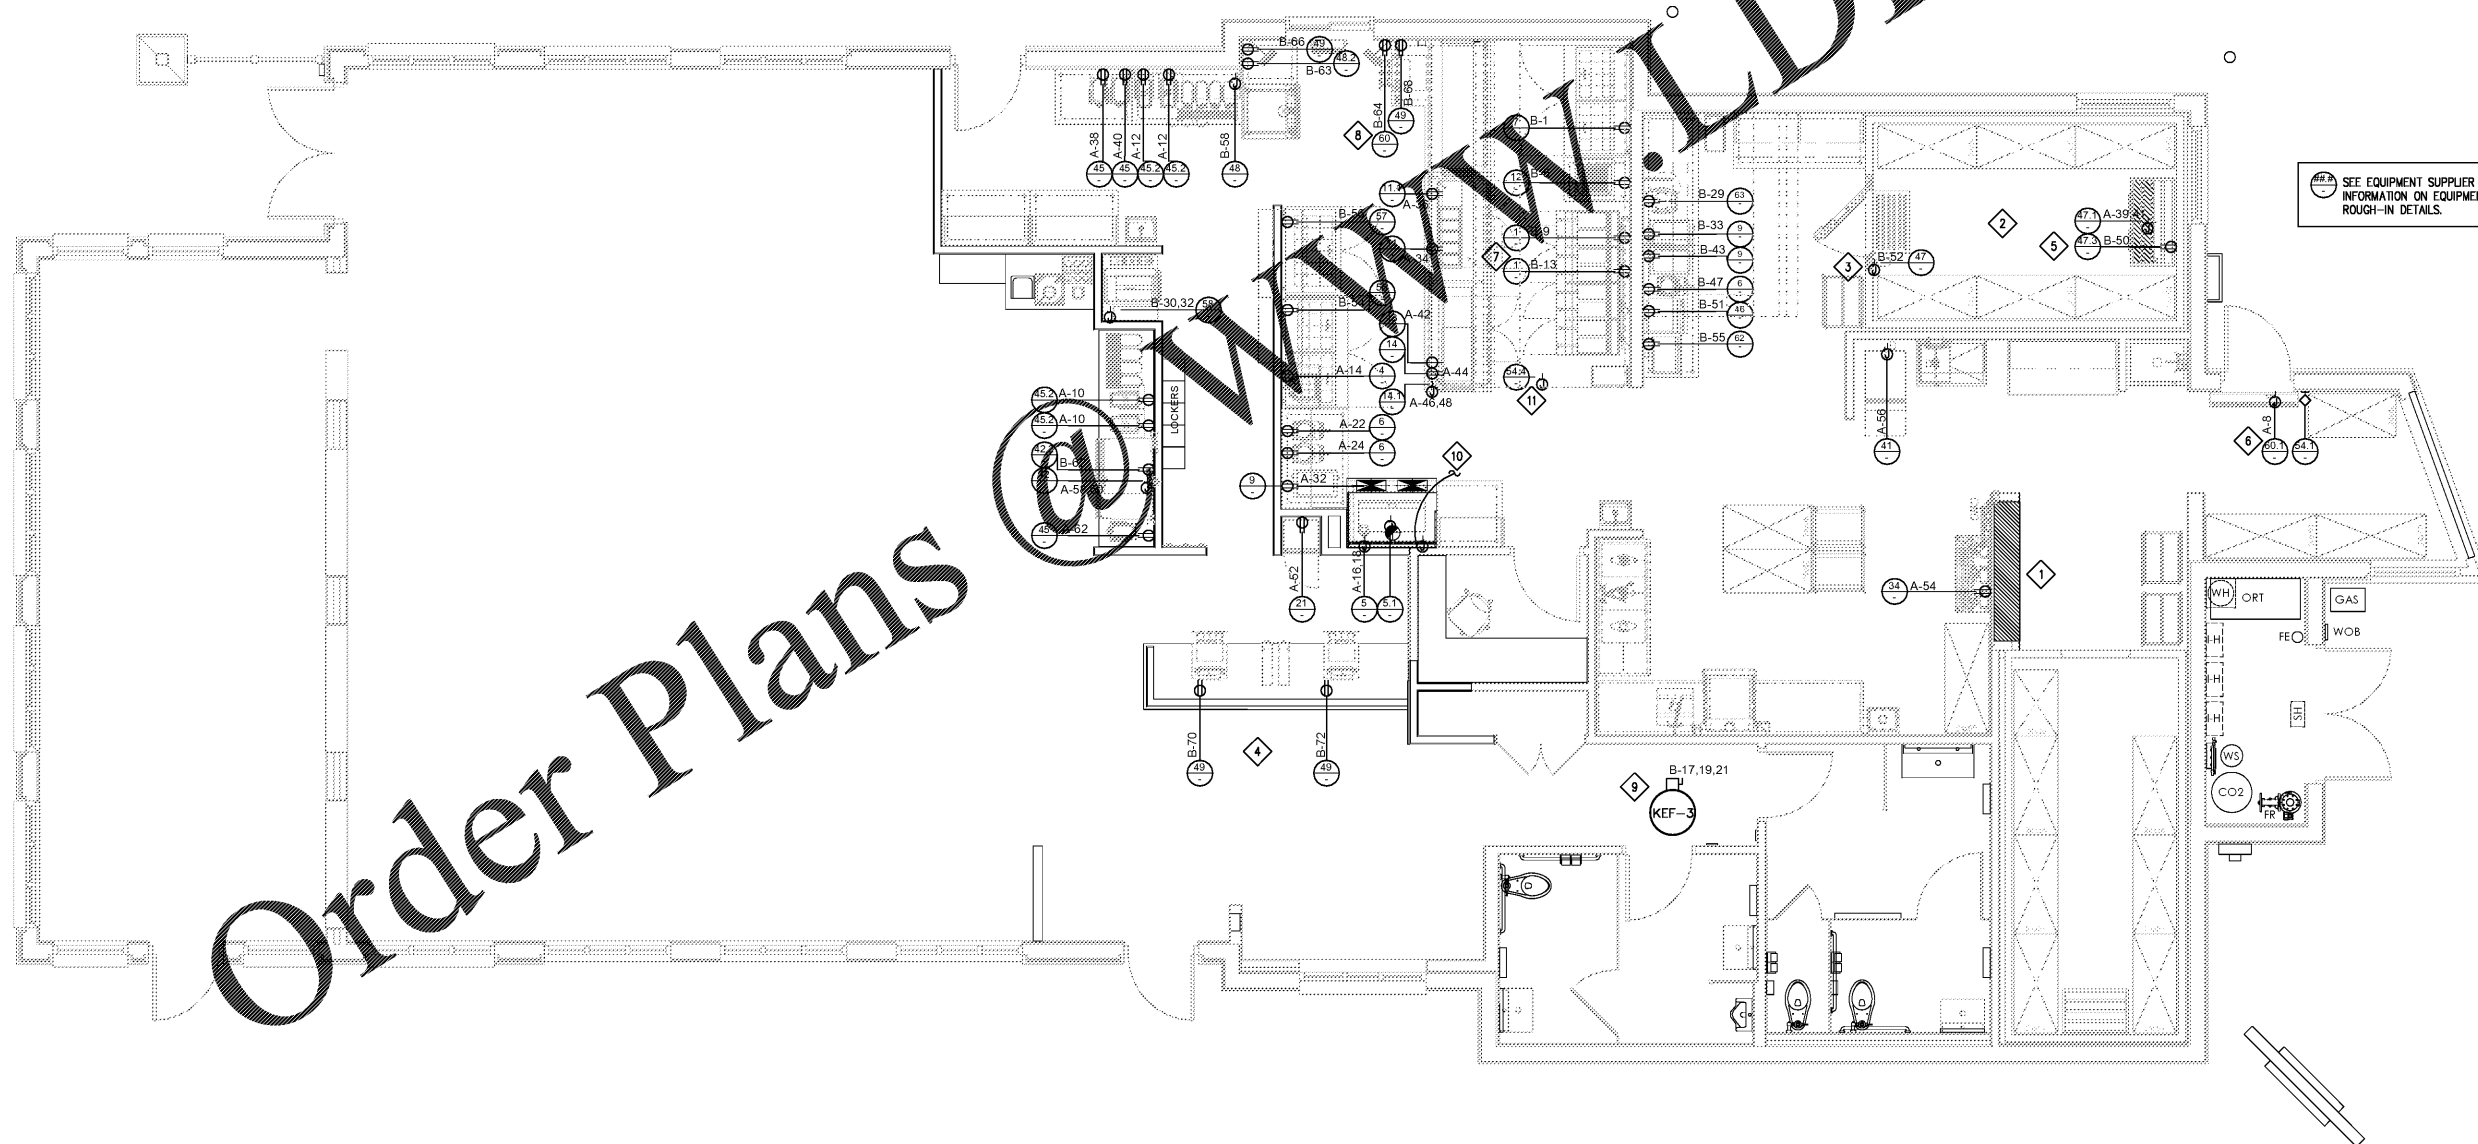

Order Plans

ARCHITECT:
JSD
 JOHN S. ODOM, ARCHITECT
 P.O. BOX 410384
 SAINT LOUIS, MISSOURI 63141
 PH: 1-417-343-2852
 WWW.JOHNSODOM.COM
 E-MAIL: JOHN@JOHNSODOM.COM
 CONTACT: JOHN S. ODOM

PROJECT:
 TENANT MODIFICATIONS FOR:
SLIM CHICKENS
 4311 WASHINGTON ROAD
 EVANS, GEORGIA 30809

GEORGIA REGISTERED PROFESSIONAL ENGINEER
 No. 25668
 WILLIAM ALKEM
 03-18-21

SPECIAL NOTICES
 I, THE ENGINEER, HEREBY CERTIFY THAT I AM A REGISTERED PROFESSIONAL ENGINEER IN THE STATE OF GEORGIA AND THAT I AM NOT PROVIDING ENGINEERING SERVICES TO ANY OTHER PARTY FOR THE SAME PROJECT AS THAT FOR WHICH I AM PROVIDING ENGINEERING SERVICES TO YOU. I AM NOT PROVIDING ENGINEERING SERVICES TO ANY OTHER PARTY FOR THE SAME PROJECT AS THAT FOR WHICH I AM PROVIDING ENGINEERING SERVICES TO YOU.