




126 TICHENOR AVE
AUBURN, AL 36830
334.887.7010

IN ASSOCIATION WITH:




Mechanics • Electrical • Plumbing
1100 South College Street
Auburn, AL 36832
P: (334) 829-8858 F: (334) 829-8859
www.Conway-Owen.com

SEALS & SIGNATURES:



REV	DESCRIPTION	DATE

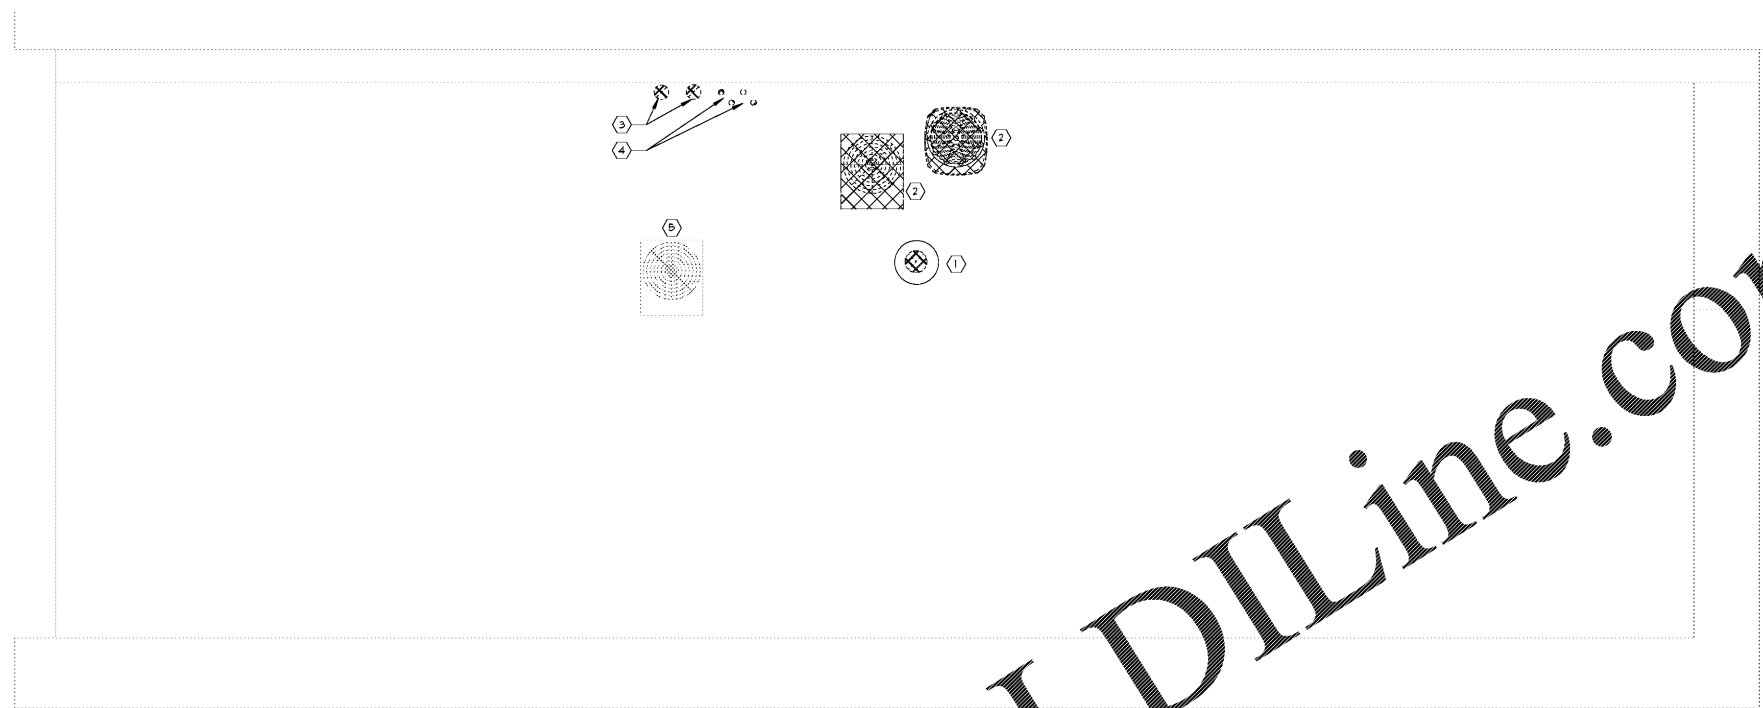

1 ROOF DEMOLITION PLAN - HVAC
1/4" = 1'-0"

GENERAL NOTES:
- SEE MECHANICAL LEGEND, SYMBOLS, & ABBREVIATIONS.
- DETAILS ARE APPLICABLE EVEN IF THEY ARE NOT DIRECTLY REFERENCED.
- EQUIPMENT SERVING THE 2ND FLOOR IS TO REMAIN.
- VERIFY THE EXISTING EQUIPMENT LOCATIONS PRIOR TO CONSTRUCTION.

ITEMS UNDERNEATH HATCHING TO BE DEMOLISHED

- KEY NOTES:**
- ① REMOVE EXISTING GREASE FAN, ASSOCIATED DUCTWORK, AND POWER.
 - ② REMOVE EXISTING CONDENSING UNIT, ASSOCIATED PIPING, CONTROLS, AND POWER. VERIFY THE CONDENSING UNITS SERVE THE 1ST FLOOR AIR HANDLING UNITS.
 - ③ REMOVE EXISTING ROOF CAP.
 - ④ REMOVE EXISTING FLUE VENTS SERVING AIR HANDLING UNITS ON 1ST FLOOR. FIELD VERIFY THESE FLUE VENTS SERVE THE AIR HANDLING UNITS ON THE 1ST FLOOR.
 - ⑤ REMOVE EXISTING CONDENSING UNIT TO REMAIN. VERIFY THIS CONDENSING UNIT SERVES THE 2ND FLOOR AIR HANDLING UNIT.

Order Plans @ WWW.LDILine.com

101 N COLLEGE STREET

101 N. COLLEGE STREET
AUBURN, AL 36830



Project No.: SNA Project # 2021-04
Client Project No.: 210000X

Drawing Title:
ROOF DEMOLITION PLAN - HVAC

Date: 03/25/2021 Phase:
Designed: Designer Drawing No.:
Drawn: Author
Checked: Checker

M1.2