KEYNOTES

1. POWER PACK FOR OCCUPANCY SENSOR. LOCATE ABOVE ACCESSIBLE CEILING. CONNECT TO UN-SWITCHED HOT LEG OF LIGHTING CIRCUIT. PROGRAM FOR AUTO ON/OFF.
2. SPEAKERS BY OWNER.

LIGHTING NOTES

1. EXIT SIGN MOUNTING
   A. WALL FIXTURE: CENTER 12" ABOVE DOOR OPENING.
   B. CEILING/PENDANT FIXTURE: ON CEILING OR AT HEIGHT SPECIFIED ON DRAWINGS.
   C. THE USE OF TRITIUM BASED RADIOACTIVE EXIT SIGNAGE SHALL NOT BE ALLOWED.
2. EMERGENCY LIGHT INSTALLATION FIXTURE MOUNTING
   A. WALL FIXTURE: 12" BELOW FINISHED CEILING OR +10'-0" IN AREAS OF EXPOSED STRUCTURE UNLESS NOTED OTHERWISE.
   B. PENDANT FIXTURE: BOTTOM CHORD OF STRUCTURE OR AT HEIGHT SPECIFIED ON DRAWINGS.
   C. REMOTE HEAD FIXTURE: HEADS CENTERED ABOVE DOOR OPENING +9'-0" UNLESS NOTED OTHERWISE.
3. ELECTRICAL CONNECTION
   A. REFER TO MANUFACTURER'S WRITTEN INSTRUCTIONS. ALLOW BATTERY TO CHARGE CONTINUOUSLY FOR A MINIMUM OF 168 HOURS BEFORE INITIAL TESTING.
   B. AFTER EMERGENCY LIGHT HAS BEEN POWERED, DO NOT TURN OFF FOR EXTENDED PERIODS OF TIME.
4. EXIT SIGNS AND EMERGENCY LIGHTS SHALL BE FED FROM THE SAME BRANCH CIRCUIT AS THAT SERVING THE NORMAL LIGHTING IN THAT AREA AND CONNECTED AHEAD OF ANY LOCAL SWITCHES OR TIME CLOCKS.
5. EMERGENCY EXIT ILLUMINATION SHALL BE SUPPLIED FROM STORAGE BATTERY THAT IS TO PROVIDE 90 MINUTES OF CONTINUED ILLUMINATION IN CASE OF PRIMARY POWER LOSS.
6. CONTRACTOR SHALL BE RESPONSIBLE FOR ASSURING THAT ALL NEW LIGHT FIXTURES WORK PROPERLY. REPORT DEFECTIVE OR DAMAGED COMPONENTS TO OWNER.
7. CONTRACTOR SHALL PROVIDE ALL LABOR AND MATERIALS TO MAINTAIN BRANCH CIRCUITS TO EXISTING LIGHT FIXTURES THAT ARE TO REMAIN. WHERE EXISTING CIRCUITS ARE ROUTED IN AREAS BEING DEMOLISHED, RE-ROUTE IN NEW CONSTRUCTION AND RECONNECT
8. CONTRACTOR SHALL FURNISH AND INSTALL UNISTRUT AS REQUIRED TO MOUNT FIXTURES TO STRUCTURAL MEMBERS.
9. CONDUIT AND WIRING IN AREAS WHERE EXPOSED SHALL BE ROUTED AT 90 DEGREE ANGLES PERPENDICULAR OR PARALLEL TO BUILDING LINES

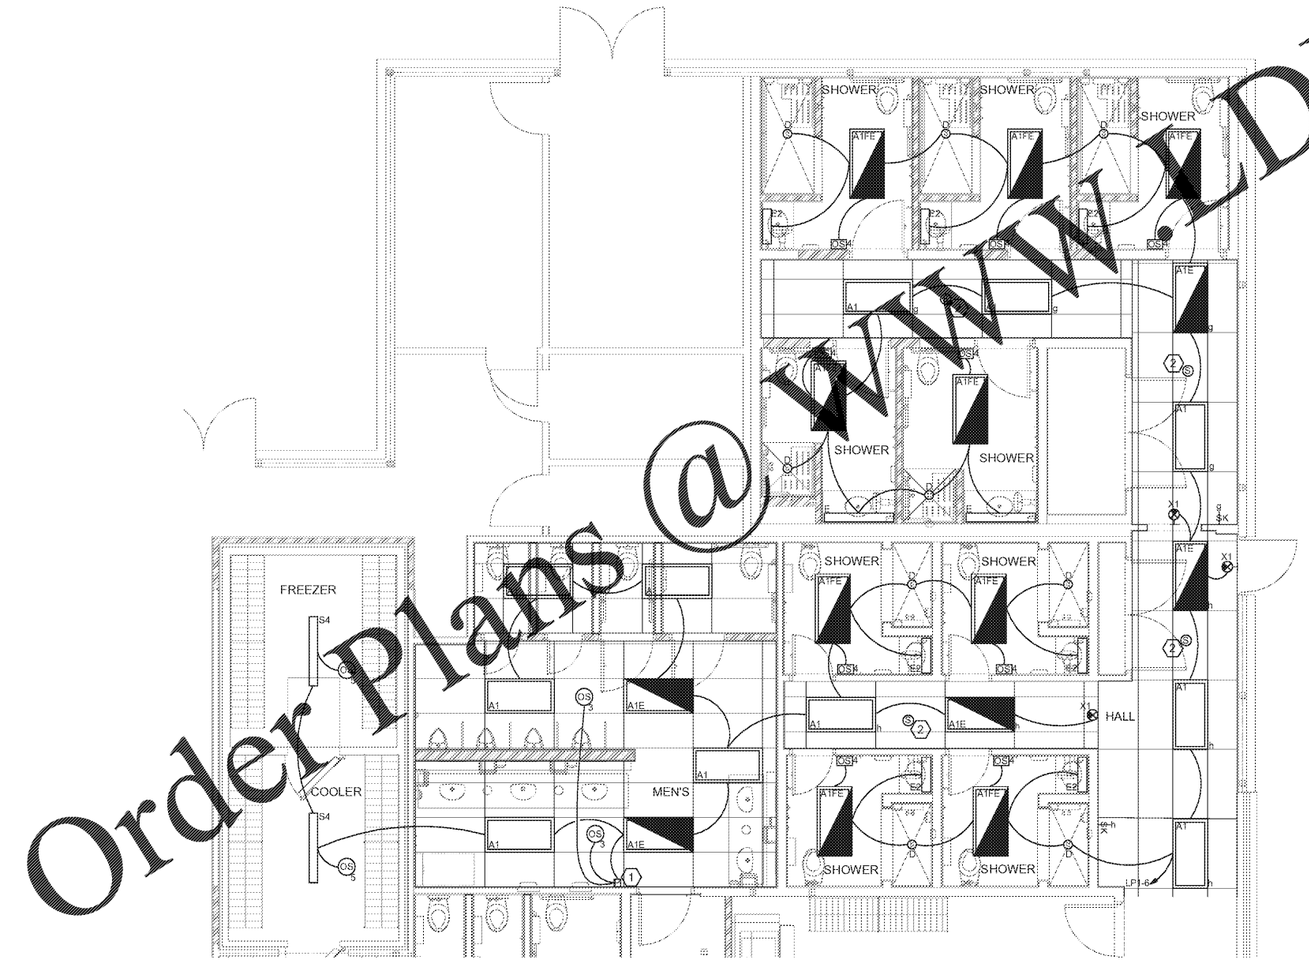

1 ENLARGED LIGHTING PLAN

SCALE: 1/4" = 1'-0"

COORDINATE THE EXTENT OF ALL REQUIRED ELECTRICAL DEMOLITION WITH CONSTRUCTION MANAGER

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT HIMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING HIS WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

HFA
HARRISON FRENCH & ASSOCIATES, LTD
1705 S. Walton Blvd., Suite 3
Bentonville, Arkansas 72712
t 479.273.7780
f 888.520.9685
www.hfa-ae.com

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE CONTEMPORANEOUSLY WITH THIS SEALED IN CONSTRUCTION ON THE PROJECT DESCRIBED HEREIN. ANY REUSE OF THESE DRAWINGS FOR ANY OTHER PROJECT, OR AT A LATER TIME, OR BY ANY OTHER PERSON OR ENTITY WITHOUT THE EXPRESS PERMISSION OF THE ARCHITECT, IS PROHIBITED. THE ARCHITECT RESERVES THE COPYRIGHT TO THESE DRAWINGS AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF SERVICE FOR THIS PROJECT. ANY UNAUTHORIZED USE WITHOUT THE ARCHITECT'S PRIOR WRITTEN CONSENT IS PROHIBITED AND TOTALLY AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO THE ARCHITECT. THE USER SHALL INDEMNIFY AND HOLD HARMLESS THE ARCHITECT AGAINST ALL DAMAGES, LIABILITIES AND COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COURT COSTS, ARISING FROM THE UNAUTHORIZED USE OF THESE DRAWINGS BY THE USER OR PERSONS UNDER USER'S CONTROL OR OBTAINING ACCESS THROUGH THE USER.

REMODEL

STORE NUMBER - 417
3150 GRANT ST
GARY, IN 46408
JOB NUMBER: 03-18-10417

ISSUE BLOCK

CHECKED BY:	CAR
DRAWN BY:	DFF
DOCUMENT DATE:	02/05/21

NATHAN KYLE CONNORS
REGISTERED
No. 11500595
STATE OF INDIANA
PROFESSIONAL ENGINEER

ENLARGED LIGHTING FLOOR PLANS

SHEET: E3.1

Order Plans @ WWW.DILine.com

Feb05,2021-2:13pm - User: dfry fcke
L:\03\03-18-10417 Lowes - Gary, IN 417\CONDOCS\MEP\elec\410 E3.1 ENLARGED LIGHTING FLOOR PLAN.dwg