


System No. W-L-1001
June 15, 2005

F Ratings — 1, 2, 3 and 4 Hr (See Items 2 and 3)
T Ratings — 0, 1, 2, 3, and 4 Hr (See Item 3)
L Rating At Ambient — Less than 1 CFM/sq ft
L Rating At 400 F — Less than 1 CFM/sq ft

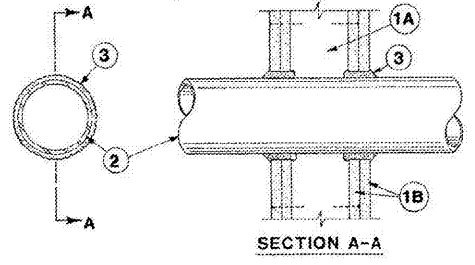

1. Wall Assembly — The 1, 2, 3 or 4 hr fire-rated gypsum wallboard/tilt wall assembly shall be constructed of the materials and in the manner described in the individual UL2089 or UL400 Series Wall or Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:

A. Studs — Wall framing may consist of either wood studs (max 2 hr fire rated assemblies) or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced 16 in. (406 mm) OC with nom 2 by 4 in. (51 by 102 mm) lumber end plates and cross braces. Steel studs to be nom 3-5/8 in. (92 mm) wide by 1-3/8 in. (35 mm) deep channels spaced max 24 in. (610 mm) OC.
B. Gypsum Board* — Nom 1/2 or 5/8 in. (12.5 or 16 mm) thick, 4 ft. (122 cm) wide with square or tapered edges. The gypsum wallboard type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual UL2089 or UL400 Series Design in the UL Fire Resistance Directory. Max diam of opening is 26 in. (660 mm).

2. Through-Penetrant — One metallic pipe, conduit or tubing installed either concentrically or eccentrically within the fire-resistive system. The annular space between pipe, conduit or tubing and periphery of opening shall be min of 0 in. (0 mm) (joint contact) to max 2 in. (51 mm) (pipe, conduit or tubing to be rigidly supported on both sides of wall opening). The following types and sizes of metallic pipes, conduit or tubing may be used:

- A. Steel Pipe — Nom 2 1/2 in. (63.5 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.
- B. Iron Pipe — Nom 2 1/2 in. (63.5 mm) diam (or smaller) service weight (or heavier) cast iron soil pipe, nom 12 in. (305 mm) diam (or smaller) or Class 50 (or heavier) ductile iron pressure pipe.
- C. Conduit — Nom 6 in. (152 mm) diam (or smaller) steel conduit or nom 4 in. (102 mm) diam (or smaller) steel electrical metallic tubing.
- D. Copper Tubing — Nom 6 in. (152 mm) diam (or smaller) Type L (or heavier) copper tubing.
- E. Copper Pipe — Nom 6 in. (152 mm) diam (or smaller) Regular (or heavier) copper pipe.

F. Through Penetrating Product* — Flexible Metal Piping: The following types of steel flexible metal gas piping may be used:

- 1. Nom 2 in. (51 mm) diam (or smaller) steel flexible metal gas piping. Plastic covering on piping may or may not be removed on both sides of floor or wall assembly.

OMEGA FLEX INC
2. Nom 1 in. (25 mm) diam (or smaller) steel flexible metal gas piping. Plastic covering on piping may or may not be removed on both sides of floor or wall assembly.

GASTITE, DIV OF TITELTEX
3. Nom 1 in. (25 mm) diam (or smaller) steel flexible metal gas piping. Plastic covering on piping may or may not be removed on both sides of floor or wall assembly.


WARDS MFG L L C
3. Fill, Void or Cavity Material* — Caulk or Sealant — Min 5/8, 1-1/4, 1-7/8 and 2-1/2 in. (16, 32, 48 and 64 mm) thickness of caulk for 1, 2, 3 and 4 hr rated assemblies, respectively, applied within annulus. Both with both surfaces of wall. Min 1/4 in. (6 mm) diam bead of caulk applied to gypsum board/penetrant interface at point contact location on both sides of wall. The hourly F Rating of the fire-resistive system is dependent upon the hourly F rating of the wall assembly in which it is installed, as shown in the following table. The hourly T Rating of the fire-resistive system is dependent upon the type or size of the pipe or conduit and the hourly F rating of the wall assembly in which it is installed, as tabulated below:

Max Pipe or Conduit Diam in (mm)	F Rating hr	T Rating hr
2 (51)	1 or 2	0, 1 or 2
4 (102)	3 or 4	3 or 4
6 (152)	3 or 4	0
12 (305)	1 or 2	0


*When copper pipe is used, T Rating is 0 hr.

SM COMPANY — CP 25WB+ or FB-3000 WT.


*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions requiring UL or cUL certification (such as Canada), respectively.

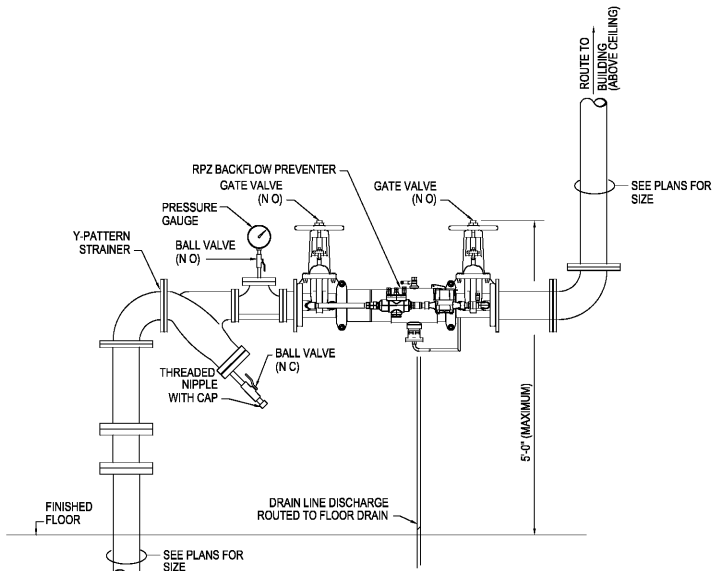


5 REDUCED PRESSURE ZONE BACKFLOW PREVENTER
P0.2 SCALE: NIS

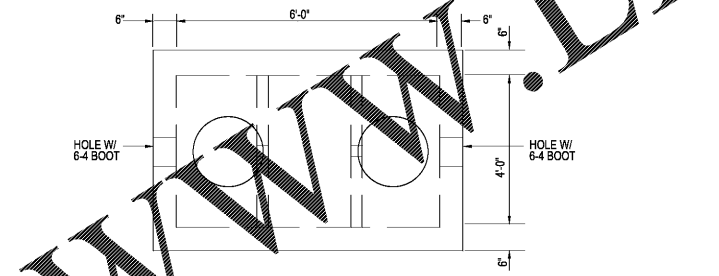


6 OIL-WATER-SAND SEPARATOR DETAIL
P0.2 SCALE: N.T.S.

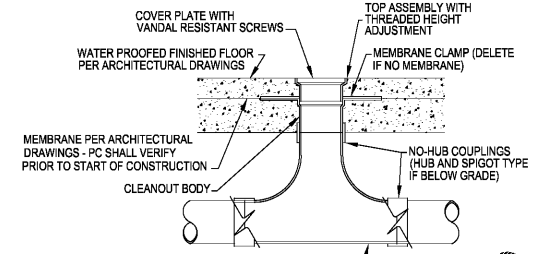


1 INTERIOR FLOOR CLEANOUT
P0.2 SCALE: NIS

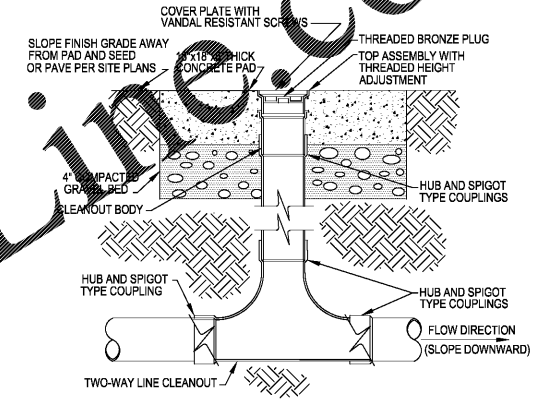

2 EXTERIOR CLEANOUT AT GRADE
P0.2 SCALE: N.T.S.

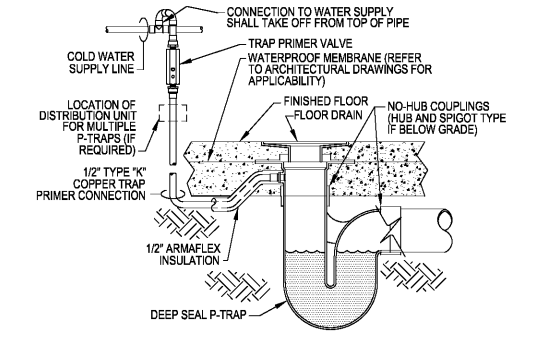


3 FLOOR DRAIN DETAIL WITH TRAP PRIMER
P0.2 SCALE: N.T.S.

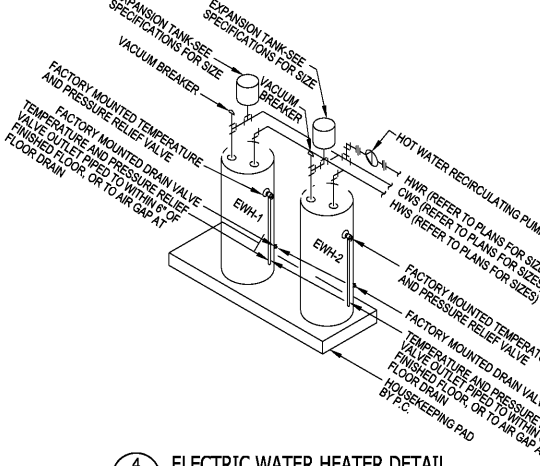

4 ELECTRIC WATER HEATER DETAIL
P0.2 SCALE: N.T.S.

Order Plans

WWW.LDILLINE.COM



ENGINEERED DESIGNS INC.
North Carolina License #FC-1729
181 SE Cary Parkway, Suite 200 Cary, North Carolina 27518
P 919.851.6461 F 919.851.9703 www.engineereddesigns.com

City of Winston-Salem
FIRE STATION 3
WINSTON-SALEM • NORTH CAROLINA



THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND SHALL REMAIN THE PROPERTY OF THE ARCHITECT. NO PART OF THESE DRAWINGS MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT.

DRAWN: J.C.
CHECKED: V.S.
COMM.: 1904
DATE: 03-17-21
REVISION: