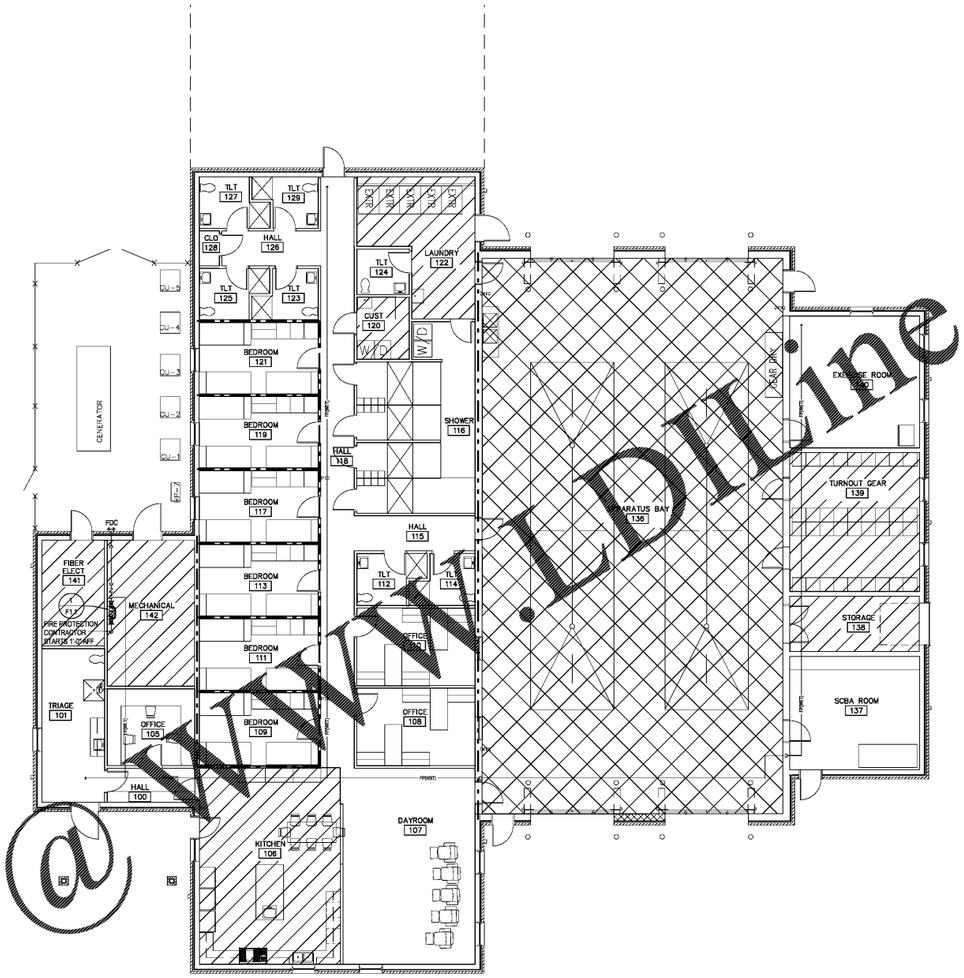

1 F1.1 FIRST FLOOR - FIRE PROTECTION PLAN

SCALE: 1/8"=1'-0"

Order Plans @ WWW.LDLine.com

SPRINKLER COVERAGE LEGEND

- LIGHT HAZARD GROUP 1
- ORDINARY HAZARD GROUP 1
- ORDINARY HAZARD GROUP 2

RATED WALL LEGEND

- 1/2 HOUR RATED FIRE BARRIER
- 2 HOUR RATED FIRE BARRIER

REFER TO UL PENETRATION DETAILS FOR ADDITIONAL REQUIREMENTS

ERSOY BRAKE APPLEYARD ARCHITECTS, P.A.
ARCHITECTURE • PLANNING • INTERIORS

ENGINEERED DESIGNS INC.
North Carolina License #C-1729
1151 SE Cary Parkway, Suite 200 Cary, North Carolina 27518
P 919.851.8481 | F 919.851.9703 www.engineereddesigns.com

City of Winston-Salem
FIRE STATION 3
WINSTON-SALEM • NORTH CAROLINA

THESE DRAWINGS ARE INSTRUMENTS OF SERVICE AND SHALL REMAIN THE PROPERTY OF THE ARCHITECT WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT. THEY ARE NOT TO BE USED BY THE OWNER OR ANY OTHER PERSON ON OTHER PROJECTS EXCEPT BY AGREEMENT IN WRITING AND WITH APPROPRIATE COMPENSATION TO THE ARCHITECT.

© COPYRIGHT 2021 BY ERSOY BRAKE APPLEYARD ARCHITECTS P.A. ALL RIGHTS RESERVED. EXCEPT AS PERMITTED UNDER THE UNITED STATES COPYRIGHT ACT OF 1976, NO PART OF THIS DRAWING MAY BE REPRODUCED, DISTRIBUTED OR USED IN ANY FORM OR BY ANY MEANS WITHOUT THE WRITTEN PERMISSION OF ERSOY BRAKE APPLEYARD ARCHITECTS, P.A.

DRAWN	DR
CHECKED	MS
COMM.	1904
DATE	03-17-21
REVISION 1	

F1.1 OF 1