LEGEND:

FE = LOCATE CLASS 2A FIRE EXTINGUISHERS IN RECESSED CABINETS (NON-RATED / RATED RELATIVE TO PLAN LOCATION). FIRE EXTINGUISHERS LOCATED AT CIP AND PRECASTWALLS TO BE SURFACED MOUNTED. SEE 9&10/A1.0a FOR PLAN DETAILS. MAXIMUM SEPARATION BETWEEN TWO UNITS IS 150' ALONG CENTERLINE OF CORRIDOR. SET TOP OF EXTINGUISHER AT 4'-6" ABOVE FINISH FLOOR.

* = TRAVEL DISTANCE FROM MOST REMOTE POINT OF DWELLING UNIT TO CORRIDOR NOT EXCEEDING 125' PER NFPA 101, SECTION 30.2.6.

** = TRAVEL DISTANCE FROM DWELLING UNIT ENTRY DOOR TO NEAREST EXIT NOT EXCEEDING 200' AS REQUIRED PER NFPA 101, SECTION 30.2.6.3.2.

*** = LOCATE A TWO-WAY COMMUNICATION SYSTEM PER NCBC, SECTION 907.8

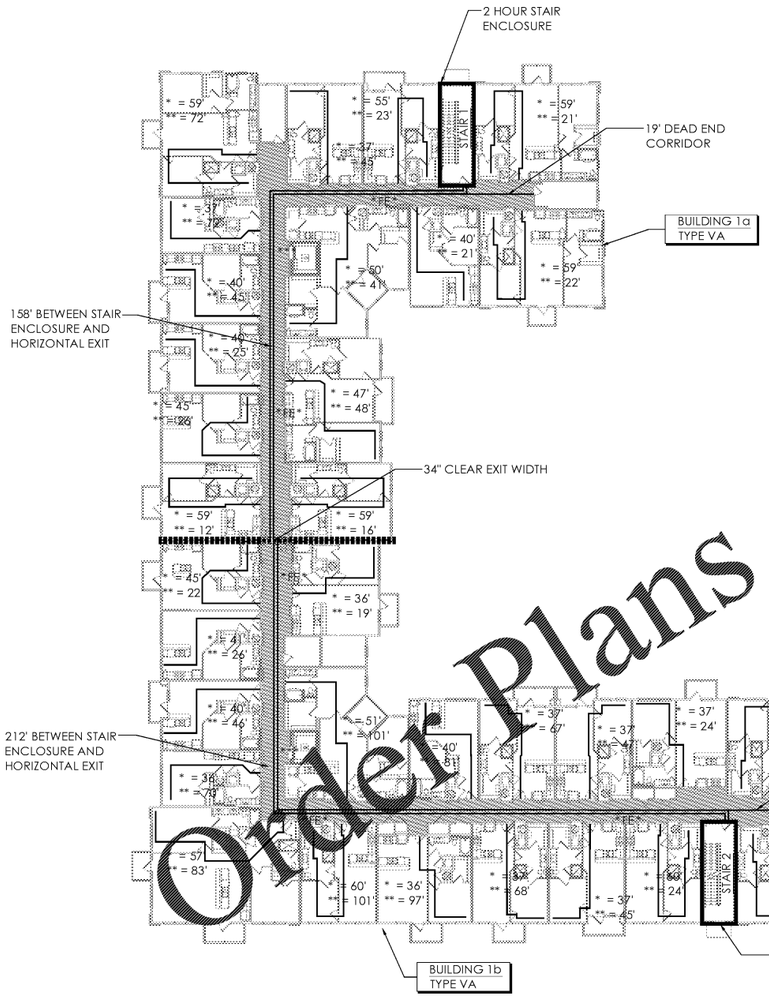

2 Life Safety - Levels 2-4 - Building 1
Scale: 1/16" = 1'-0"

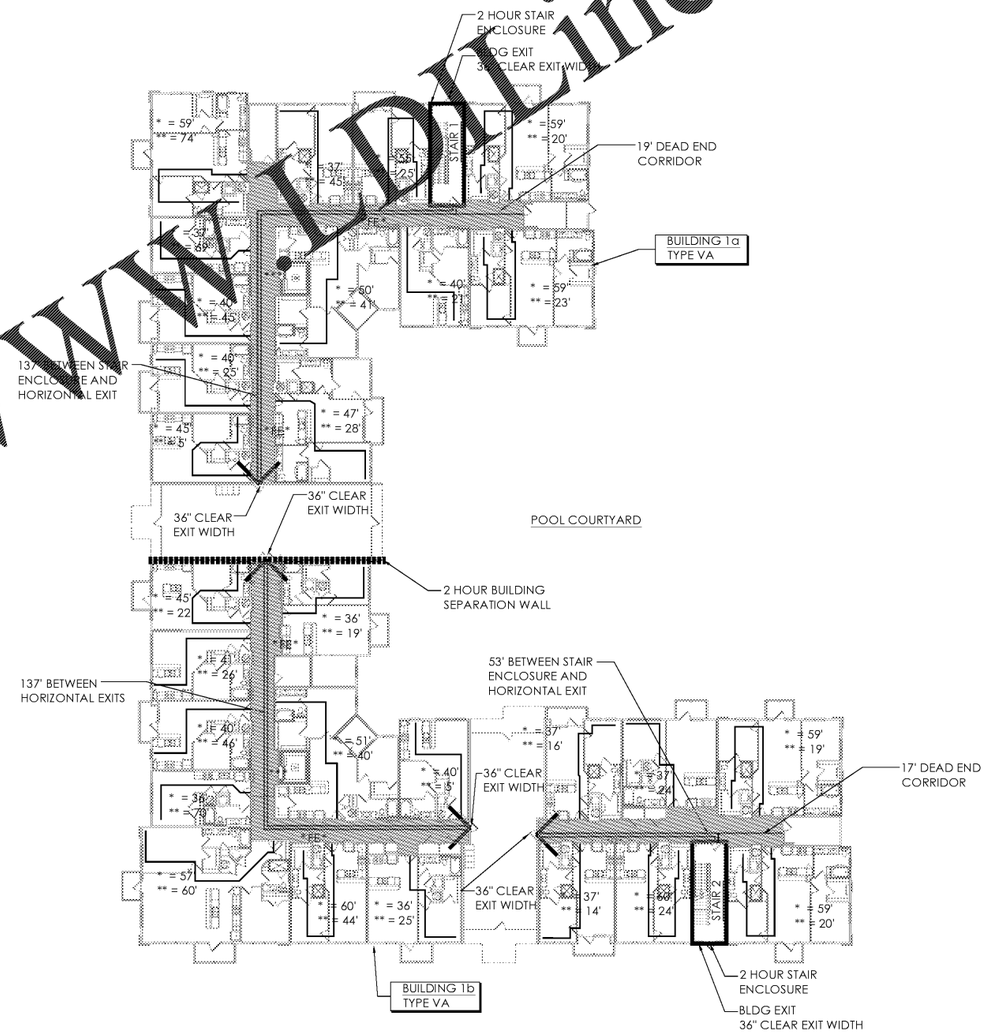

1 Life Safety - Level 1 - Building 1
Scale: 1/16" = 1'-0"

Order Plans @ WWLDLine.com

Seal

MICHAEL K. POOLE
REGISTERED
ARCHITECT
No. 100001
STATE OF TENNESSEE

May 15, 2020

2PA
POOLE & POOLE ARCHITECTURE
3736 Winterfield Road, Suite 102
Midlothian, Virginia 23113
Telephone 804.225.0215
www.2pa.net

Project:	1928.00
CADD File:	CODE
Drawn By:	SGS
Checked By:	GA

Permit Release:
May 15, 2020
Construction Release Set:
May 15, 2020

Revisions

No.	Date	Description

ASI / RFI Revisions

No.	Date	Description

© 2019 Poole & Poole Architecture, LLC
Drawings and specifications are and shall remain the property of Poole & Poole Architecture, LLC and shall not be used or reproduced in whole or part in any form without prior written consent of Poole & Poole Architecture, LLC.

Borough 33
an Apartment Community by
33 Broad MF, LLC
in Chattanooga, Tennessee

Drawing Title:
Life Safety Plans
Building 1

A0.3c

ISSUED FOR CONSTRUCTION