

LEGEND:

- *FE* = LOCATE CLASS 2A FIRE EXTINGUISHERS IN RECESSED CABINETS (NON-RATED / RATED RELATIVE TO PLAN LOCATION). FIRE EXTINGUISHERS LOCATED AT CIP AND PRECAST WALLS TO BE SURFACED MOUNTED. SEE 9&10/A1.0a FOR PLAN DETAILS. MAXIMUM SEPARATION BETWEEN TWO UNITS IS 150' ALONG CENTERLINE OF CORRIDOR. SET TOP OF EXTINGUISHER AT 4'-6" ABOVE FINISH FLOOR.
- * = TRAVEL DISTANCE FROM MOST REMOTE POINT OF DWELLING UNIT TO CORRIDOR NOT EXCEEDING 125' PER NFPA 101, SECTION 30.2.6.
- ** = TRAVEL DISTANCE FROM DWELLING UNIT ENTRY DOOR TO NEAREST EXIT NOT EXCEEDING 200' AS REQUIRED PER NFPA 101, SECTION 30.2.6.3.2.
- *** = LOCATE A TWO-WAY COMMUNICATION SYSTEM PER NBC, SECTION 707.8

Seal



May 15, 2020

ZPA

POOLE & POOLE ARCHITECTURE
 3736 Winterfield Road, Suite 102
 Midlothian, Virginia 23113
 Telephone 804.275.0215
 www.zpa.net

Project: 1928.00
 CADD File: CODE
 Drawn By: SG5
 Checked By: GA

Permit Release:
 May 15, 2020
 Construction Release Set:
 May 15, 2020

Revisions

No.	Date	Description

ASI / RFI Revisions

No.	Date	Description

© 2019 Poole & Poole Architecture, LLC. Drawings and specifications are not to be relied upon by anyone other than the user. The user shall be responsible for obtaining all necessary permits and approvals from the appropriate authorities. Poole & Poole Architecture, LLC is not responsible for any errors or omissions in these drawings and specifications.


Borough 33
 an Apartment Community by
 33 Broad MF, LLC
 in Chattanooga, Tennessee




Drawing Title:
 Life Safety Plans
 Building 2

A0.3d

ISSUED FOR CONSTRUCTION

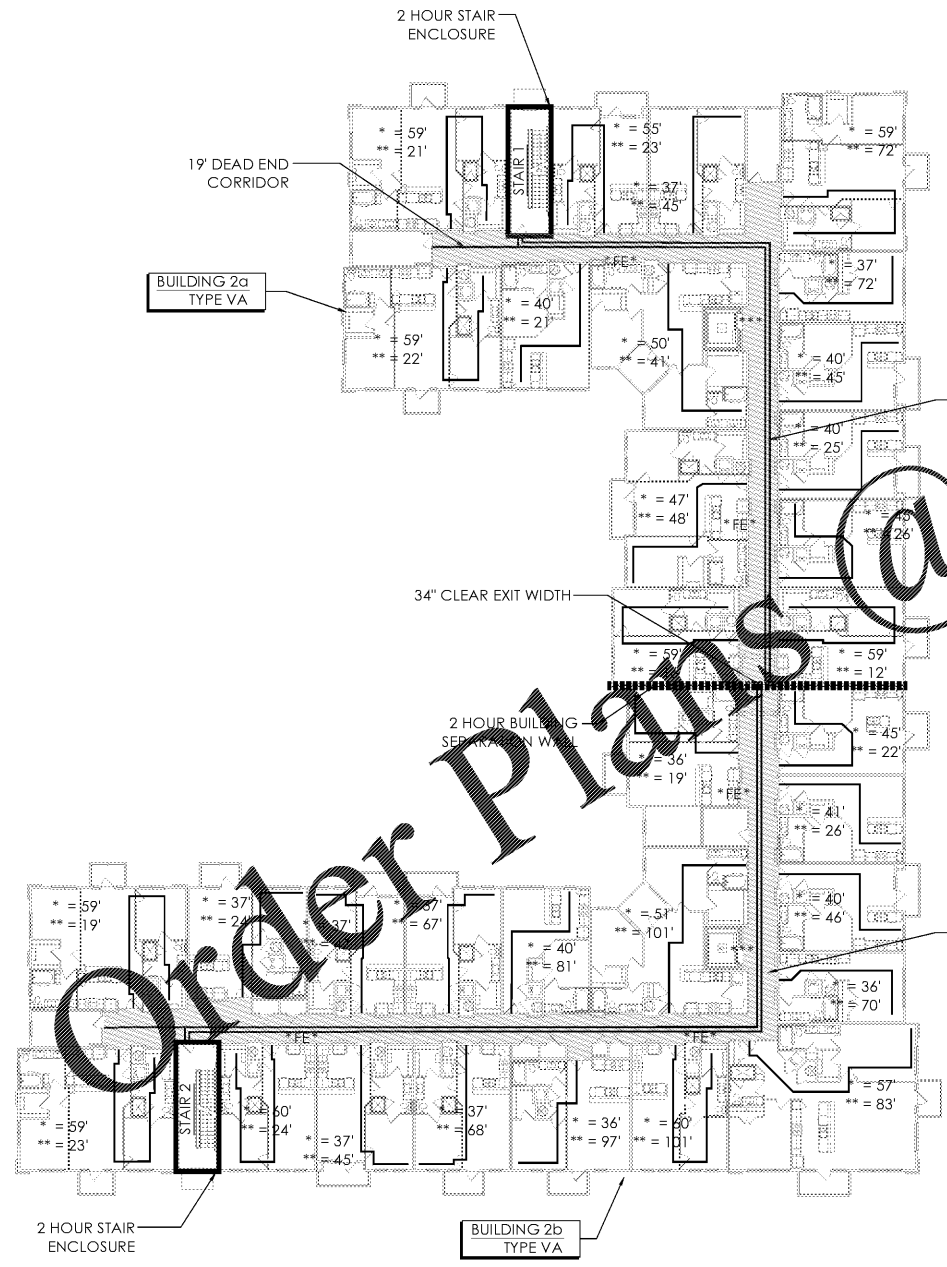

② Life Safety - Levels 2-4 - Building 2
 Scale: 1/16" = 1'-0"

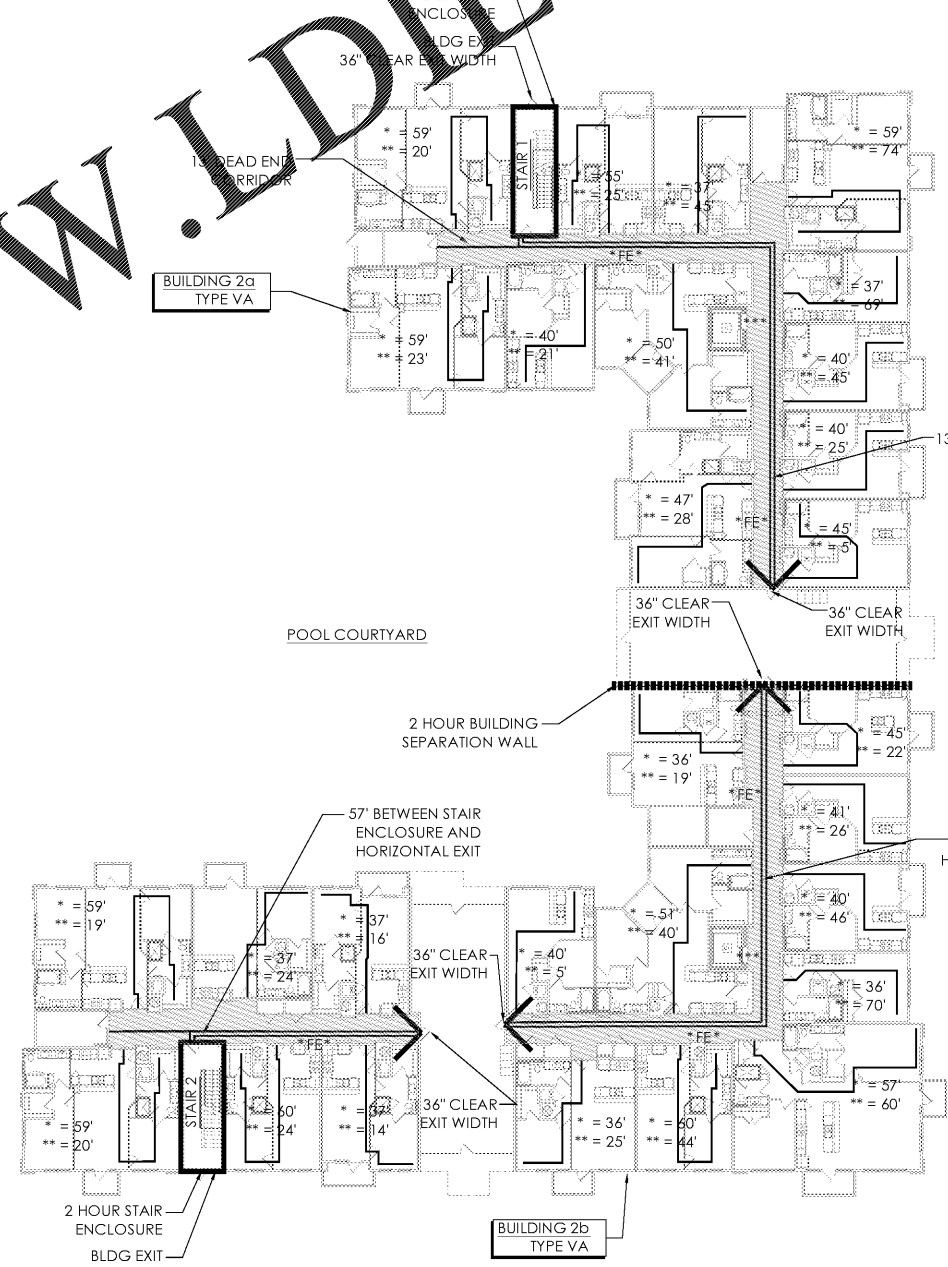

① Life Safety - Level 1 - Building 2
 Scale: 1/16" = 1'-0"

Order Plans @ www.IDILine.com