

Order Plans @ WWW.LDILine.com

- NOTES:
1. SEE M.I.X. SERIES SHEETS FOR APARTMENT HVAC.
 2. ALL CORRIDOR SUPPLY AIR DUCT & AIR DISTRIBUTION IS LOCATED IN RATED ASSEMBLY. PROVIDE C.R.D. FOR EACH PENETRATION.
 3. FOR MECHANICAL SYSTEMS SERVING THE CORRIDORS, THE O.A. INTAKE LOWER SHALL BE INSTALLED A MINIMUM OF 10'-0" FROM APARTMENT UNITS TOILET EXHAUST. ADJUST TERMINATION POINT OF EXHAUST DUCTS AS NECESSARY FOR EACH APARTMENT UNIT.
 4. O.A. DUCT AT MECHANICAL CLOSET WILL REQUIRE A C.R.D. AT CEILING PENETRATION.
 5. PROVIDE FSD WHERE MECHANICAL UNIT RETURNS PENETRATE CORRIDOR WALLS.
 6. REFRIGERANT LINES ARE TO BE RUN THRU MECHANICAL CLOSETS.

Seal



03/19/21



ZPA
POOLE & POOLE ARCHITECTURE
3736 Winterfield Road, Suite 102
Midlothian, Virginia 23113
Telephone 804.225.0215
www.zpa.net

Project: 1928
CADD File:
Drawn By: JC
Checked By: CB

Permit Release:
May 15, 2020
Construction Release Set:
May 15, 2020

Revisions

No.	Date	Description
1	03/19/21	Owner Comments


ASI / RFI Revisions

No.	Date	Description
-----	------	-------------

© 2019 Poole & Poole Architects, LLC. Drawings and specifications are the property of Poole & Poole Architects, LLC and shall not be used or reproduced without the prior written consent of Poole & Poole Architects, LLC.


PHILLIP GRADNICK
ENGINEERING, P.C.
1010 N. Brentwood Drive
Chattanooga, TN 37416
PH: 423.242.1111
CELL: 423.242.1111
FAX: 423.242.1111

Borough 33
an Apartment Community by
33 Broad MF, LLC
in Chattanooga, Tennessee



Drawing Title:
Building 1
Building Plan

M2.1a

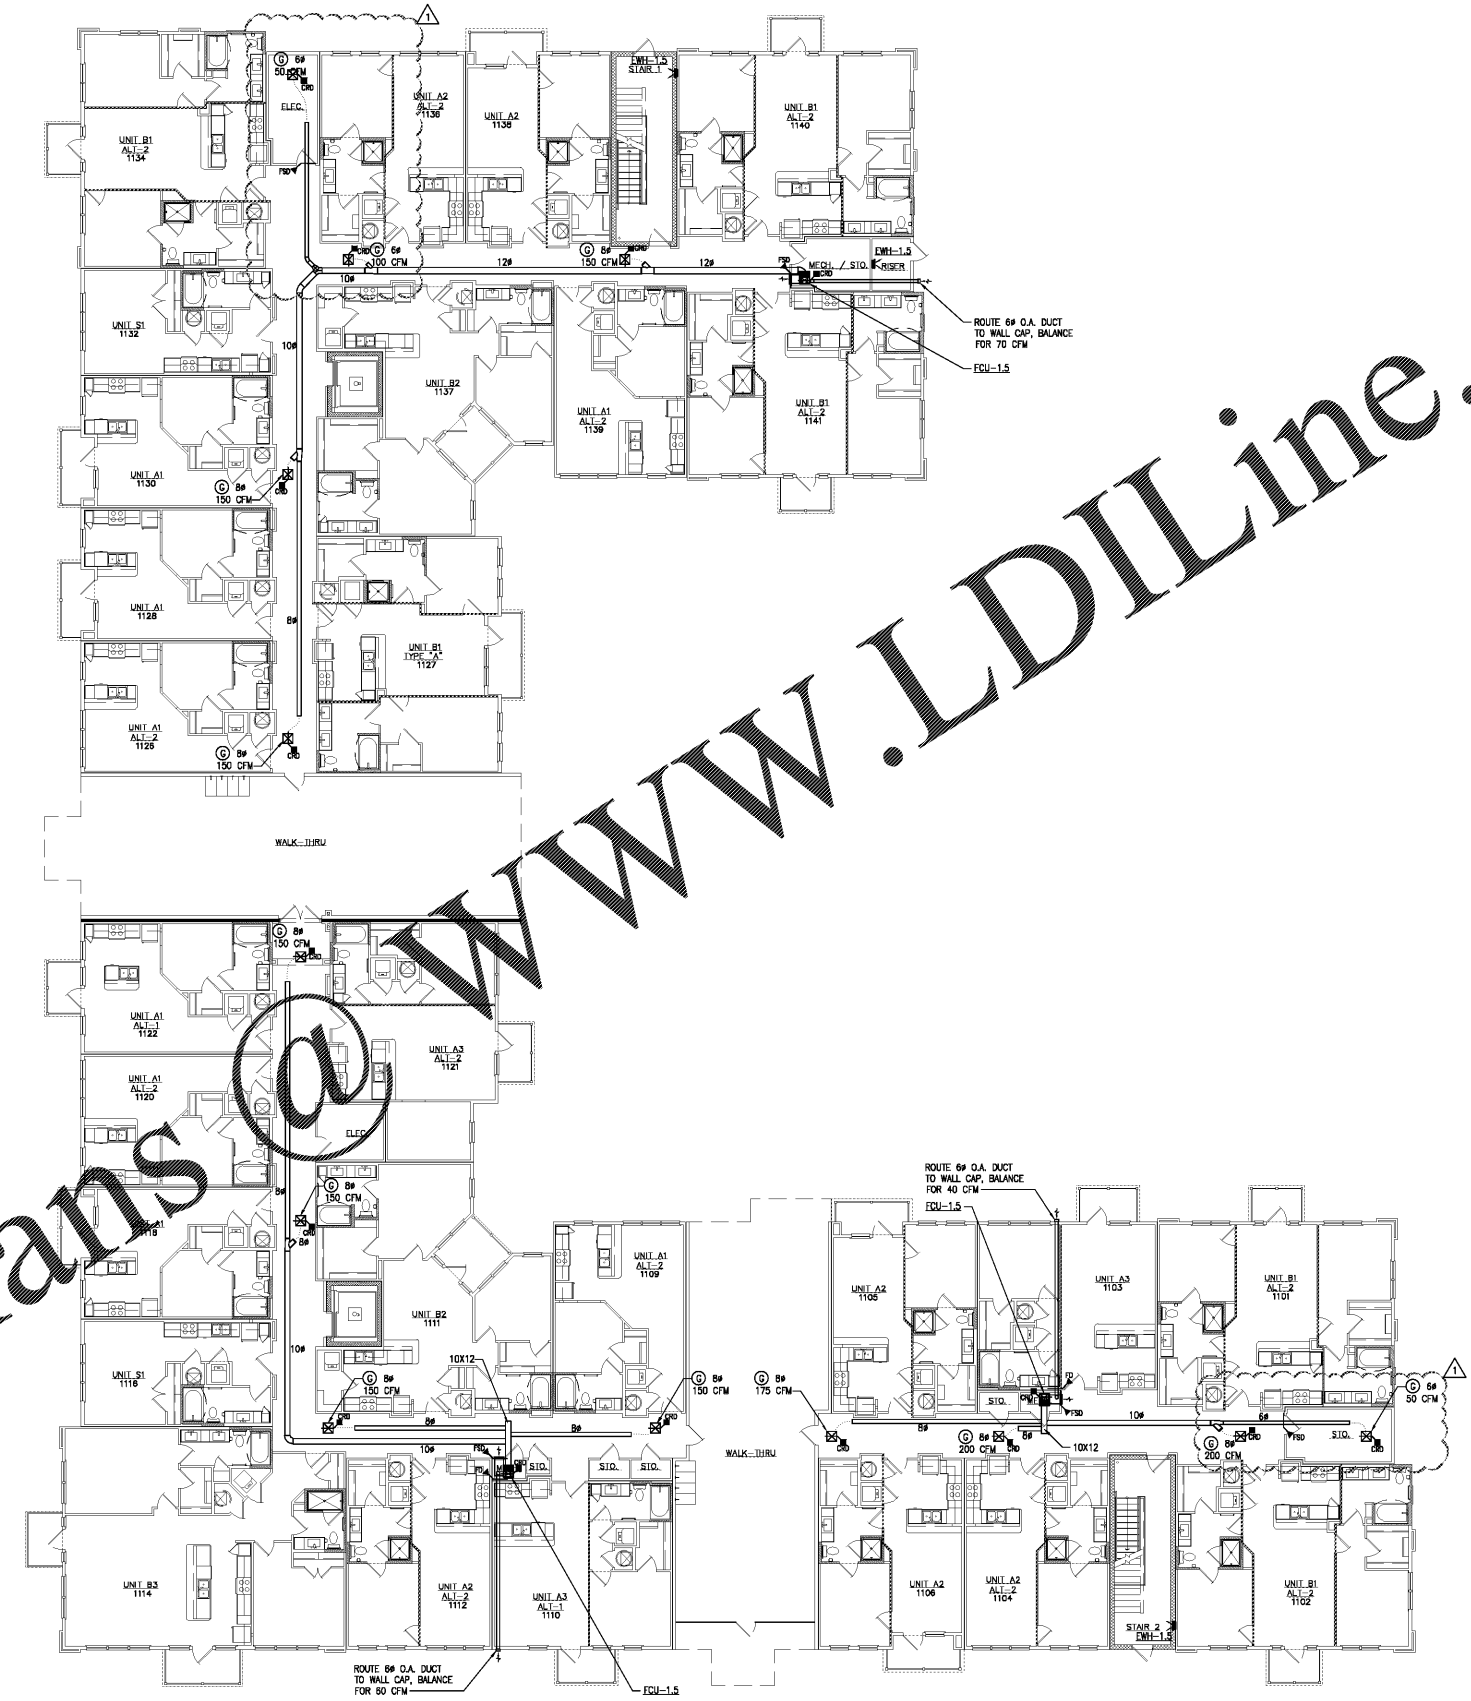

1 Building 1 - First Level
Scale: 3/32" = 1'-0"

Plan

ISSUED FOR CONSTRUCTION