

- NOTES:
1. SEE M1.X SERIES SHEETS FOR APARTMENT HVAC.
 2. ALL CORRIDOR SUPPLY AIR DUCT & AIR DISTRIBUTION IS LOCATED IN RATED ASSEMBLY. PROVIDE C.R.D. FOR EACH PENETRATION.
 3. FOR MECHANICAL SYSTEMS SERVING THE CORRIDORS, THE O.A. INTAKE LOUVER SHALL BE INSTALLED A MINIMUM OF 10'-0" FROM APARTMENT UNITS TOILET EXHAUST. ADJUST TERMINATION POINT OF EXHAUST DUCTS AS NECESSARY FOR EACH APARTMENT UNIT.
 4. O.A. DUCT AT MECHANICAL CLOSET WILL REQUIRE A C.R.D. AT CEILING PENETRATION.
 5. PROVIDE FSD WHERE MECHANICAL UNIT RETURNS PENETRATE CORRIDOR WALLS.
 6. REFRIGERANT LINES ARE TO BE RUN THRU MECHANICAL CLOSETS.

Seal



03/19/21

ZPA

POOLE & POOLE ARCHITECTURE
 3736 Winterfield Road, Suite 102
 Midlothian, Virginia 23113
 Telephone 804.225.0215
 www.zpa.net

Project: 1928
 CADD File:
 Drawn By: JC
 Checked By: CB

Permit Release:
 May 15, 2020
 Construction Release Set:
 May 15, 2020

Revisions

No.	Date	Description
1	03/19/21	Owner Comments

ASI / RFI Revisions

No.	Date	Description
-----	------	-------------

© 2019 Poole & Poole Architecture, LLC. All rights reserved. No part of this drawing may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopying, recording, or by any information storage and retrieval system, without prior written consent of Poole & Poole Architecture, LLC.


PROF. CHAD R. POOLE
 ENGINEERING, P.C. P.E. # 12547
 1210 W. Shiloh Road
 Chattanooga, TN 37408 (423) 844-3800

Borough 33
 an Apartment Community by
 33 Broad MF, LLC
 in Chattanooga, Tennessee

Drawing Title:
 Building 3
 Building Plans - HVAC


M2.3b

ISSUED FOR CONSTRUCTION

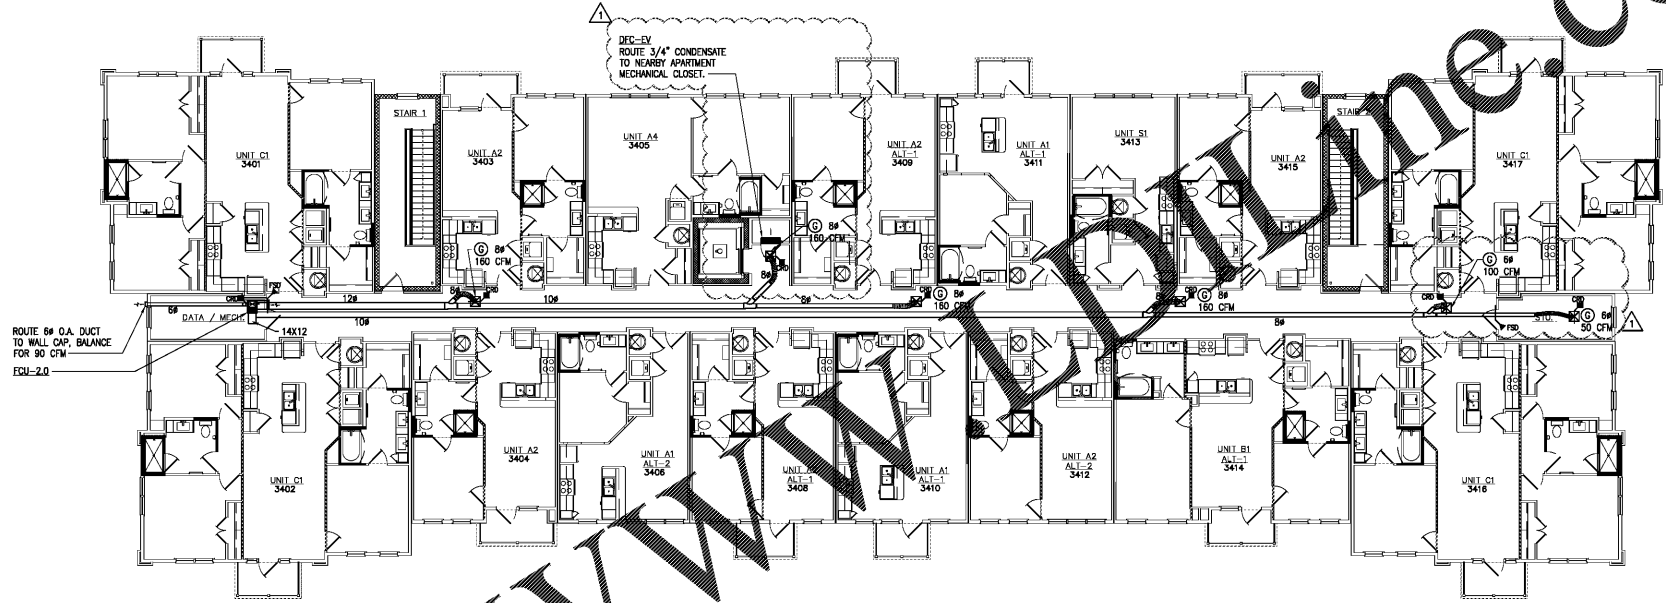

2 Building 3 - Fourth Level
 Scale: 3/32" = 1'-0"

Plan

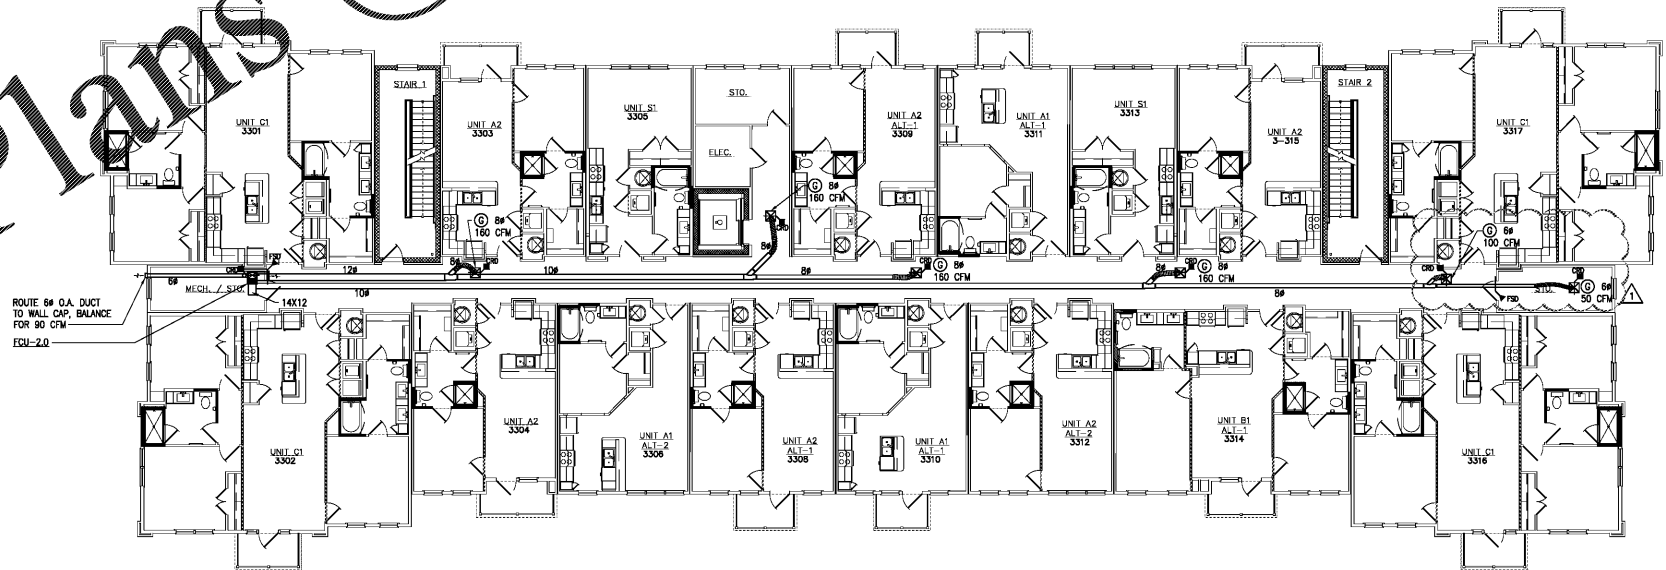

1 Building 3 - Third Level
 Scale: 3/32" = 1'-0"

Plan

Order Plans @ www.dynline.com